# Twido programmable controllers Hardware Reference Guide

TWD USE 10AE eng Version 3.2





### **Table of Contents**



	Safety Information7
	About the Book11
Chapter 1	Twido Overview         13           At a Glance         13           About Twido         14           Maximum Hardware Configuration         21           Main Functions of the Controllers         24           Communication Overview         26
Chapter 2	Descriptions, Specifications, and Wiring29
2.1	At a Glance
2.2	Compact Controller
	Description of Analog Potentiometers
	I/O Specifications for the Compact Controller
2.3	Compact Controller Wiring Schematics.54Modular Controller.59At a Glance.59Overview of Modular Controllers.60Description of Analog Potentiometers.62Overview of Analog Voltage Input.63Parts Description of a Modular Controller64General Specifications for the Modular Controllers.65Functional Specifications for the Modular Controllers.67I/O Specifications for the Modular Controllers.69Modular Controller Wiring Schematics75

2.4	Digital I/O Modules	. 79
	At a Glance	
	Overview of Digital I/O Modules	. 80
	Parts Description of Digital I/O Modules	. 83
	Specifications for the Digital I/O Modules	. 85
	Digital I/O Module Wiring Schematics	
2.5	Analog I/O Modules	
	At a Glance	
	Overview of Analog I/O Modules	
	Parts Description of Analog I/O Modules.	
	General Specifications for the Analog I/O Module	
	I/O Specifications for the Analog I/O Module	
	Analog I/O Modules Wiring Schematics.	
2.6	AS-Interface V2 bus master module	
2.0	At a Glance	
	Reminder about the AS-Interface bus	
	Presentation of the main constituent elements of the AS-Interface bus	
	Main specifications of the AS-Interface V2 Bus	
	Parts description of an AS-Interface master module: TWDNOI10M3	
	Technical specifications of the TWDNOI10M3 module and the AS-Interface V2 bus .	
	Wiring and connections	
	TWDNOI10M3 Operating Modes and Push Buttons	
	AS-Interface module TWDNOI10M3 display panel	
2.7	CANopen fieldbus master module	
	At a Glance	
	About the CANopen Fieldbus	
	CANopen Fieldbus Topology	
	Cable Length and Transmission Speed	
	Dimensions of the CANopen master module: TWDNCO1M	
	Parts description of a CANopen master module: TWDNCO1M	
	Technical specifications of the TWDNCO1M module and the CANopen fieldbus	
	CANopen Wiring and Connections	
2.8	Communication Options	158
	At a Glance	158
	Overview of Communication Adapters and Expansion Modules	159
	Parts Description of Communication Adapters and Expansion Modules	160
	Specifications for Communication Adapters and Expansion Modules	
2.9	Operator Display Options	
	At a Glance	
	Overview of Operator Display Modules and Expansion Modules	
	Parts Description of Operator Display Module and Expansion Module	
	Specifications for Operator Display Modules and Expansion Modules	

2.10	Options	168
	At a Glance	168
	Overview of the Options	169
	Specifications for the Options	
2.11	The ConneXium TwidoPort Ethernet Interface Module	171
	At a Glance	171
	Overview of the ConneXium TwidoPort Ethernet Interface Module	172
	TwidoPort's External Features	173
	TwidoPort's LED-Panel Description	174
	TwidoPort's Wiring	176
	General Specifications	177
2.12	Telefast® Pre-Wired Systems for Twido	179
	At a Glance	179
	Overview of the Telefast® Pre-Wired System for Twido	180
	Specifications for the Telefast® Bases	183
	Telefast® Bases Wiring Schematics	185
Chantes 2	Installation	100
Chapter 3		
	At a Glance	
	Dimensions of the Compact Controllers	
	Dimensions for the Modular Controllers	
	Dimensions for the Digital and Analog I/O Modules	
	Dimensions of AS-Interface V2 bus master module: TWDNOI10M3	
	Dimensions for the Operator Display Module, Operator Display Expansion Module	
	and Communication Expansion Modules	203
	Installation Preparation	
	Controller, Expansion I/O Module, AS-Interface Bus Master Module and	200
	CANopen Fieldbus Master Module Mounting Positions	207
	Assembling an expansion I/O, an AS-Interface bus master module or	207
	a CANopen fieldbus master module to a controller	200
	Disassembling an Expansion I/O, an AS-Interface Bus Master Module or a	209
	CANopen Fieldbus Master Module from a Controller	011
	How to Install the Operator Display Module and Operator Display Expansion Module.	
	Installing a Communication Adapter and an Expansion Module	
	How to Install the TwidoPort Ethernet Interface Module	
	How to Install a Memory or RTC Cartridge	
	Removing a Terminal Block	
		220
	How to Install and Remove a Controller, an Expansion I/O Module, an AS-Interface Bus Interface Module or a CANopen Fieldbus Master Module	
	·	227
	from a DIN Rail	
	Minimum Clearances for Controllers and Expansion I/O Modules in a Control Panel	
	How to Connect the Power Supply	
	How to Install and Replace an External Battery	241

Chapter 4	Special Functions	. 245
-	At a Glance	
	RUN/STOP Input	
	Controller Status Output	
	Latching input	
	Fast Counting	
	Very Fast Counters	
	Pulse (PLS) Generator Output	
	Pulse Width Modulation (PWM) Output	
Chantar F	, ,	
Chapter 5	Powering-Up and Troubleshooting	
	At a Glance	
	Procedure for First Time Power-Up of a Controller	
	Checking I/O Connections on the Base Controller	
	Troubleshooting Using the Controller's LEDs	258
Chapter 6	Agency Compliance	. 261
•p.:•.	Agency Requirements	
	Agency requirements	201
Appendices		263
(ppoliaiooo	At a Glance	
	At a Glarice	203
Appendix A	IEC Symbols	. 265
	Glossary of Symbols	
	, ,	
Glossary		.267
•		
Index		.273

#### **Safety Information**



#### **Important Information**

#### NOTICE

Read these instructions carefully, and look at the equipment to become familiar with the device before trying to install, operate, or maintain it. The following special messages may appear throughout this documentation or on the equipment to warn of potential hazards or to call attention to information that clarifies or simplifies a procedure.



The addition of this symbol to a Danger or Warning safety label indicates that an electrical hazard exists, which will result in personal injury if the instructions are not followed.



This is the safety alert symbol. It is used to alert you to potential personal injury hazards. Obey all safety messages that follow this symbol to avoid possible injury or death.

### **A** DANGER

DANGER indicates a hazardous situation, which **will result** in death, serious injury or equipment damage.



WARNING indicates a situation presenting risks liable to **provoke** death, serious injury or equipment damage.



CAUTION indicates a potentially hazardous situation, which, **can result** in personal injury or equipment damage.

#### PLEASE NOTE

Electrical equipment should be serviced only by qualified personnel. No responsibility is assumed by Schneider Electric for any consequences arising out of the use of this material. This document is not intended as an instruction manual for untrained persons. Assembly and installation instructions are provided in the Twido Hardware Reference Manual. TWD USE 10AE.

(c) 2002-2005 Schneider Electric

All Rights Reserved

## Additional Safety

Those responsible for the application, implementation or use of this product must ensure that the necessary design considerations have been incorporated into each application, completely adhering to applicable laws, performance and safety requirements, regulations, codes and standards.

#### General Warnings and Cautions

### **A** DANGER

#### HAZARD OF ELECTRIC SHOCK, BURN OR EXPLOSION

Turn off all power before starting installation, removal, wiring, maintenance or inspection of the smart relay system.

Failure to follow this instruction will result in death or serious injury.



#### **EXPLOSION HAZARD**

- Substitution of components may impair suitability for Class I, Div 2 compliance.
- Do not disconnect equipment unless power has been switched off or the area is known to be non-hazardous.

Failure to follow this instruction can result in death, serious injury, or equipment damage.



#### UNINTENDED EQUIPMENT OPERATION

- Turn power off before installing, removing, wiring, or maintaining.
- This product is not intended for use in safety critical machine functions. Where
  personnel and or equipment hazards exist, use appropriate safety interlocks.
- Do not disassemble, repair, or modify the modules.
- This controller is designed for use within an enclosure.
- Install the modules in the operating environment conditions described.
- Use the sensor power supply only for supplying power to sensors connected to the module.
- For power line and output circuits, use a fuse designed to Type T standards per IEC60127. The fuse must meet the circuit voltage and current requirements.
   Recommended: Littelfuse<sup>®</sup> 218 Series, 5x20mm time lag (slow blow) fuses.

Failure to follow this instruction can result in death, serious injury, or equipment damage.

#### Safe Battery Disposal

The TWDLCA•40DRF compact bases use an optional external lithium battery for longer duration of data backup. (Note: The lithium battery is not supplied with the compact bases; you must purchase it separately.)



#### **EXPLOSION AND TOXIC HAZARD**

- Do not incinerate a lithium battery for it may explode and release toxic substances.
- Do not handle damaged or leaking lithium battery.
- Dead batteries shall be disposed of properly, for improper disposal of unused batteries can cause harm, as well as environmental damage.
- In some areas, the disposal of lithium batteries with household or business trash
  collection may be prohibited. In any case, it is your responsibility to always
  conform to local regulations in your area, as regard to battery disposal.

Failure to follow this instruction can result in death, serious injury, or equipment damage.

## Reverse Polarity Warning

#### Reverse-Polarity at Transistor Output is Not Allowed

The TWDLCA•40DRF compact bases transistor outputs cannot withstand any reverse polarity.



#### RISK OF REVERSE-POLARITY DAMAGE AT TRANSISTOR OUTPUTS

- Make sure to conform to the polarity markings on the transistor output terminals.
- Use of a reverse polarity can permanently damage or destroy the output circuits.

Failure to follow this instruction can result in injury or equipment damage.

#### **About the Book**

#### At a Glance

Document Scope

This manual provides parts descriptions, specifications, wiring schematics, installation, set up, and troubleshooting information for all Twido products.

Validity Note

The information in this manual is applicable only for Twido products.

**Product Related**Warnings
Schneider Electric assumes no responsibility for any errors that appear in this document. No part of this document may be reproduced in any form or means, including electronic, without prior written permission of Schneider Electric.

**User Comments** We welcome your comments about this document. You can reach us by e-mail at techpub@schneider-electric.com

**Twido Overview** 

1

#### At a Glance

#### Introduction

This chapter provides an overview of the Twido products, the maximum configurations, the main functions of the controllers, and an overview of the communication system.

## What's in this Chapter?

This chapter contains the following topics:

Topic	Page
About Twido	14
Maximum Hardware Configuration	21
Main Functions of the Controllers	24
Communication Overview	26

#### **About Twido**

#### Introduction

The Twido controller is available in two models:

- Compact
- Modular

The Compact controller is available with:

- 10 I/Os
- 16 I/Os
- 24 I/Os
- 40 I/Os

The Modular controller is available with:

- 20 I/Os
- 40 I/Os

Additional I/O can be added to the controllers using expansion I/O modules. They are:

- 15 expansion modules of the digital I/O or relay type
- 8 expansion modules of the analog I/O type

Connecting to an AS-Interface bus interface module also allows you to manage up to 62 slave devices. Use the following module:

• AS-Interface V2 bus interface master module: TWDNOI10M3.

The 24 I/O and 40 I/O compact base controllers and all modular base controllers can connect to a CANopen fieldbus interface module that allows you to manage up to 16 CANopen slave devices (not to exceed 16 Transmit-PDOs (TPDO) and 16 Receive-PDOs (RPDO)). Use the following module:

• CANopen fieldbus interface master module: TWDNCO1M.

There are also several options that can be added to the base controllers:

- Memory cartridges
- Real-Time Clock (RTC) cartridge
- Communication adapters
- Communication expansion modules (Modular controller only)
- Ethernet interface module (all Modular and Compact controllers, except TWDLCAE40DRF with on-board Ethernet interface)
- Operator display module (Compact controller only)
- Operator display expansion module (Modular controller only)
- Input simulators (Compact controller only)
- Programming cables
- Digital I/O cables
- Telefast<sup>®</sup> pre-wired systems with I/O interfaces

Advanced integrated features are provided on the TWDLCAA40DRF and TWDLCAE40DRF series compact base controllers:

- Built-in 100Base-TX Ethernet network port: TWDLCAE40DRF only
- Onboard Real-Time Clock (RTC): TWDLCAA40DRF and TWDLCAE40DRF
- A fourth Fast Counter (FC):TWDLCAA40DRF and TWDLCAE40DRF
- External battery support:TWDLCAA40DRF and TWDLCAE40DRF

#### Controller Models

The following table lists the controllers:

Controller Name	Reference	Channels	Channel type	Input/Output type	Power supply
Compact 10 I/O	TWDLCAA10DRF	6	Inputs	24 VDC	100/240 VAC
		4	Outputs	Relay	
Compact 10 I/O	TWDLCDA10DRF	6	Inputs	24 VDC	24 VDC
		4	Outputs	Relay	
Compact 16 I/O	TWDLCAA16DRF	9	Inputs	24 VDC	100/240 VAC
		7	Outputs	Relay	
Compact 16 I/O	TWDLCDA16DRF	9	Inputs	24 VDC	24 VDC
		7	Outputs	Relay	
Compact 24 I/O	TWDLCAA24DRF	14	Inputs	24 VDC	100/240 VAC
		10	Outputs	Relay	
Compact 24 I/O	TWDLCDA24DRF	14	Inputs	24 VDC	24 VDC
		10	Outputs	Relay	
Compact 40 I/O	TWDLCAA40DRF	24 16	Inputs Outputs	24 VDC Relay X 14 Transistors X 2	100/240 VAC
Compact 40 I/O	TWDLCAE40DRF	24 16	Inputs Outputs	24 VDC Relay X 14 Transistors X 2 Ethernet port	100/240 VAC
Modular 20 I/O	TWDLMDA20DUK	12	Inputs	24 VDC	24 VDC
		8	Outputs	Transistor sink	
Modular 20 I/O	TWDLMDA20DTK	12	Inputs	24 VDC	24 VDC
		8	Outputs	Transistor source	
Modular 20 I/O	TWDLMDA20DRT	12	Inputs	24 VDC	24 VDC
		6 2	Outputs Outputs	Relay Transistor source	
Modular 40 I/O	TWDLMDA40DUK	24	Inputs	24 VDC	24 VDC
		16	Outputs	Transistor sink	
Modular 40 I/O	TWDLMDA40DTK	24	Inputs	24 VDC	24 VDC
		16	Outputs	Transistor source	
	1	1	1	1	

#### Digital Expansion I/O Modules

The following table lists the digital and relay expansion I/O modules:

Module Name	Reference	Channels	Channel type	Input/Output type	Terminal type
Input modules	1		1		
8-point input	TWDDDI8DT	8	Inputs	24 VDC	Removable terminal block
8-point input	TWDDAI8DT	8	Inputs	120 VAC	Removable terminal block
16-point input	TWDDDI16DT	16	Inputs	24 VDC	Removable terminal block
16-point input	TWDDDI16DK	16	Inputs	24 VDC	Connector
32-point input	TWDDDI32DK	32	Inputs	24 VDC	Connector
Output Modules					
8-point output	TWDDD08UT	8	Outputs	Transistor sink	Removable terminal block
8-point output	TWDDD08TT	8	Outputs	Transistor source	Removable terminal block
8-point output	TWDDRA8RT	8	Outputs	Relay	Removable terminal block
16-point output	TWDDRA16RT	16	Outputs	Relay	Removable terminal block
16-point output	TWDDDO16UK	16	Outputs	Transistor sink	Connector
16-point output	TWDDDO16TK	16	Outputs	Transistor source	Connector
32-point output	TWDDDO32UK	32	Outputs	Transistor sink	Connector
32-point output	TWDDDO32TK	32	Outputs	Transistor source	Connector
Mixed modules					
4-point input/4-	TWDDMM8DRT	4	Inputs	24 VDC	Removable
point output		4	Outputs	Relay	terminal block
16-point input/8-	TWDDMM24DRF	16	Inputs	24 VDC	Non-removable
point output		8	Outputs	Relay	terminal block

## Analog Expansion I/O Modules

The following table lists the analog expansion I/O modules:

Module name	Reference	Channel	Channel type	Details	Terminal type
2 high level inputs	TWDAMI2HT	2	Inputs	12 bits 0-10V, 4-20mA	
1 high level output	TWDAMO1HT	1	Outputs	12 bits 0-10V, 4-20mA	
2 high level	TWDAMM3HT	2	Inputs	12 bits 0-10V, 4-20mA	
inputs/1 output		1	Output	12 bits 0-10V, 4-20mA	
2 low level	TWDALM3LT	2	Inputs	12 bits Thermocouple, RTD	Removable
inputs/1 high level output		1	Output	12 bits 0-10V, 4-20mA	terminal block
2 high level outputs	TWDAVO2HT	2	Outputs	11 bits + sign, +/-10V	
4 low level inputs	TWDAMI4LT	4	Inputs	12 bits 0-10V, 0-20mA, 3-wire PT100, PT1000, NI100 and NI1000	
8 high level	TWDAMI8HT	8	Inputs	10 bits 0-10V, 0-20mA	
inputs	TWDARI8HT	8	Inputs	10 bits, NTC or PTC sensors	

#### AS-Interface V2 bus master module

Module name	Reference	Number of slaves	Maximum number of channels	Power supply	Terminal type
AS-Interface master	TWDNOI10M3	Maximum 62	248 inputs 186 outputs	30 VDC	Removable terminal block

## CANopen fieldbus master module

The following table lists the specifications of the CANopen field bus master module:  $\label{eq:canonical}$ 

Module name	Reference	Number of slaves	Maximum number of channels	Power supply	Terminal type
CANopen master	TWDNCO1M	Maximum 16	16 TPDOs 16 RPDOs	24 VDC	Removable terminal block

**Telefast<sup>®</sup> pre- The following table lists the various Telefast<sup>®</sup> bases for Twido: wired systems** 

I/O sub-bases	Reference	Inputs	Outputs
For Twido modular base	ABE 7B20MPN20	12 inputs	8 passive outputs
controllers	ABE 7B20MPN22	12 inputs	8 passive outputs with individual fuse protection and LED
	ABE 7B20MRM20	12 inputs	8 outputs with soldered relays
For Twido expansion modules	ABE 7E16EPN20	16 passive inputs	_
	ABE 7E16SPN20	_	16 passive outputs
	ABE 7E16SPN22	_	16 passive outputs with indivdual fuse protection and LED
	ABE 7E16SRM20	_	16 soldered relay outputs
Optional terminal blocks	ABE 7BV20TB	12 shunted screw terminals for the input common	8 shunted screw terminals for the output common
	ABE 7BV20	20 shunted screw terminals	for connection of a single common

#### **Options** The following table lists the options:

Option name	Reference	
Operator display module	TWDXCPODC	
Operator display expansion module	TWDXCPODM	
Real Time Clock (RTC) cartridge	TWDXCPRTC	
32 Kb EEPROM memory cartridge	TWDXCPMFK32	
64 Kb EEPROM memory cartridge	TWDXCPMFK64	
Communication adapter, RS485, miniDIN	TWDNAC485D	
Communication adapter, RS232, miniDIN	TWDNAC232D	
Communication adapter, RS485, terminal	TWDNAC485T	
Communication expansion module, RS485, miniDIN	TWDNOZ485D	
Communication expansion module, RS232, miniDIN	TWDNOZ232D	
Communication expansion module, RS485, terminal	TWDNOZ485T	
ConneXium TwidoPort Ethernet interface module	499TWD01100	
6-point input simulator	TWDXSM6	
9-point input simulator	TWDXSM9	
14-point input simulator	TWDXSM14	
External backup battery (TWDLCA•40DRF only)	TSXPLP01 (single battery order) TSXPLP101 (10 pack order)	
5 mounting strips	TWDDXMT5	

Option name	Reference
2 terminal blocks (10 positions)	TWDFTB2T10
2 terminal blocks (11 positions)	TWDFTB2T11
2 terminal blocks (13 positions)	TWDFTB2T13
2 terminal blocks (16 positions)	TWDFTB2T16T
2 connectors (20 pins)	TWDFCN2K20
2 connectors (26 pins)	TWDFCN2K26

#### **Cables** The following table lists the cables:

Cable name	Reference
Programming cables	
PC to controller programming cable: Serial	TSXPCX1031
PC to controller programming cable: USB	TSXPCX3030
Mini-DIN to free wire communication cable	TSXCX100
Digital I/O Cables	
3 meter, connector for controller to free wire	TWDFCW30M
5 meter, connector for controller to free wire	TWDFCW50M
3 meter, connector for expansion I/O module to free wire	TWDFCW30K
5 meter, connector for expansion I/O module to free wire	TWDFCW50K
AS-Interface Cables	
Standard two-wire AS-Interface ribbon cable for sending data and power to slave devices	see AS-Interface Wiring System catalog available from your local Schneider representative
Standard two-wire round cable for sending data and power to slave devices	see AS-Interface Wiring System catalog available from your local Schneider representative
Telefast <sup>®</sup> Cables for Twido base controllers and expansion modules	
for Twido modular base controllers	
Cable equipped with a 26-way HE 10 connector at each end. (AWG 28 $$ / 0.08 mm <sup>2</sup> ; length: 0.5 m / 1.64 ft)	ABF T26B050
Cable equipped with a 26-way HE 10 connector at each end. (AWG 28 $/$ 0.08 mm $^2$ ; length: 1 m $/$ 3.28 ft)	ABF T26B100

Cable name	Reference
Cable equipped with a 26-way HE 10 connector at each end. (AWG 28	ABF T26B200
/ 0.08 mm <sup>2</sup> ; length: 2 m / 6.56 ft)	
for Twido discrete I/O expansion modules	
Cable equipped with a 20-way HE 10 connector at each end. (AWG 28	ABF T20E050
/ 0.08 mm <sup>2</sup> ; length: 0.5 m / 1.64 ft)	
Cable equipped with a 20-way HE 10 connector at each end. (AWG 28	ABF T20E100
/ 0.08 mm <sup>2</sup> ; length: 1 m / 3.28 ft)	
Cable equipped with a 20-way HE 10 connector at each end. (AWG 28	ABF T20E200
/ 0.08 mm <sup>2</sup> ; length: 2 m / 6.56 ft)	
Ethernet Connection Cable	
SFTP Cat5 RJ45 Ethernet cable	490NTW000••

#### **Maximum Hardware Configuration**

Introduction

This section provides the maximum hardware configurations for each controller.

Maximum
Hardware
Configurations Compact
Controllers

The following table lists the maximum number of configuration items for each compact controller:

Controller Item	Compact controller			
TWD	LCAA10DRF LCDA10DRF	LCAA16DRF LCDA16DRF	LCAA24DRF LCDA24DRF	LCAA40DRF LCAE40DRF
Standard digital inputs	6	9	14	24
Standard digital outputs	4	7	10	16 (14 Relay + 2 Transistor outputs)
Max expansion I/O modules (Digital or analog)	0	0	4	7
Max digital inputs (controller I/O + exp I/O)	6	9	14+(4x32)=142	24+(7x32)=248
Max digital outputs (controller I/O + exp I/O)	4	7	10+(4x32)=138	16+(7x32)=240
Max digital I/O (controller I/O + exp I/O)	10	16	24+(4x32)=152	40+(7x32)=264
Max AS-Interface bus interface modules	0	0	2	2
Max I/O with AS-Interface modules (7 I/O per slave)	10	16	24+(2x62x7)=892	40+(2x62x7)=908
Max CANopen fieldbus master modules	0	0	1	1
Max T/R-PDOs with CANopen devices	0	0	16 TPDOs 16 RPDOs	16 TPDOs 16 RPDOs
Max relay outputs	4 base only	7 base only	10 base + 32 expansion	14 base + 96 expansion
Potentiometers	1	1	2	2
Built-in analog inputs	0	0	0	0
Max analog I/O (controller I/O + exp I/O)	0 in / 0 out	0 in / 0 out	8 in / 4 out	15 in / 7 out
Remote controllers	7	7	7	7

Controller Item	Compact controller			
TWD	LCAA10DRF LCDA10DRF	LCAA16DRF LCDA16DRF	LCAA24DRF LCDA24DRF	LCAA40DRF LCAE40DRF
Serial ports	1	2	2	2
Ethernet port	0	0	0	1 (TWDLCA-E40DRF only)
Cartridge slots	1	1	1	1
Largest application/backup size (KB)	8	16	32	64
Optional memory cartridge (KB)	32 <sup>1</sup>	32 <sup>1</sup>	32 <sup>1</sup>	32 or 64 <sup>2</sup>
Optional RTC cartridge	yes <sup>1</sup>	yes <sup>1</sup>	yes <sup>1</sup>	RTC onboard <sup>3</sup>
Optional Operator Display	yes	yes	yes	yes
Optional 2nd port	no	yes	yes	yes
Optional Ethernet interface module	yes	yes	yes	yes (TWDLC-AA40DRF) no (TWDLC-AE40DRF)

#### Note:

- 1. A Compact controller can have either a memory cartridge or an RTC cartridge.
- 2. Memory cartridge only, for RTC is already onboard.
- 3. Both TWDLCA40DRF and TWDLCAE40DRF compact controllers have a builtin RTC. Therefore, no RTC cartridge can be added on those controllers, but only a memory cartridge.

Maximum Hardware Configurations -Modular Controllers The following table lists the maximum number of configuration items for each modular controller:

Controller Item	Modular controller			
TWD	LMDA20DUK LMDA20DTK	LMDA20DRT	LMDA40DUK LMDA40DTK	
Standard digital inputs	12	12	24	
Standard digital outputs	8	8	16	
Max expansion I/O modules (Digital or analog)	4	7	7	
Max digital inputs (controller I/O + exp I/O)	12+(4x32)=140	12+(7x32)=236	24+(7x32)=248	
Max digital outputs (controller I/O + exp I/O)	8+(4x32)=136	8+(7x32)=232	16+(7x32)=240	
Max digital I/O (controller I/O + exp I/O)	20+(4x32)=148	20+(7x32)=244	40+(7x32)=264	
Max AS-Interface bus interface modules	2	2	2	
Max I/O with AS-Interface modules (7 I/O per slave)	20+(2x62x7)=888	20+(2x62x7)=888	40+(2x62x7)=908	
Max CANopen fieldbus interface modules	1	1	1	
Max T/R-PDOs with CANopen devices	16 TPDOs 16 RPDOs	16 TPDOs 16 RPDOs	16 TPDOs 16 RPDOs	
Max relay outputs	64 expansion only	6 base + 96 expansion	96 expansion only	
Potentiometers	1	1	1	
Built-in analog inputs	1	1	1	
Max analog I/O (controller I/O + exp I/O)	9 in / 4 out	15 in / 7 out	15 in / 7 out	
Remote controllers	7	7	7	
Serial ports	2	2	2	
Cartridge slots	2	2	2	
Largest application/backup size (KB)	32	64	64	
Optional memory cartridge (KB)	32	32 or 64	32 or 64	
Optional RTC cartridge	yes	yes	yes	
Optional Operator Display	yes <sup>2</sup>	yes <sup>2</sup>	yes <sup>2</sup>	
Optional Ethernet interface module	yes	yes	yes	

#### Note:

- 1. A Compact controller can have either a memory cartridge or an RTC cartridge.
- 2. A Modular controller can have either an Operator Display expansion module (with an optional communication adapter) or a communication expansion module.

#### Main Functions of the Controllers

#### Introduction

By default all I/O on the controllers are configured as digital I/O. However, certain I/O can be assigned to specific tasks during configuration such as:

- RUN/STOP input
- Latching inputs
- Fast counters:
  - Single up/down counters: 5 kHz (1-phase)
  - Very fast counters: Up/down counters 20 kHz (2-phase)
- Controller status output
- Pulse Width Modulation (PWM)
- Pulse (PLS) generator output

Twido controllers are programmed using TwidoSoft which enables the following functions to be used on:

- PWM
- PLS
- · Fast counters and very fast counters
- PID and PID Auto-Tuning

#### **Main Functions** The following table lists the main functions of the controllers:

Function	Description	
Scanning	Normal (cyclical) or periodic (constant) (2 to 150 ms)	
Execution time	0.14 μs to 0.9 μs for a list instruction	
Memory capacity	Data: 3000 memory words for all controllers, 128 memory bits for TWDLCAA10DRF and TWDLCAA16DRF, 256 memory bits for all other controllers.	
	Program: 10 I/O compact controller: 700 list instructions 16 I/O compact controller: 2000 list instructions 24 I/O compact, and 20 I/O modular controllers: 3000 list instructions 20 I/O modular and 40 I/O modular controllers, and 40 I/O compact controllers: 6000 list instructions (with a 64 Kb cartridge, otherwise 3000 list instructions)	
RAM backup	<ul> <li>All controllers: By lithium internal battery. Backup duration is approximately 30 days (typical) at 25°C (77°F) after battery is fully charged. The charging time is 15 hours for charging from 0 to 90% of full charge. Battery life is 10 years when charging for 9 hours and discharging for 15 hours. The battery cannot be replaced.</li> <li>40DRF compact controllers: By user-replaceable lithium external battery (in addition to internal battery onboard). Backup duration is approximately 3 years (typical) at 25°C (77°F) under normal operating condition of the controller (typically, no long-term powering off of the controller). BAT LED on front-panel provides indication of status for battery-power.</li> </ul>	
Programming port	All controllers: EIA RS-485     TWDLCAE40DRF compact controller: Built-in RJ45 Ethernet communications port	
Expansion I/O modules	10 and 16 I/O compact controllers: no expansion modules 24 I/O compact and 20 I/O modular controllers: up to 4 expansion I/O modules 40 I/O modular and 40 I/O compact controllers: up to 7 expansion I/O modules	

Function	Description			
AS-Interface V2 bus interface modules	10 and 16 I/O compact controllers: no AS-Interface bus interface module 24 I/O and 40 I/O compact, 20 I/O and 40 I/O modular controllers: up to 2 AS-Interface bus interface modules			
CANopen fieldbus interface modules		10 and 16 I/O compact controllers: no CANopen fieldbus interface module 24 I/O and 40 I/O compact, 20 I/O and 40 I/O modular controllers: 1 CANopen fieldbus interface module		
Remote link communication	Maximum 7 slaves by Maximum length of er	remote I/O or peer controllers. htire network: 200 m (650 feet).		
Modbus communication	Non-isolated EIA RS-ASCII or RTU mode.	485 type, maximum length limited to 200 m.		
Ethernet communication		mpact controller and 499TWD01100 Ethernet interface module: gotiated type Ethernet communications over TCP/IP protocol, via		
ASCII communication	Half-duplex protocol to	o a device.		
Dedicated function blocks	PWM/PLS	All modular and 40 I/O compact controllers: 2		
	Fast counters	TWDLCA•40DRF Compact controllers: 4 All other compact controllers: 3 All modular controllers: 2		
	Very fast counters	TWDLCA•40DRF compact controllers: 2 All other compact controllers: 1 All modular controllers: 2		
Analog potentiometers	24 I/O and 40 I/O compact controllers: 2 All other controllers: 1			
Built-in analog channel	Compact controllers: none Modular controllers: 1 input			
Programmable input filter	Input filter time can be changed during configuration No filtering or filtering at 3 ms or 12 ms I/O points are configured in groups			
Special I/O	Inputs	RUN/STOP: Any one of the base inputs		
		Latching: up to 4 inputs (%I0.2 to %I0.5)		
		Built-in analog input connected to %I0.0 according to frequency meter		
		Fast counters: 5 kHz maximum Very fast counters: 20 kHz maximum Frequency meter: 1 kHz to 20 kHz maximum		
	Outputs	Controller status output: 1 of 3 outputs (%Q0.1 to %Q0.3)		
		PLS: 7 kHz maximum		
		PWM: 7 kHz maximum		

#### Communication Overview

#### Introduction

Twido controllers have one, or an optional second, serial port that is used for real-time or system management services. The real-time services provide data distribution functions for exchanging data with I/O devices and messaging functions for communicating to external devices. System management services manage and configure the controller through TwidoSoft. Either serial port is used for any of these services but only serial port 1 is for communicating with TwidoSoft.

To provide these services, there are three protocols available on each controller:


- Remote Link
- Modbus
- ASCII

In addition, the TWDLCAE40DRF compact controller features a built-in RJ45 Ethernet communications port allowing to perform all real-time communications and system management tasks via the network. Ethernet communications implements the following protocol:

Modbus TCP/IP

## Communications Architecture

The following diagram shows a communication architecture with all three protocols.

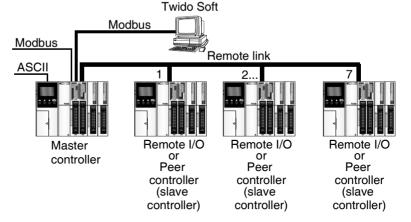

**Note:** Communication between the "Modbus" and "Remote Link" protocols cannot occur at the same time.

#### Remote Link Protocol

The Remote Link protocol is a high-speed master/slave bus designed to communicate a small amount of data between the Master controller and up to seven Remote Slave controllers. Application or I/O data is transferred, depending on the configuration of the Remote controller. A combination of Remote controller types is possible where some can be Remote I/O and some can be Peer controllers.

#### Modbus Protocol

The Modbus protocol is a master/slave protocol that allows for one master to request responses from slaves or to take action based on the request. The master can address individual slaves or can initiate a broadcast message to all slaves. Slaves return a message (response) to queries that are addressed to them individually. Responses are not returned to broadcast queries from the master.

**Modbus Master Mode** - The Modbus master mode allows the controller to initiate a Modbus query transmission, with a response expected from a Modbus slave. **Modbus slave mode** - Modbus slave mode enables the controller to respond to Modbus queries from a master. This is the default communications mode if no communication is configured.

## Modbus TCP/IP

**Note:** Modbus TCP/IP is solely supported by TWDLCAE40DRF compact controllers with built-in Ethernet network interface.

The following information describes the Modbus Application Protocol (MBAP). The Modbus Application Protocol (MBAP) is a layer-7 protocol providing peer-to-peer communication between programmable logic controllers (PLCs) and other nodes on a LAN.

The Twido controller TWDLCAE40DRF implements Modbus TCP/IP Client/Server communications over the Ethernet network. Modbus protocol transactions are typical request-response message pairs. A PLC can be both client and server depending on whether it is querying or answering messages. A Modbus TCP/IP Client is equivalent to a Modbus Master controller in legacy Modbus, while a Modbus TCP/IP Server would correspond to a legacy Modbus Slave controller.

#### **ASCII Protocol**

The ASCII protocol allows communication between the controller and a simple device such as a printer.

#### At a Glance

#### Introduction

This chapter provides wiring rules and recommendations, overviews, parts descriptions, specifications, and wiring schematics for the Twido products.

## What's in this Chapter?

This chapter contains the following sections:

Section	Topic	Page
2.1	Wiring Rules and Recommendations	31
2.2	Compact Controller	35
2.3	Modular Controller	59
2.4	Digital I/O Modules	79
2.5	Analog I/O Modules	106
2.6	AS-Interface V2 bus master module	125
2.7	CANopen fieldbus master module	145
2.8	Communication Options	158
2.9	Operator Display Options	163
2.10	Options	168
2.11	The ConneXium TwidoPort Ethernet Interface Module	171
2.12	Telefast <sup>®</sup> Pre-Wired Systems for Twido	179

#### 2.1 Wiring Rules and Recommendations

#### Wiring Rules and Recommendations

#### Introduction

There are several rules that must be followed when wiring a controller or module. Recommendations, when needed, are provided on how to comply with the rules.

## **A** DANGER

#### FLECTRIC SHOCK

- Be sure to remove ALL power from ALL devices before connecting or disconnecting inputs or outputs to any terminal or installing or removing any hardware.
- Be sure to connect the grounding wire to a proper ground.

Failure to follow this instruction will result in death, serious injury, or equipment damage.



#### **FAILURE OF OUTPUTS**

If outputs should fail, outputs may remain on or off. Where personnel and or equipment hazards exist, use appropriate safety interlocks.

Failure to follow this instruction can result in death, serious injury, or equipment damage.

#### Rules


- Each terminal accepts up to two 18 AWG (0.82 mm<sup>2</sup>) through 28 AWG (0.08 mm<sup>2</sup>) fitted with cable ends or tags.
- Output module fusing is the responsibility of the user. It is not within the Twido
  product itself. Select a fuse appropriate for the load with respect to the electrical
  codes.
- Depending on the load, a protection circuit may be needed for relay outputs on modules.
- The power supply wire should be between 18 AWG (0.82 mm²) and 22 AWG (0.33 mm²). Use the shortest wire length possible.
- The grounding wire should be 16 AWG (1.30 mm<sup>2</sup>).
- Power supply wires routed inside the panel must be kept separate from power wires, I/O wiring and communication wiring. Route wiring in separate cable ducting.
- Take care when wiring output modules that are designed to work as either source or sink. Incorrect wiring can cause equipment damage.
- Make sure that the operating conditions and environments are within the specification values.
- Use proper wire size to meet voltage and current requirements.

#### Terminal Tightening Torque

Recommended tightening torque of terminal blocks is listed for all products on the product label.


Contact Protection Circuit for Relay and Transistor Outputs Depending on the load, a protection circuit may be needed for the relay output on the controllers and certain modules. Choose a protection circuit, from the following diagrams, according to the power supply. Connect the protection circuit to the outside of the controller or relay output module.

Protective circuit A: this protection circuit can be used when the load impedance is smaller than the RC impedance in an AC load power circuit.




- C represents a value from 0.1 to 1 μF.
- R represents a resistor of approximately the same resistance value as the load.

Protective circuit B: this protection circuit can be used for both AC and DC load power circuits.



- C represents a value from 0.1 to 1 μF.
- R represents a resistor of approximately the same resistance value as the load.


Protective circuit C: this protection circuit can be used for DC load power circuits.



Use a diode with the following ratings:


- Reverse withstand voltage: power voltage of the load circuit x 10.
- Forward current: more than the load current.

Protective circuit D: this protection circuit can be used for both AC and DC load power circuits.



## Explanation of Source Inputs/ Sink Outputs


**Note:** Sink corresponds to the sensors' common on the (+) terminal of the power supply.

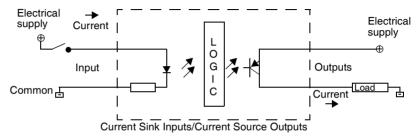

Input side COM field terminal connects to the "-" terminal or common of the field power supply. Output side COM field terminal connects to +24V field power supply.

## Explanation of Sink Inputs/ Source Outputs

**Note: Source** corresponds to the sensors' common on the (-) terminal of the power supply.

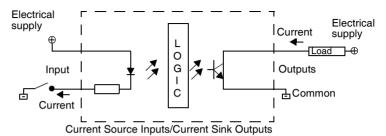

Input side COM field terminal connects to +24V field power supply. Output side COM field terminal connects to the "-" terminal or common of the field power supply.

## 2.2 Compact Controller

#### At a Glance

#### Introduction

This section provides an overview, parts description, specifications, and wiring schematics of the Compact controllers.

## What's in this Section?

This section contains the following topics:

Topic	Page
Overview of Compact Controllers	36
Description of Analog Potentiometers	39
Parts Description of a Compact Controller	40
General Specifications for the Compact Controllers	42
Functional Specifications for the Compact Controllers	46
I/O Specifications for the Compact Controller	48
Compact Controller Wiring Schematics	54

#### **Overview of Compact Controllers**

#### Introduction

The information in this section describes the main features of the Compact controllers.

#### Illustrations

The following illustrations are the Compact controllers:

Controller Type	Illustration
The Compact 10 I/O controller:  • has 6 digital inputs and 4 relay outputs  • has 1 analog potentiometer  • has 1 integrated serial port  • accepts one optional cartridge (RTC or memory - 32 KB only)  • accepts an optional operator display module  • accepts 1 ConneXium TwidoPort Ethernet interface module	TWDLCAA10DRF TWDLCDA10DRF
The Compact 16 I/O controller:  • has 9 digital inputs and 7 relay outputs  • has 1 analog potentiometer  • has 1 integrated serial port  • has a slot for an additional serial port  • accepts one optional cartridge (RTC or memory - 32 KB only)  • accepts an optional operator display module  • accepts 1 ConneXium TwidoPort Ethernet interface module	TWDLCAA16DRF TWDLCDA16DRF

#### Controller Type Illustration The Compact 24 I/O controller: TWDLCAA24DRF has 14 digital inputs and 10 relay TWDI CDA24DRF outputs • has 2 analog potentiometers has 1 integrated serial port has a slot for an additional serial port accepts up to 4 expansion I/O modules accepts up to 2 AS-Interface V2 bus interface modules • accepts 1 CANopen fieldbus interface module • accepts one optional cartridge (RTC or memory - 32 KB only) accepts an optional operator display module accepts 1 ConneXium TwidoPort

TWD USE 10AE 37

Ethernet interface module

#### Controller Type

The Compact 40 I/O controllers.

Features shared by both

TWDLCAA40DRF and TWDLCAE40DRF series are as follows:

- has 24 digital inputs, 14 relay and 2 transistor outputs
- has 2 analog potentiometers
- has 1 integrated serial port
- has a slot for an additional serial port
- has BTC onboard
- has battery compartment for userreplaceable external battery
- accepts up to 7 expansion I/O modules
- accepts up to 2 AS-Interface V2 bus interface modules
- accepts 1 CANopen fieldbus interface module
- accepts one optional memory cartridge (32 KB or 64 KB)
- accepts an optional operator display module


#### TWDLCAA40DRF-specific feature:

 accepts 1 ConneXium TwidoPort Ethernet interface module

#### TWDLCAE40DRF-specific feature:

has 1 built-in Ethernet interface RJ-45 port

#### Illustration



#### TWDI CAF40DRF



#### **Description of Analog Potentiometers**

#### Introduction

The following section describes the analog potentiometer on the Compact controllers.

#### Description


The TWDLC•A10DRF¹ and TWDLC•A16DRF¹ controllers have one analog potentiometer. The TWDLC•A24DRF¹ and TWDLCA•40DRF² controllers have two analog potentiometers. The first analog potentiometer can be set to a value between 0 and 1023. The second analog potentiometer can be set to a value between 0 and 511. The value is stored in a system word and is updated in every scan. For more information on setting the analog potentiometer, see the TwidoSoft Software Reference Manual.

#### Note:

- 1. = D as in 24 VDC power supply
  - = A as in 110/240 VAC power supply
- 2. = A as in standard model (no Ethernet port)
  - = F as in built-in Ethernet communications interface

# Analog Potentiometer on a Compact Controller

The following figure shows the analog potentiometers on a TWDLC•A24DRF Compact controller.



#### Legend

Label	Description
1	Analog potentiometer 1
2	Analog potentiometer 2


#### **Parts Description of a Compact Controller**

#### Introduction

The following section describes the parts of a Compact controller. Your controller may differ from the illustrations but the parts will be the same.

# Parts Description of a Compact Controller

The following figure shows the parts of a Compact controller. This figure is the TWDL CAA24DRF controller.

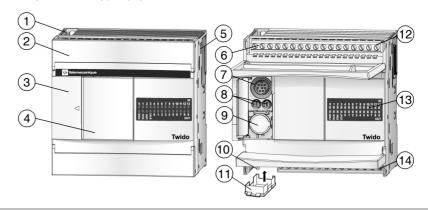


#### Legend

Label	Description
1	Mounting hole
2	Terminal cover
3	Hinged lid
4	Removable cover to operator display connector
5	Expansion connector - On both 24DRF and 40DRF series compact bases
6	Sensor power terminals
7	Serial port 1
8	Analog potentiometers - TWDLCAA10DRF and TWDLCAA16DRF have one
9	Serial port 2 connector - TWDLCAA10DRF does not have one
10	100-240 VAC power supply terminals on TWDLCA•••DRF series 24 VDC power supply terminals on TWDLCD•••DRF series
11	Cartridge connector - located on the bottom of the controller
12	Input terminals
13	LEDs
14	Output terminals

#### Rear Panel of a 40DRF Compact Controller

The following figure shows the rear panel of a 40 I/O Compact controller. This figure is the TWDLCAE40DRF controller.

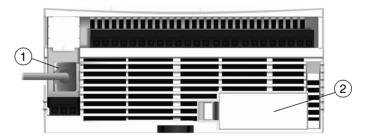

#### Legend

Label	Description
1	RJ-45 100Base-TX Ethernet port (only TWDLCAE40DRF has one)
2	External user-replaceable battery compartment (both TWDLCAA40DRF and TWDLCAE40DRF have one)

#### **General Specifications for the Compact Controllers**

#### Introduction

This section provides general specifications for the Compact controllers.

#### Normal Operating Specifications

Compact controller TWDLC	AA10DRF DA10DRF	AA16DRF DA16DRF	AA24DRF DA24DRF	AA40DRF AE40DRF
Ambient operating temperature	0 to 55°C (32°F to 131°F)  0 to 55°C (32°F to 131°F) at 75% load 0 to 45°C (32°F to 113°F) at full load			
Storage temperature	-25°C to +70	)°C (-13°F to	158°F)	
Relative humidity	Level RH1, 3	30 to 95% (no	n-condensing	)
Degree of pollution	2 (IEC60664	<b>!</b> )		
Degree of protection	IP20			
Corrosion immunity	Free from co	rrosive gases	3	
Altitude	Operation: 0 to 2,000 m (0 to 6,560 ft) Transport: 0 to 3,000 m (0 to 9,840 ft)			
Resistance to vibration	When mounted on a DIN rail:  10 to 57 Hz amplitude 0.075 mm, 57 to 150 Hz acceleration 9.8 ms² (1G), 2 hours per axis on each of three mutually perpendicular axes.  When mounted on a panel surface: 2 to 25 Hz amplitude 1.6 mm, 25 to 100 Hz acceleration 39.2 ms² (4G) Lloyd's 90 min per axis on each of three mutually perpendicular axes.			
Impact strength	147 ms <sup>2</sup> (15G), 11 ms duration, 3 shocks per axis, on three mutually perpendicular axes (IEC 61131)			
Weight	230 g 250 g 305 g 522 g (8.11 oz) (8.81 oz) (10.75 oz) (18.4 oz)			

## Specifications for the Backup Internal Battery

All compact base controllers have one non-removable internal battery

Compact backed up elements	Internal RAM: internal variables, internal bits and words, timers, counters, shift registers, etc.
Time	Approximately 30 days at 25°C (77°F) after battery fully charged.
Battery type	Non-interchangeable lithium accumulator
Charging time	Approximately 15 hours for 0% to 90 % of total load
Service life	10 years

## Specifications for the Backup External Battery

Only TWDLCAA40DRF and TWDLCAE40DRF series compact controllers have one external battery compartment.

Compact backed up elements	Internal RAM: internal variables, internal bits and words, timers, counters, shift registers, etc.
Time	<ul> <li>Approximately 3 years at 25°C (77°F) under following conditions:</li> <li>Internal backup battery is fully charged.</li> <li>The Twido compact base is constantly powered. It has had no (or minor) down-time.</li> </ul>
Battery type	<sup>1</sup> / <sub>2</sub> AA, 3.6V, lithium battery Part number TSXPLP01 (Tadiran, TL-5902) Note that the external battery must be purchased separately by user. No external battery is included with the Twido controller's package.

#### TWDLCA•40DRF Agency Compliance



#### **EMISSION WARNING (5.1.2/CISPR11)**

Class A equipment is intended for use in industrial environment. There may be potential difficulties in ensuring electromagnetic compatibility in other environments, due to conducted as well as radiated disturbances.

Failure to follow this instruction can result in death or serious injury.

## Electrical Specifications

Compact controller TWDLC	AA10DRF	AA16DRF	AA24DRF	AA40DRF AE40DRF	
Rated power voltage	100 to 240 VAC				
Allowable voltage range	85 to 264 VAC				
Rated power frequency	50/60 Hz (47 to	63 Hz)			
Maximum input current	0.25 A (85				
Maximum power consumption	30 VA (264 VAC), 20 VA VAC), 22 VA (100 VAC) (100 VAC) (100 VAC) (100 VAC) This Controller's controller's power consumption includes 250 mA sensor power.  31 VA (264 VAC), 22 VA VAC), 33 VA VAC), 65 VA (100 VAC) (100 VAC) This controller plus 4 I/O modules' power consumption includes 250 mA sensor power.  31 VA (264 VAC), 23 VA VAC), 65 VA (100 VAC) This controller plus 7 I/O modules' power consumption includes 250 modules 250 mA sensor power.				
Allowable momentary power interruption	10 ms, 100% drop out (at the rated inputs and outputs) (IEC61131 and IEC61000-4-11)				
Dielectric strength	Between power and ground terminals: 1,500 VAC, 1 min Between I/O and ground terminals: 1,500 VAC, 1 min				
Insulation resistance	Between power and ground terminals: 10 M $\Omega$ minimum (500 VDC) Between I/O and ground terminals: 10 M $\Omega$ minimum (500 VDC)				
Noise resistance	AC power terminals: 2kV, Level 3 I/O terminals: - DC: 1kV, Level 3 - AC: 2kV, Level 4 According to IEC61131-2 (Zone B) and IEC61000-4-4				
Inrush current	35 A 35 A 40 A 35 A maximum maximum maximum maximum				
Ground wiring	UL1007 16 AWG (1.30 mm <sup>2</sup> )				
Power supply wiring	UL1015 22 AWG (0.33 mm <sup>2</sup> ), UL1007 18 AWG (0.82 mm <sup>2</sup> )				
Effect of improper power supply connection	Reverse polarity: normal operation Improper voltage or frequency: internal fuse protection				

Compact controller TWDLC	DA10DRF	DA16DRF	DA24DRF			
Rated power voltage	24 VDC	24 VDC				
Allowable voltage range	from 19.2 to 30 VDC	(including ripple)				
Maximum input power	Controller	Controller	Controller plus 4 I/O Modules			
	3.9 W (@ 24 VDC)	4.6 W (@ 24 VDC)	5.6 W (@ 24 VDC)			
Allowable momentary power interruption	10 ms, 100% drop o (IEC61000-4-11)	ut (at the rated inputs	and outputs)			
Dielectric strength	Between power and ground terminals: 500 VAC, 1 min Between I/O and ground terminals: 1500 VAC, 1 min					
Insulation resistance	Between power and ground terminals: 10 M $\Omega$ minimum (500 VDC) Between I/O and ground terminals: 10 M $\Omega$ minimum (500 VDC)					
Noise resistance	AC power terminals: 2kV, Level 3 I/O terminals: - DC: 1kV, Level 3 - AC: 2kV, Level 4 According to IEC61131-2 (Zone B) and IEC61000-4-4					
Inrush current	35 A maximum					
Ground wiring	UL1015 22 AWG (0.33 mm <sup>2</sup> ), UL1007 18 AWG (0.82 mm <sup>2</sup> )					
Power supply wiring	UL1015 22 AWG (0.33 mm <sup>2</sup> ), UL1007 18 AWG (0.82 mm <sup>2</sup> )					
Effect of improper power supply connection	Reverse polarity: no operation, no damage Improper voltage or frequency: internal fuse protection					

#### **Functional Specifications for the Compact Controllers**

**Introduction** This section provides functional specifications for the Compact controllers.

#### Communication Function Specifications

Communication Port	Port 1 (RS485)	Port 2 (RS232C) Communication Adapter: TWDNAC232D	Port 2 (RS485) Communication Adapters: TWDNAC485D TWDNAC485T	Ethernet Port (RJ45) (TWDLCAE40DRF controller only)
Standards	RS485	RS232	RS485	100Base-TX, RJ45
Maximum baud rate	PC Link: 19,200 bps Remote Link: 38,400 bps	19,200 bps	PC Link: 19,200 bps Remote Link: 38,400 bps	100 Mbps, depending on network speed.
Modbus communication (RTU master/ slave)	Possible	Possible	Possible	TCP/IP Modbus Client/ Server
ASCII communication	Possible	Possible	Possible	-
Remote communication	7 links possible	Not possible	7 links possible	up to 16 remote nodes configured per controller
Maximum cable length	Maximum distance between the base controller and the remote controller: 200 m (656 ft)	Maximum distance between the base controller and the remote controller: 10 m (32.8 ft)	Maximum distance between the base controller and the remote controller: 200 m (656 ft)	Maximum distance between network nodes (depending on network architecture)
Isolation between internal circuit and communication port	Not isolated	Not isolated	Not isolated	Isolated
Telephone communication	Possible Possible to connect from a receive only modem.	Not possible	Not possible	Not possible

#### **Built-in Function Specifications**

Sensor power supply	Output voltage/current	24 VDC (+10% to -15%), 250 mA max. current (For TWDLCA•40DRF, 400 mA max. current)		
	Overload detection	Short-circuit protection for TWDLCA•40DRF. Not available on all other controllers.		
	Isolation	Isolated from the internal circuit		
Counting	Number of channels	4		
	Frequency	For TWDLCA•40DRF: - 4 channels at 5kHz (FCi), - 2 channels at 20kHz (VFCi)  For all other controllers: - 3 channels at 5kHz (FCi), - 1 channel at 20kHz (VFCi)		
	Capacity 16 bits (065535 steps) 32 bits (04294967295			
Analog potentiometers	1 adjustable from 0 through to 1023 steps			
	1 adjustable from 0 through to 511 steps			

FCi: Fast Counter "i".

VFCi: Very Fast Counter "i".

#### I/O Specifications for the Compact Controller

#### Introduction

This section provides I/O specifications for the Compact controllers.

## DC Input Specifications



## HAZARDS OF UNINTENDED EQUIPMENT OPERATION & EQUIPMENT DAMAGE

If any input exceeding the rated value is applied, permanent damage may be caused.


Failure to follow this instruction can result in death, serious injury, or equipment damage.


Compact controller	TWDLCAA10DRF TWDLCDA10DRF	TWDLCAA16DRF TWDLCDA16DRF	TWDLCAA24DRF TWDLCDA24DRF	TWDLCAA40DRF TWDLCAE40DRF
Input points	6 points in 1 common line	9 points in 1 common line	14 points in 1 common line	24 points in 2 common lines
Rated input voltage	24 VDC sink/source	input signal		
Input voltage range	from 20.4 to 28.8 VI	DC		
Rated input current	I0 and I1: 11 mA I2 to I13: 7 mA/poin	I0 and I1: 11 mA I2 to I13: 7 mA/point (24 VDC)		
Input impedance	I0 and I1: 2.1 k $\Omega$ I2 to I13: 3.4 k $\Omega$	10 0.10 111 211 122		
Turn on time	I0 to I1: 35 μs + filter value I2 to I13: 40 μs + filter value			I0, I1, I6, I7: 35 μs + filter value I2 to I5, I8 to I23: 40 μs + filter value
Turn off time	I0 and I1: 45 μs + filter value I2 to I13: 150 μs + filter value			I0, I1, I6, I7: 45 μs + filter value I2 to I5, I8 to I23: 150 μs + filter value
Isolation	Between input terminals and internal circuit: photocoupler isolated (isolation protection up to 500 V)  Between input terminals: not isolated			
Input type	Type 1 (IEC 61131)			

Compact controller	TWDLCAA10DRF TWDLCDA10DRF	TWDLCAA16DRF TWDLCDA16DRF		TWDLCAA40DRF TWDLCAE40DRF
External load for I/O interconnection	Not needed			
Signal determination method	Static			
Input signals type	The input signals can be both sink and source.			
Cable length	3m (9.84 ft) for compliance with electromagnetic immunity.			

## Input Operating Range

The input operating range of the Type 1 (IEC 61131-2) input module is shown below.






## Input Internal Circuit


The input internal circuit is shown below.

### Latching or High Speed Sink or Source Inputs

#### Standard Sink or Source Input


Inputs I0 and I1 <- (10, 16 and 24 I/O controllers) -> Inputs I0, I1, I6, I7
Inputs I0, I1, I6, I7 <- (40 I/O controllers) -> Inputs I2 to I5, I8 to I23





#### I/O Usage Limits

When using TWDLC•AA16DRF, TWDLC•A24DRF and TWDLCA•40DRF at an ambient temperature of 55°C (131°F) in the normal mounting direction, limit the inputs and outputs, respectively, which turn on simultaneously along line (1).



Also, when using the above-mentionned controllers at 45°C (113°F), all I/O can be turned on simultaneously at input voltage 28.8 VDC as indicated with line (2). When using the TWDDMM8DRT controller, all inputs and outputs can be turned on simultaneously at 55°C (131°F), input voltage 28.8 VDC.

For other possible mounting directions, see *Controller, Expansion I/O Module, AS-Interface Bus Master Module and CANopen Fieldbus Master Module Mounting Positions. p. 207.* 

#### Relay Output Specifications


Compact controller	TWDLCAA10DRF TWDLCDA10DRF	TWDLCAA16DRF TWDLCDA16DRF	TWDLCAA24DRF TWDLCDA24DRF	TWDLCAA40DRF TWDLCDAE40DRF
Output points	4 output	7 output	10 output	14 output
Output points per common line: COM0	3 NO contacts	4 Normally Open	4 NO contacts	_
Output points per common line: COM1	1 NO contact	2 NO contacts	4 NO contacts	_
Output points per common line: COM2	_	1 NO contact	1 NO contact	4 NO contact
Output points per common line: COM3	_	_	1 NO contact	4 NO contact
Output points per common line: COM4	_	_	_	4 NO contact
Output points per common line: COM5	_	_	_	1 NO contact
Output points per common line: COM6	_	_	_	1 NO contact
Maximum load current	2 A per output 8 A per common lin	e		
Minimum switching load	0.1 mA/0.1 VDC (re	ference value)		
Initial contact resistance	30 mΩ maximum: @ 240VAC/2A load (TWDLCA• controllers) @ 30VDC/2A load (TWDLCD• controllers)			
Electrical life	100,000 operations minimum (rated resistive load 1,800 operations/h)			
Mechanical life	20,000,000 operations minimum (no load 18,000 operations/h)			
Rated load (resistive/inductive)	240 VAC/2 A, 30 VDC/2 A			
Dielectric strength	Between output to internal circuit: 1500 VAC, 1 min Between output groups: 1500 VAC, 1 min			

# Transistor Source Output Specifications

Compact controller	TWDLCAA40DRF and TWDLCAE40DRF
Output type	Source output
Number of digital output points	2
Output points per common Line	1
Rated load voltage	24 VDC
Maximum load current	1 A per common line
Operating load voltage range	from 20.4 to 28.8 VDC
Voltage drop (on voltage)	1 V maximum (voltage between COM and output terminals when output is on)
Rated load current	1 A per output
Inrush current	2.5 A maximum
Leakage current	0.25 mA maximum
Maximum lamp load	19 W
Inductive load	L/R = 10 ms (28.8 VDC, 1 Hz)
External current draw	12 mA maximum, 24 VDC (power voltage at the +V terminal)
Isolation	Between output terminal and internal circuit: photocoupler isolated (isolation protection up to 500 VDC) Between output terminals: 500 VDC
Output delay - turn on/off time	Q0, Q1: 5 $\mu s$ maximum ( $I \ge 5 mA$ )


#### **Output delay**

The output delay is shown below.

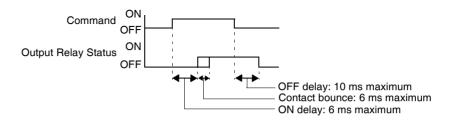


#### Relay Output Contact

The relay output contact is shown below.



#### Transistor Source Output Contact

The transistor source output contact applicable to TWDLCA•40DRF series compact controllers is shown below.



#### **Compact Controller Wiring Schematics**

#### Introduction

This section shows examples of wiring schematics for Compact controllers.

### **A** DANGER

#### HAZARD OF ELECTRIC SHOCK

- Be sure to remove ALL power from ALL devices before connecting or disconnecting inputs or outputs to any terminal or installing or removing any hardware.
- Be sure to connect the grounding wire to a proper ground.


Failure to follow this instruction will result in death, serious injury, or equipment damage.

Note: These schematics are for external wiring only.

**Note:** The shaded boxes are markings on the controller. The I and Q numbers are the input and output points.


## AC Power Supply Wiring Schematic

The following AC power supply wiring schematic is for the TWDLCA•••DRF series controllers.




#### DC Power Supply Wiring Schematic

The following DC power supply wiring schematic is for the TWDLCDA••DRF series controllers. (Note that TWDLCA•40DRF series controllers have AC power supply only.)




#### DC Source Input Wiring Schematic

The following schematic is for the TWDLC•A10DRF, TWDLC•A16DRF, and TWDLC•A24DRF controllers.

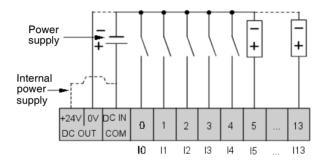


The following DC source input wiring schematic is for the TWDLCA•40DRF series controllers.




#### DC Sink Input Wiring Schematic


This schematic is for the TWDLC•A10DRF, TWDLC•A16DRF, and TWDLC•A24DRF controllers.

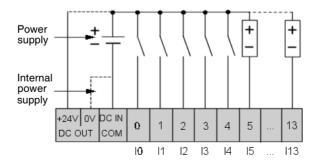


The following DC sink input wiring schematic is for the TWDLCA•40DRF series controllers.




Relay and Transistor Output Wiring Schematic This schematic is for the TWDLC•A10DRF series controllers.




This schematic is for the TWDLC•A16DRF series controllers.

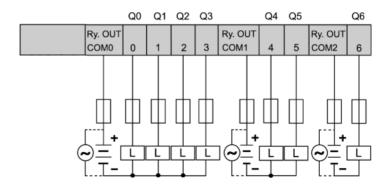

This schematic is for the TWDLC•A24DRF series controllers.

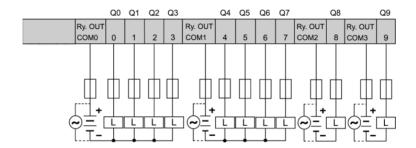

This schematic is for the TWDLCA•40DRF series controllers.

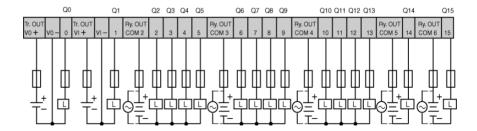

#### Reverse-Polarity at Transistor Output is Not Allowed

The TWDLCA•40DRF compact bases transistor outputs cannot withstand any reverse polarity.

#### **▲** CAUTION

#### RISK OF REVERSE-POLARITY DAMAGE AT TRANSISTOR OUTPUTS

- Make sure to conform to the polarity markings on the transistor output terminals.
- Use of a reverse polarity can permanently damage or destroy the output circuits.

Failure to follow this instruction can result in injury or equipment damage.

#### 2.3 Modular Controller

#### At a Glance

#### Introduction

This section provides an overview, parts description, specifications, and wiring schematics of the Modular controllers.

## What's in this Section?

This section contains the following topics:

Торіс	Page
Overview of Modular Controllers	60
Description of Analog Potentiometers	62
Overview of Analog Voltage Input	63
Parts Description of a Modular Controller	64
General Specifications for the Modular Controllers	65
Functional Specifications for the Modular Controllers	67
I/O Specifications for the Modular Controllers	69
Modular Controller Wiring Schematics	75

#### **Overview of Modular Controllers**

**Introduction** The following section provides an overview of the Modular controllers.

**Illustrations** The following illustrations are the Modular controllers.

Controller Type	Illustration
The Modular 20 I/O controllers:  are available in two models: with transistor source outputs (TWDLMDA20DTK) or with transistor sink outputs (TWDLMDA20DUK)  have 12 digital inputs and 8 transistor source or sink outputs  have 1 analog voltage input connector  have 1 analog potentiometer  have 1 integrated serial port  have a connector for wiring  accept up to 4 expansion I/O modules  accept up to 2 AS-Interface V2 bus interface modules  accept 1 CANopen fieldbus interface module  accept both optional cartridges (RTC and memory - 32 KB or 64 KB)  accept either an optional operator display expansion module or an optional communication expansion module  accept 1 ConneXium TwidoPort Ethernet interface module	TWDLMDA20DTK TWDLMDA20DUK
The Modular 20 I/O controller:  • has 12 digital inputs, 6 relay outputs, and 2 transistor source outputs  • has 1 analog voltage input connector  • has 1 analog potentiometer  • has 1 integrated serial port  • has a terminal block for wiring  • accepts up to 7 expansion I/O modules  • accepts up to 2 AS-Interface V2 bus interface modules  • accepts 1 CANopen fieldbus interface module  • accepts both optional cartridges (RTC and memory - 32 KB or 64 KB)  • accepts either an optional operator display expansion module or an optional communication expansion module  • accept 1 ConneXium TwidoPort Ethernet interface module	TWDLMDA20DRT


#### Controller Type

The Modular 40 I/O controller:

- is available in two models: with transistor source outputs (TWDLMDA40DTK) or with transistor sink outputs (TWDLMDA40DUK)
- has 24 digital inputs and 16 transistor source or sink outputs
- has 1 analog voltage input connector
- has 1 analog potentiometer
- has 1 integrated serial port
- has a connector for wiring
- accepts up to 7 expansion I/O modules
- accepts up to 2 AS-Interface V2 bus interface modules
- accept 1 CANopen fieldbus interface module
- accepts both optional cartridges (RTC and memory 32 KB or 64 KB)
- accepts either an optional operator display expansion module or an optional communication expansion module
- accept 1 ConneXium TwidoPort Ethernet interface module

#### Illustration

#### TWDLMDA40DTK TWDLMDA40DUK





#### **Description of Analog Potentiometers**

#### Introduction

The following section describes the analog potentiometer on the Modular controllers.

#### Description

The TWDLMDA20DUK, TWDLMADA20DTK, TWDLMDA20DRT, TWDLMDA40DUK, and TWDLMADA40DTK controllers have one analog potentiometer. The analog potentiometer can be set to a value between 0 and 1024. The value is stored in a system words and is updated in every scan. For more information on setting the analog potentiometer, see the TwidoSoft Software Reference Manual.

# Analog Potentiometer on a Compact Controller

The following figure shows the analog potentiometer on a Modular controller, the TWDLMDA40DUK.



#### Legend

Label	Description
1	Analog potentiometer 1

#### **Overview of Analog Voltage Input**

#### Introduction

The following section describes the analog voltage input on the Modular controllers.

#### **Description**

All Modular controllers have one analog voltage input. The analog voltage input connects an analog voltage source of 0 through 10 VDC. The analog voltage is converted to a value of 0 through 512 and is stored in a system word.


#### **Parts Description of a Modular Controller**

#### Introduction

The following section describes the parts of a Modular controller. Your controller may differ from the illustrations but the parts will be the same.

Parts
Description of a
Modular
Controller

The following figure shows the parts of a Modular controller. This figure is the Modular 40 I/O controller.

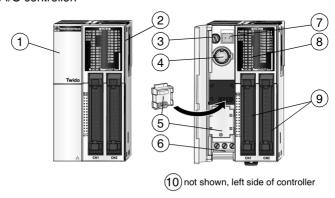

#### Legend

Label	Description
1	Hinged lid
2	Expansion connector
3	Analog potentiometer
4	Serial port 1
5	Cartridge covers
6	24 VDC power supply terminals
7	Analog voltage input connector
8	LEDs
9	I/O terminals
10	Communication connector

#### **General Specifications for the Modular Controllers**

#### Introduction

This section provides general specifications for the Modular controllers.

#### Normal Operating Specifications

Modular controller	TWDLMDA20DTK TWDLMDA20DUK	TWDLMDA20DRT	TWDLMDA40DTK TWDLMDA40DUK		
Operating temperature	0 to 55°C (32°F to 1	0 to 55°C (32°F to 131°F) operating ambient temperature			
Storage temperature	-25°C to +70°C (-13	°F to 158°F)			
Relative humidity	from 30 to 95% Rh (	non-condensing)			
Pollution degree	2 (IEC60664)				
Degree of protection	IP20				
Corrosion immunity	Free from corrosive	Free from corrosive gases			
Altitude	Operation: from 0 to 2000 m (0 to 6,560 ft) Transport: 0 to 3,000 m (0 to 9,840 ft)				
Resistance to Vibration	When mounted on a DIN rail: from 10 to 57 Hz amplitude 0.075 mm, from 57 to 150 Hz acceleration 9.8 ms² (1G), 2 hours per axis on each of three mutually perpendicular axes. When mounted on a panel surface: from 2 to 25 Hz amplitude 1.6 mm, from 25 to 100 Hz acceleration 39.2 ms² (4G) Lloyd's 90 min per axis on each of three mutually perpendicular axes.				
Impact strength	147 ms <sup>2</sup> (15G), 11 ms duration, 3 shocks per axis, on three mutually perpendicular axes (IEC 61131).				
Weight	140 g (4.93 oz) 185 g 180 g (6.35 oz) (6.35 oz)				

# Specifications for the Backup Battery

Modular backed up elements	Internal RAM: internal variables, internal bits and words, timers, counters, shift registers, etc.	
Time	Approximately 30 days at 25°C (77°F) after battery fully charged.	
Battery type	Non-interchangeable lithium accumulator	
Charging time	Approximately 15 hours for 0% to 90 % of total load	
Service life	10 years	

## Electrical Specifications

Modular controller	TWDLMDA20DTK TWDLMDA20DUK	TWDLMDA20DRT	TWDLMDA40DTK TWDLMDA40DUK	
Rated power voltage	24 VDC			
Allowable voltage range	from 20.4 to 26.4 VD	C (including ripple)		
Maximum input power	Controller plus 4 I/O Controller plus 7 I/O Modules Modules		Modules	
	15 W (26.4 VDC)	19 W (26.4 VDC)	19 W (26.4 VDC)	
Allowable momentary power interruption	10 ms, 100% drop out (at the rated inputs and outputs) (IEC61131 and IEC61000-4-11)			
Dielectric strength	Between power and ground terminals: 500 VAC, 1 min Between I/O and ground terminals: 1500 VAC, 1 min			
Insulation resistance	Between power and ground terminals: 10 M $\Omega$ minimum (500 VDC) Between I/O and ground terminals: 10 M $\Omega$ minimum (500 VDC)			
Noise resistance	AC power terminals: 2kV, Level 3 I/O terminals: DC: 1kV, Level 3 AC: 2kV, Level 4 According to IEC61131-2 (Zone B) and IEC61000-4-4			
Inrush current	50 A maximum (24 VDC)			
Ground wiring	UL1015 22 AWG (0.33 mm <sup>2</sup> ), UL1007 18 AWG (0.82 mm <sup>2</sup> )			
Power supply wiring	UL1015 22 AWG (0.33 mm <sup>2</sup> ), UL1007 18 AWG (0.82 mm <sup>2</sup> )			
Effect of improper power supply connection	Reverse polarity: no operation, no damage Improper voltage or frequency: internal fuse protection			

#### **Functional Specifications for the Modular Controllers**

#### Introduction

This section provides functional specifications for the Modular controllers.

# Communication Function Specifications

Communication Port	Port 1 (RS485)	Port 2 (RS232C) Communication Expansion Module (TWDNOZ232D) or Operator Display Expansion Module (TWDXCPODM) with Communication Adapter (TWDNAC232D)	Port 2 (RS485) Communication Expansion Modules (TWDNOZ485D) or (TWDNOZ485T) or Operator Display Expansion Module (TWDXCPODM) with Communication Adapter (TWDNAC485D) or (TWDNAC485T)
Standards	RS485	RS232	RS485
Maximum baud rate	PC Link: 19,200 bps Remote Link: 38,400 bps	19,200 bps	PC Link: 19,200 bps Remote Link: 38,400 bps
Modbus communication (RTU master/slave)	Possible	Possible	Possible
ASCII communication	Possible	Possible	Possible
Remote communication	7 links possible	Not possible	7 links possible
Maximum cable length	Maximum distance between the base controller and the remote controller: 200 m (656 ft)	Maximum distance between the base controller and the remote controller: 200 m (656 ft)	Maximum distance between the base controller and the remote controller: 200 m (656 ft)
Isolation between internal circuit and communication port	Not isolated	Not isolated	Not isolated
Telephone communication	Possible Possible to connect from a receive only modem.	Not possible	Not possible

## **Built-in Function Specifications**

Analog voltage input	Number of channels	1	
	Input voltage range	from 0 to 10 VDC	
	Input impedance	100 kΩ	
	Resolution	9 bits (0 to 511 pulses)	
	Input error	+/- 5%	
	Sample duration time	5 ms	
	Sample repeat time	5 ms	
	Total input transfer time	5 ms + 1 cycle time	
Movement	Number of channels	2	
	Frequency	7 kHz	
	Functions	PWM - Pulse Width Modulation	
		output	
		PLS - Pulse generator output	
Counting	Number of channels	4	
	Frequency	2 channels at 5kHz (FCi),	
		2 channels at 20kHz (VFCi)	
	Capacity	16 bits (065535 steps)	
Analog potentiometers	1 adjustable from 0 through to 1023 steps		
FCi = Fast Counter "i			
VFCi = Very Fast Counter "i"			

#### I/O Specifications for the Modular Controllers

#### Introduction

This section provides I/O specifications for the Modular controllers.

## DC Input Specifications



#### HAZARDS OF UNINTENDED EQUIPMENT OPERATION & EQUIPMENT DAMAGE

If any input exceeding the rated value is applied, permanent damage may be caused.


Failure to follow this instruction can result in death, serious injury, or equipment damage.


Modular controller	TWDLMDA20DUK TWDLMDA20DTK	TWDLMDA20DRT	TWDLMDA40DUK TWDLMDA40DTK
Input points	12 points in 1 common line	12 points in 1 common line	24 points in 1 common line
Rated input voltage	24 VDC source/sink	input signal	
Input voltage range	from 20.4 to 26.4 VD	С	
Rated input current	10, 11, 16, 17: 5 mA/inp 12 to 15, 18 to 123: 7 m	,	
Input impedance	I0, I1, I6, I7: 5.7 kΩ I2 to I5, I8 to I23: 3.4 kΩ		
Turn on time (ON Time)	I0 to I7: 35 μs + filter value I8 to I23: 40 μs + filter value		
Turn off time (OFF Time)	I0, I1, I6, I7: 45 μs + filter value I2 to I5, I8 to I23: 150 μs + filter value		
Isolation	Between input terminals and internal circuit: photocoupler isolated (isolation protection up to 500 V) Between input terminals: not isolated		
Filtering (3 possibilities: none, 3 ms or 12 ms.)	I0 to I11 I0 to I11 I0 to I7		
Input type	Type 1 (IEC 61131)		
External load for I/O interconnection	Not needed		
Signal determination method	Static		
Input signals type	The input signals can be both sink and source.		

Modular controller	TWDLMDA20DUK TWDLMDA20DTK	TWDLMDA20DRT	TWDLMDA40DUK TWDLMDA40DTK			
Cable length	3m (9.84 ft) for compliance with electromagnetic immunity					
Connector insertion/ removal durability	100 times minimum					

## Input Operating Range

The input operating range of the Type 1 (IEC 61131-2) input module is shown below.






## Input Internal Circuit


The input internal circuit is shown below.

#### Latching or High Speed Sink or Source Inputs




### Standard Sink Or Source Input

Inputs I2 to I5, I8 to I23



#### I/O Usage Limits

When using TWDLMDA20DUK and TWDLMDA20DTK at an ambient temperature of 55°C (131°F) in the normal mounting direction, limit the inputs and outputs, respectively, which turn on simultaneously along line (1).



When using TWDLMDA40DUK and TWDLMDA40DTK limit the inputs and outputs, respectively, which turn on simultaneously along line (2).

At  $40^{\circ}$ C ( $104^{\circ}$ F), all inputs and outputs can be turned on simultaneously at 26.4 VDC as indicated with line (3).

When using the TWDLMDA20DRT controller, all inputs and outputs can be turned on simultaneously at 55°C (131°F), input voltage 26.4 VDC.

#### Transistor Sink and Source Output Specifications

Modular controller TWDLMDA	20DUK	40DUK	20DRT	20DTK	40DTK		
Output type	Sink output	Sink output	Source output	Source output	Source output		
Output points per common Line	8	2	2	8	16		
Rated load voltage	24 VDC						
Maximum load current	1 A per common line						
Operating load voltage range	from 20.4 to 28.8 VDC						
Voltage drop (on voltage)	1 V maximum (voltage between COM and output terminals when output is on)						
Rated load current	0.3 A per output						
Inrush current	1 A maximum						
Leakage current	0.1 mA maximum						
Clamping voltage	39 V +/-1 V						
Maximum lamp load	8 W						
Inductive load	L/R = 10 ms (28.8 VDC, 1 Hz)						
External current draw	100 mA maxim (power voltage terminal)	,	•				
Isolation	Between output terminal and internal circuit: photocoupler isolated (isolation protection up to 500 V)  Between output terminals: not isolated						
Average number of connector insertions/removals	100 times minimum						
Output delay - turn on time	Q0, Q1: 5 μs maximum Q2 to Q15: 300 μs maximum						
Output delay - turn off time	Q0, Q1: 5 μs maximum Q2 to Q15: 300 μs maximum						

### Relay Output Specifications


Modular controller	TWDLMDA20DRT
Number of outputs	8 digital inputs consisting of 6 relay outputs and 2
	transistor source outputs
Output points per common line - COM0	2 outputs
Output points per common line - COM1	3 NO contacts
Output points per common line - COM2	2 NO contacts
Output points per common line - COM3	1 NO contact
Maximum load current	2 A per output
	8 A per common line
Minimum switching load	0.1 mA/0.1 VDC (reference value)
Initial contact resistance	30 m $Ω$ maximum
Mechanical life	20,000,000 operations minimum (no load 18,000
	operations/h)
Dielectric strength	Between output to internal circuit: 1500 VAC,
	1 min
	Between output groups: 1500 VAC, 1 min
Connector insertion/removal durability	100 times minimum

Usage category	Rated load	Electrical life (number of operations)
AC1 Resistive load command	500 VA(*)	10 <sup>5</sup>
AC14 Weak solenoid load	250 VA	10 <sup>5</sup>
AC15 Solenoid	200 VA	10 <sup>5</sup>
DC1 Resistive load command	60 W(*)	10 <sup>5</sup>
DC13 Solenoid L/R=150ms	30 W	10 <sup>5</sup>

 $(\mbox{\ensuremath{^{'}}})$  for AC1 & DC1 the outputs indicated here take the maximum per point on Twido (2A) into account.


### **Output delay**

The output delay is shown below.

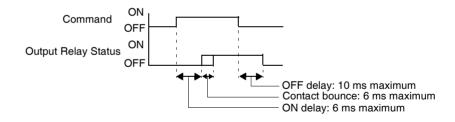


# Relay Output

The relay output contact is shown below.




### Transistor Source Output Contact

The transistor source output contact is shown below.



### Transistor Sink Output Contact

The transistor sink output contact is shown below.



### **Modular Controller Wiring Schematics**

### Introduction

This section shows examples of wiring schematics for the Modular controllers.

# **▲** DANGER

### HAZARD OF ELECTRIC SHOCK

- Be sure to remove ALL power from ALL devices before connecting or disconnecting inputs or outputs to any terminal or installing or removing any hardware
- Be sure to connect the grounding wire to a proper ground.


Failure to follow this instruction will result in death, serious injury, or equipment damage.

Note: These schematics are for external wiring only.

**Note:** The shaded boxes are markings on the controller. The I and Q numbers are the input and output points.

### TWDLMDA20-DUK Wiring Schematic


This schematic is for the TWDLMDA20DUK controller with connector.

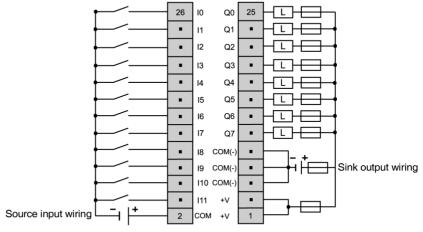

- The COM(-) terminals are connected together internally.
- The COM and COM(-) terminals are **not** connected together internally.
- The +V terminals are connected together internally.
- Connect an appropriate fuse for the load.

### TWDLMDA20-DTK Wiring Schematic


This schematic is for the TWDI MDA20DTK controller with connector

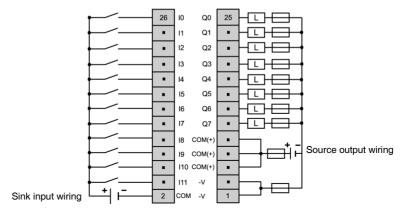

- The COM(+) terminals are connected together internally.
- The COM and COM(+) terminals are **not** connected together internally.
- The -V terminals are connected together internally.
- Connect an appropriate fuse for the load.

### TWDLMDA20-DRT Wiring Schematic


This schematic is for the TWDLMDA20DRT controller with terminal block.

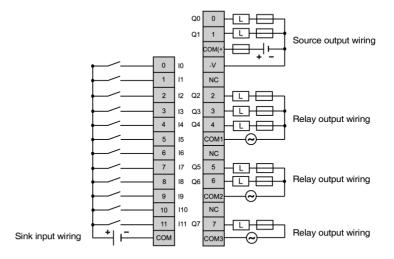

- Output points 0 and 1 are transistor source outputs, all other output points are relay.
- The COM terminals are not connected together internally.
- Connect an appropriate fuse for the load.

### TWDLMDA40-DUK Wiring Schematic


This schematic is for the TWDLMDA40DUK controller with connector.

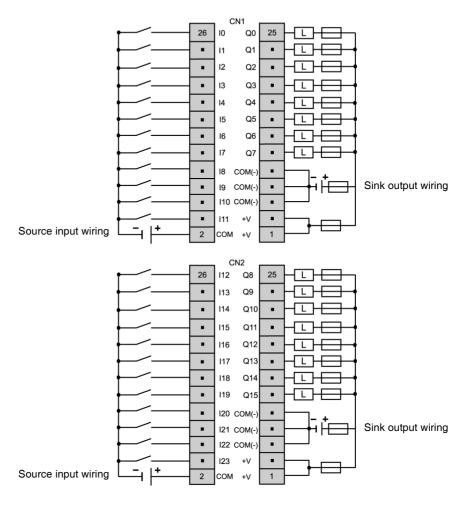

- The terminals on CN1 and CN2 are **not** connected together internally.
- The COM(-) terminals are connected together internally.
- The COM and COM(-) terminals are **not** connected together internally.
- The +V terminals are connected together internally.
- Connect an appropriate fuse for the load.

### TWDLMDA40-DTK Wiring Schematic

This schematic is for the TWDLMDA40DTK controller with connector.

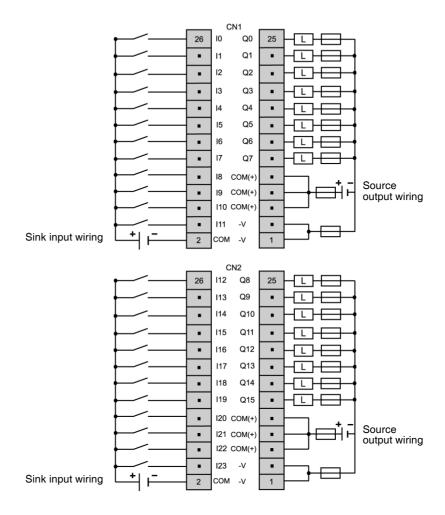

- The terminals on CN1 and CN2 are **not** connected together internally.
- The COM(+) terminals are connected together internally.
- The COM and COM(+) terminals are **not** connected together internally.
- The -V terminals are connected together internally.
- Connect an appropriate fuse for the load.

# 2.4 Digital I/O Modules

### At a Glance

### Introduction

This section provides an overview, specifications, and wiring schematics of the digital I/O modules.

# What's in this Section?

This section contains the following topics:

Topic	Page
Overview of Digital I/O Modules	80
Parts Description of Digital I/O Modules	83
Specifications for the Digital I/O Modules	85
Digital I/O Module Wiring Schematics	96

### **Overview of Digital I/O Modules**

**Introduction** The following section provides an overview of the digital I/O modules.

Illustrations The following illustrations are the digital input, output, and mixed I/O modules.

# Model Type Illustration There are 4 digital input modules: • 8-point module with a terminal block (TWDDDI8DT) **TWDDDI8DT** TWDDDI16DK • 16-point module with a terminal block (TWDDDI16DT) TWDDDI16DT • 16-point module with a connector (TWDDDI16DK) • 32-point module with a connector (TWDDDI32DK) • 8-point, 120 VAC input module with a terminal block (TWDDAI8DT) These modules can be attached to any controller except the Compact 10 I/O and 16 I/O controllers. TWDDDI32DK **TWDDAI8DT**


Illustration

### Model Type

There are 8 digital output modules:

- 8-point relay output module with a terminal block (TWDDRA8RT)
- 16-point relay output module with a terminal block (TWDDRA16RT)
- 8-point transistor sink module with a connector (TWDDDO8UT)
- 16-point transistor sink module with a connector (TWDDDO16UK)
- 32-point transistor sink module with a connector (TWDDDO32UK)
- 8-point transistor source module with a terminal block (TWDDD08TT)
- 16-point transistor source module with a connector (TWDDDO16TK)
- 32-point transistor source module with a connector (TWDDDO32TK)

These modules can be attached to any controller except the Compact 10 I/O and 16 I/O controllers.

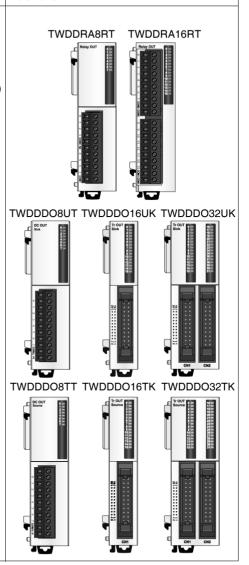

# Model Type There are 2 digital mixed input and output modules: ● 4-point input/4-point output module with a terminal block (TWDDMM8RT) ● 16-point input/8-point output module with a wire-clamp terminal block (TWDDMM24DRF) These modules can be attached to any controller except the Compact 10 I/O and 16 I/O controllers.


### Parts Description of Digital I/O Modules

### Introduction

The following section describes the parts of a digital I/O module with a terminal block and with a connector. Your I/O module may differ from the illustrations but the parts will be the same.

Parts
Description of a
Digital I/O
Module with a
Terminal Block

The following figure shows the parts of a digital I/O module with a terminal block. This figure is the TWDDDI8DT module.




### Legend

Label	Description
1	Expansion connector - one on each side, right side not shown
2	Terminal block
3	Latch button
4	LEDs
5	Clamp

Parts
Description of a
Digital I/O
Module with a
Connector

The following figure shows the parts of a digital I/O module with a connector. This figure is the TWDDDO16TK module.



### Legend

Label	Description
1	Expansion connector - one on each side, right side not shown
2	Connector
3	Latch button
4	LEDs
5	Clamp

### Specifications for the Digital I/O Modules

### Introduction

This section presents the specifications for the digital I/O modules.

TWDDDI8DT, TWDDDI16DT, TWDDDI16DK, TWDDDI32DK and TWDDAI8DT Specifications



# HAZARDS OF UNINTENDED EQUIPMENT OPERATION & EQUIPMENT DAMAGE


If any input exceeding the rated value is applied, permanent damage may be caused.

Failure to follow this instruction can result in death, serious injury, or equipment damage.

Reference	Digital I/O Modules TWDD				
number	DI8DT	DI16DT	DI16DK	DI32DK	AI8DT
Input points	8	16	16	32	8
Common lines	1	1	1	2	2
Rated input voltage	24 VDC source/s	sink input signal			120 VAC
Input voltage range	from 20.4 to 28.8	3 VDC			132 VAC max
Rated input current	7 mA/input (24 V	/DC)	5 mA/input (	24 VDC)	7.5 mA/input (100 VAC)
Input impedance	3.4 kΩ		4.4 kΩ		11 kΩ
Turn on time	8 ms (24 VDC)	8 ms (24 VDC)			25 ms (120 VAC)
Turn off time	8 ms (24 VDC)			30 ms (120 VAC)	
Isolation	Between input terminals and internal circuit: photocoupler isolated (isolation protection up to 500 V) Between input terminals: not isolated				
External load for I/O interconnection	Not needed				
Signal determination method	Static				
Input signals type	The input signals can be both sink and source.  The input signals makes the signals of the input signals makes the signal of the input signals of the input			The input signals must be of AC type.	
Cable length	3m (9.84 ft.) in compliance with electromagnetic immunity				

Reference	Digital I/O Modules TWDD			Digital I/O Modules TWD		
number	DI8DT	DI16DT	DI16DK	DI32DK	AI8DT	
Connector insertion/removal durability	100 times minim	um				
Internal current	25 mA (5 VDC)	40 mA (5 VDC)	` ,	65 mA (5 VDC)	55 mA (5 VDC)	
draw - all inputs on	0 mA (24 VDC)	0 mA (24 VDC)		0 mA (24 VDC)	0 mA (24 VDC)	
Internal current	5 mA (5 VDC)	5 mA (5 VDC)	5 mA (5 VDC)	10 mA (5 VDC)	25 mA (5 VDC)	
draw - all inputs off	0 mA (24 VDC)	0 mA (24 VDC)	0 mA (24 VDC)	0 mA (24 VDC)	0 mA (24 VDC)	
Weight	85 g	100 g	65 g	100 g	81 g	
	(3 oz)	(3.5 oz)	(2.3 oz)	(3.5 oz)	(2.9 oz)	


TWDDDI8DT, TWDDDI16DT, TWDDDI36DK, TWDDDI32DK and TWDDAI8DT Operating Range The operating range of the Type 1 (IEC 61131-2) input module is shown below.

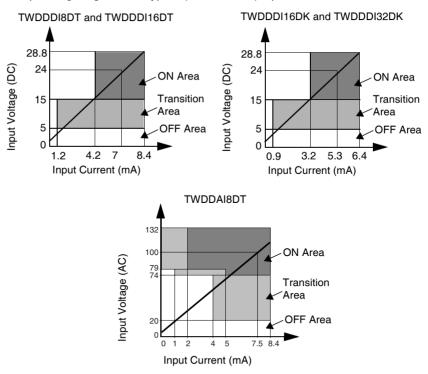


TWDDDI8DT, TWDDDI16DT, TWDDDI16DK, TWDDDI32DK and TWDDAI8DT Internal Circuit The input internal circuit is shown below.

### Standard Sink or Source Input


### TWDDDI8DT and TWDDDI16DT




### TWDDDI16DK and TWDDDI32DK




### TWDDAI8DT



TWDDDI8DT, TWDDDI16DT, TWDDDI16DK, TWDDDI32DK and TWDDAI8DT Usage Limits When using TWDDDI16DT at 55°C (131°F) in the normal mounting direction, limit the inputs which turn on simultaneously along line (1). At 45°C (113°F), all inputs can be turned on simultaneously at 28.8 VDC as indicated with line (2).



When using TWDDDI16DK and TWDDDI32DK at 55°C (131°F), limit the inputs which turn on simultaneously on each connector along line (3). This limitation applies per connecteur. At 30°C (86°F), all inputs can be turned on simultaneously at 28.8 VDC as indicated with line (4).



When using TWDDDI8DT, all inputs can be turned on simultaneously at 55°C (131°F), input voltage 28.8 VDC.

# TWDDRA8RT and TWDDRA16RT Specifications

# **A** CAUTION


### **ELECTRIC SHOCK & FIRE HAZARDS**

Possible current overload; size wire accordingly.

Failure to follow this instruction can result in injury or equipment damage.

Reference number	TWDDRA8RT	TWDDRA16RT	
Output points and common lines	8 NO contacts in 2 common lines	16 NO contacts in 2 common lines	
Maximum load current	2 A per output		
	7 A per common line	8 A per common line	
Minimum switching load	0.1 mA/0.1 VDC (reference value)		
Initial contact resistance	30 mΩ maximum		
Electrical life	100,000 operations minimum (rated	resistive load 1,800 operations/h)	
Mechanical life	20,000,000 operations minimum (no	load 18,000 operations/h)	
Rated load (resistive/inductive)	240 VAC/2 A, 30 VDC/2 A		
Dielectric strength	Between output to terminals: 1500 VAC, 1 minute Between output terminal and internal circuit: 1500 VAC, 1 minute Between output groups: 1500 VAC, 1 minute		
Connector insertion/removal durability	100 times minimum		
Internal current draw - all outputs on	30 mA (5 VDC) 40mA (24 VDC)	45 mA (5 VDC) 75 mA (24 VDC)	
Internal current draw - all outputs off	5 mA (5 VDC) 0 mA (24 VDC)	5 mA (5 VDC) 0 mA (24 VDC)	
Weight	110 g (3.9 oz)	145 g (5.1 oz)	

TWDDRA8RT and TWDDRA16RT Delay The output delay is shown below.

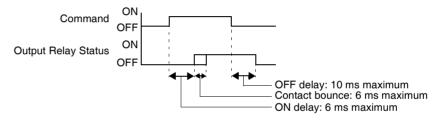

### TWDDDO8UT, TWDDDO16UK, and TWDDDO32UK Specifications

Reference number	TWDDD08UT	TWDDD016UK	TWDDD032UK	
Output type	Transistor sink output			
Output points per common Line	8 points in 1 common line	16 points in 1 common line	32 points in 2 common lines	
Rated load voltage	24 VDC		•	
Operating load voltage range	from 20.4 to 28.8 VDC			
Rated load current	0.3 A per output	0.1 A per output		
Maximum load current	0.36 A per output at maximum load (0.3 A at nominal load) 3 A per common line	0.12 A per output a (0.1 A at nominal lo 1 A per common lir	oad)	
Voltage drop (on voltage)	1 V maximum (voltage between COM a	and output terminals	when output is on)	
Inrush current	1 A maximum			
Leakage current	0.1 mA maximum			
Clamping voltage	39 V +/-1 V			
Maximum lamp load	8 W			
Inductive load	L/R = 10 ms (28.8 VDC, 1 Hz)	L/R = 10 ms (28.8 VDC, 1 Hz)		
External current draw	100 mA maximum, 24 VDC (power voltage at the +V terminal)			
Isolation	Between output terminal and internal circuit: photocoupler isolated (isolation protection up to 500 V) Between output terminals: not isolated			
Connector insertion/removal durability	100 times minimum			
Internal current draw - all outputs on	10 mA (5 VDC) 10 mA (5 VDC) 20 mA (5 VDC) 20 mA (24 VDC) 70 mA (24 VDC)			
Internal current draw - all outputs off	5 mA (5 VDC) 0 mA (24 VDC)	5 mA (5 VDC) 0 mA (24 VDC)	10 mA (5 VDC) 0 mA (24 VDC)	
Output delay	Turn on time: 300 μs maximum Turn off time: 300 μs maximum			
Weight	85 g (3 oz)	70 g (2.5 oz)	105 g (3.7 oz)	

### TWDDDO8TT, TWDDDO16TK, and TWDDDO32TK Specifications

Reference number	TWDDDO8TT	TWDDDO16TK	TWDDDO32TK
Output type	Transistor source output		
Output points per common Line	8 points in 1 common line	16 points in 1 common line	32 points in 2 common lines
Rated load voltage	24 VDC		
Operating load voltage range	from 20.4 to 28.8 VDC		
Rated load current	0.3 A per output	0.1 A per output	
Maximum load current	0.36 A per output at maximum load (0.1 A at nominal load) (0.3 A at nominal load) 1 A per common line		
Voltage drop (on voltage)	1 V maximum (voltage b	etween COM and output to	erminals when output is on)
Inrush current	1 A maximum		
Leakage current	0.1 mA maximum		
Clamping voltage	39 V +/-1 V		
Maximum lamp load	8 W		
Inductive load	L/R = 10 ms (28.8 VDC, 1 Hz)		
External current draw	100 mA maximum, 24 VDC (power voltage at the +V terminal)		
Isolation	Between output terminal and internal circuit: photocoupler isolated (isolation protection up to 500 V) Between output terminals: not isolated		
Connector insertion/removal durability	100 times minimum		
Internal current draw - all outputs on	10 mA (5 VDC) 10 mA (5 VDC) 20 mA (5 VDC) 20 mA (24 VDC) 70 mA (24 VDC)		
Internal current draw - all outputs off	5 mA (5 VDC) 0 mA (24 VDC)	5 mA (5 VDC) 0 mA (24 VDC)	10 mA (5 VDC) 0 mA (24 VDC)
Output delay	Turn on time: 300 μs maximum Turn off time: 300 μs maximum		
Weight	85 g (3 oz)	70 g (2.5 oz)	105 g (3.7 oz)

### TWDDMM8DRT and TWDDMM24DRF Input Specifications




# HAZARDS OF UNINTENDED EQUIPMENT OPERATION & EQUIPMENT DAMAGE

If any input exceeding the rated value is applied, permanent damage may be caused.

Failure to follow this instruction can result in death, serious injury, or equipment damage.


Reference number	TWDDMM8DRT	TWDDMM24DRF	
I/O points	4 inputs and 4 outputs	16 inputs and 8 outputs	
Rated input voltage	24 VDC source/sink input signal		
Input voltage range	from 20.4 to 28.8 VDC		
Rated input current	7 mA/input (24 VDC)		
Input impedance	3.4 kΩ		
Turn on time (24 VDC)	4 ms (24 VDC)		
Turn off time (24 VDC)	4 ms (24 VDC)		
Isolation	Between input terminals and internal circuit: photocoupler isolated (isolation protection up to 500 V) Between input terminals: not isolated		
External load for I/O interconnection	Not needed		
Signal determination method	Static		
Input signals type	Both sinking and sourcing input signals	can be connected.	
Cable length	3m (9.84 ft.) in compliance with electron	magnetic immunity	
Connector insertion/removal durability	100 times minimum	Not removable	
Internal current draw - all I/O on	25 mA (5 VDC) 65 mA (5 VDC) 20 mA (24 VDC) 45 mA (24 VDC)		
Internal current draw - all I/O off	5 mA (5 VDC) 10 mA (5 VDC) 0 mA (24 VDC) 0 mA (24 VDC)		
Weight	95 g (3.3 oz)	140 g (4.9 oz)	

TWDDMM8DRT and TWDDMM24DRF Input Operating Range The input operating range of the Type 1 (IEC 61131-2) input module is shown below.




TWDDMM8DRT and TWDDMM24DRF Input Internal Circuit The input internal circuit is shown below.

### Standard Sink or Source Input



TWDDMM8DRT and TWDDMM24DRF Usage Limits When using TWDDMM24DRF at an ambient temperature of 55°C (131°F) in the normal mounting direction, limit the inputs and outputs, respectively, which turn on simultaneously along line (1). At 45°C (113°F), all inputs and outputs can be turned on simultaneously at 28.8 VDC as indicated with line (2).




When using TWDDMM8DRT, all inputs and outputs can be turned on simultaneously at 55°C (131°F), input voltage 28.8 VDC.

### TWDDMM8DRT and TWDDMM24DRF Output Specifications

Reference number	TWDDMM8DRT	TWDDMM24DRF	
Output points and common lines	4 NO contacts in 1 common	8 NO contacts in 2 common	
	line	lines	
Maximum load current	2 A per output		
	7 A per common line		
Minimum switching load	0.1 mA/0.1 VDC (reference v	/alue)	
Initial contact resistance	30 m $Ω$ maximum		
Electrical life	100,000 operations minimum (rated resistive load 1,800		
	operations/h)		
Mechanical life	20,000,000 operations minimum (no load 18,000		
	operations/h)		
Rated load (resistive/inductive)	240 VAC/2 A, 30 VDC/2 A		
Dielectric strength	Between the output and ground terminals: 1500 VAC, 1		
	Between output terminal and internal circuit: 1500 VAC, 1		
	minute		
	Between output groups: 1500 VAC, 1 minute		


### TWDDMM8DRT and TWDDMM24DR Output Delay

The output delay is shown below.

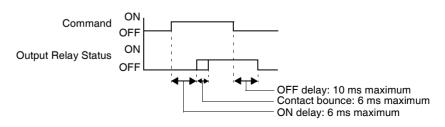


# Relay Output

The relay output contact is shown below.




### Transistor Source Output Contact

The transistor source output contact is shown below.



### Transistor Sink Output Contact

The transistor sink output contact is shown below.



### **Digital I/O Module Wiring Schematics**

### Introduction

This section shows examples of wiring schematics for the digital I/O modules.

## **A** DANGER

### HAZARD OF ELECTRIC SHOCK

- Be sure to remove ALL power from ALL devices before connecting or disconnecting inputs or outputs to any terminal or installing or removing any hardware.
- Be sure to connect the grounding wire to a proper ground.


Failure to follow this instruction will result in death, serious injury, or equipment damage.

Note: These schematics are for external wiring only.

**Note:** The shaded boxes are markings on the digital I/O modules. The I and Q numbers are the input and output points.

### TWDDDI8DT Wiring Schematic

This schematic is for the TWDDDI8DT module.



• The two COM terminals are connected together internally.

### TWDDAI8DT Wiring Schematic


# **▲** DANGER

### HAZARD OF ELECTRIC SHOCK, BURN OR EXPLOSION

Turn off all power before starting installation, removal, wiring, maintenance or inspection of the smart relay system.

Failure to follow this instruction will result in death, serious injury, or equipment damage.

This schematic is for the TWDDAI8DT module.




120 VAC input wiring

• The two COM terminals are **not** connected together internally.

### TWDDDI16DT Wiring Schematic


This schematic is for the TWDDDI16DT module.

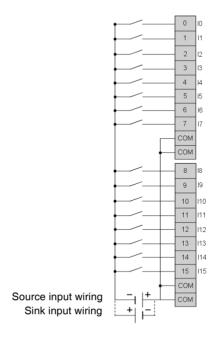

• The four COM terminals are connected together internally.


### TWDDDI16DK Wiring Schematic

This schematic is for the TWDDDI16DK module.

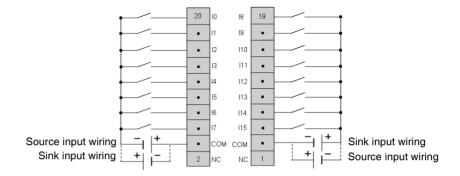

### TWDDDI32DK Wiring Schematic


This schematic is for the TWDDDI32DK module.

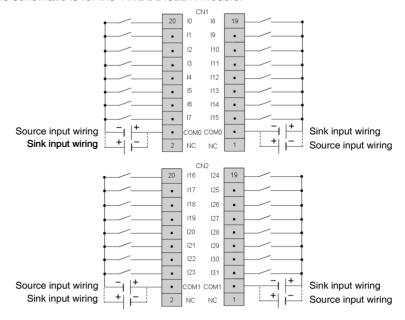

- The COM0 terminals are connected together internally.
- The COM1 terminals are connected together internally.
- The COM0 and COM1 terminals are **not** connected together internally.

### TWDDRA8RT Wiring Schematic

This schematic is for the TWDDRA8RT module.



- The COM0 and COM1 terminals are **not** connected together internally.
- · Connect an appropriate fuse for the load.

### TWDDRA16RT Wiring Schematic


This schematic is for the TWDDRA16RT module.

Relay output wiring 0 Q0 Q1 1 Q2 2 Ω3 3 4 Q4 Q5 5 Q6 6 7 Ω7 СОМО СОМО Q8 8 Q9 9 Q10 10 Q11 11 Q12 12 Q13 13 Q14 14 Q15 15 СОМ1 COM1

- The COM0 terminals are connected together internally.
- The COM1 terminals are connected together internally.
- The COM0 and COM1 terminals are **not** connected together internally.
- Connect an appropriate fuse for the load.

# TWDDDO8UT Wiring Schematic


This schematic is for TWDDDO8UT module



• Connect an appropriate fuse for the load.

### TWDDDO16UK Wiring Schematic

This schematic is for the TWDDDO16UK module.

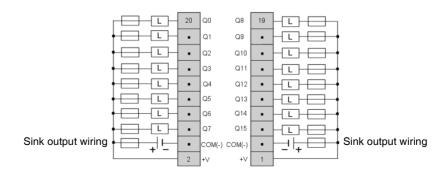


- The COM(-) terminals are connected together internally.
- The +V terminals are connected together internally.
- Connect an appropriate fuse for the load.

TWD USE 10AE 10AE

### TWDDDO32UK Wiring Schematic


This schematic is for the TWDDDO32UK module

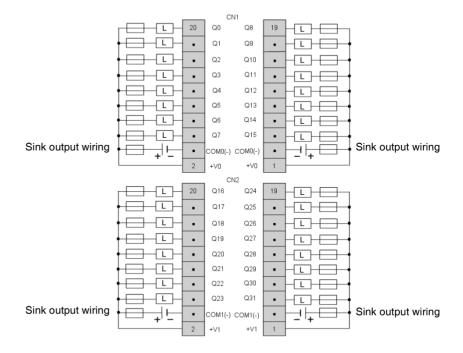

- Terminals on CN1 and CN2 are **not** connected together internally.
- The COM0(-) terminals are connected together internally.
- The COM1(-) terminals are connected together internally.
- The +V0 terminals are connected together internally.
- The +V1 terminals are connected together internally.
- Connect an appropriate fuse for the load.

### TWDDDO8TT Wiring Schematic


This schematic is for the TWDDDO8TT module.



• Connect an appropriate fuse for the load.

### TWDDDO16TK Wiring Schematic

This schematic is for the TWDDDO16TK module.

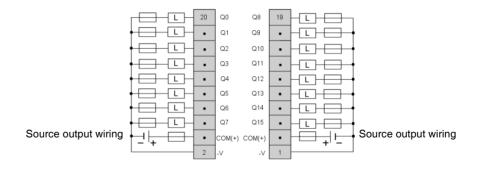


- The COM(+) terminals are connected together internally.
- The -V terminals are connected together internally.
- Connect an appropriate fuse for the load.

TWD USE 10AE 10AE

### TWDDDO32TK Wiring Schematic


This schematic is for the TWDDDO32TK module.

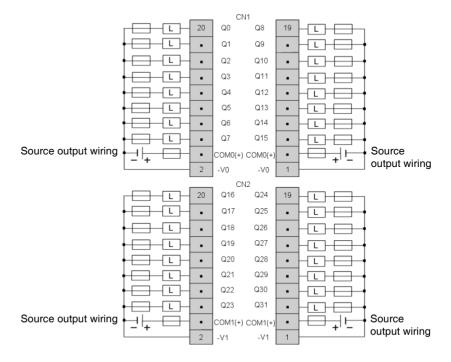

- Terminals CN1 and CN2 are **not** connected together internally.
- The COMO(+) terminals are connected together internally.
- The COM1(+) terminals are connected together internally.
- The -V0 terminals are connected together internally.
- The -V1 terminals are connected together internally.
- Connect an appropriate fuse for the load.

### TWDDMM8DRT Wiring Schematic


This schematic is for the TWDDMM8DRT module.

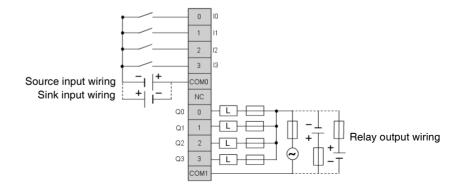

• The COM0 and COM1 terminals are **not** connected together internally.

### TWDDMM24DRF Wiring Schematic

This schematic is for the TWDDMM24DRF module.

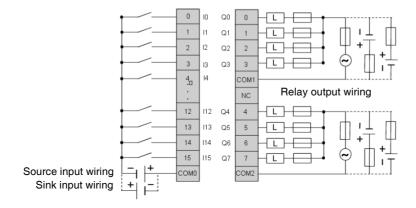

- The COM0, COM1 and COM2 terminals are **not** connected together internally.
- Connect an appropriate fuse for the load.

# 2.5 Analog I/O Modules

### At a Glance

### Introduction

This section provides an overview, specifications, and wiring schematics of the analog I/O modules.

# What's in this Section?

This section contains the following topics:

Topic	Page
Overview of Analog I/O Modules	107
Parts Description of Analog I/O Modules	109
General Specifications for the Analog I/O Module	110
I/O Specifications for the Analog I/O Module	111
Analog I/O Modules Wiring Schematics	119

### Overview of Analog I/O Modules

**Introduction** The following section provides an overview of the analog I/O modules.

**Illustrations** The following illustrations present the analog I/O modules.

Controller Type	Illustration
These 2 analog I/O modules are:  2-point input/1-point output module with a terminal block, accepts thermocouple and resistance thermometer signals (TWDALM3LT)  2-point input/1-point output module with a terminal block (TWDAMM3HT)  These modules can be attached to any controller except the Compact 10 I/O and 16 I/O controllers.	TWDALM3LT  TWDAMM3HT  AMAGO  A
These 2 analog I/O modules are:  2-point input module with a terminal block (TWDAMI2HT)  1-point output module with a terminal block (TWDAMO1HT)  These modules can be attached to any controller except the Compact 10 I/O and 16 I/O controllers.	TWDAMI2HT TWDAMO1HT

TWD USE 10AE 10AE

# Controller Type Illustration These 2 analog I/O modules are: • 2-point output module with a terminal block (TWDAVO2HT) TWDAVO2HT TWDAMI4LT • 4-point input module, current, voltage and temperature, with a terminal block These modules can be attached to any controller except the Compact 10 I/O and 16 I/O controllers. These 2 analog I/O modules are: • 8-point input module, current and voltage, with a terminal block (TWDAMI8HT) **TWDAMI8HT** TWDARI8HT • 8-point input module, temperature, with a terminal block (TWDARI8HT) These modules can be attached to any controller except the Compact 10 I/O and 16 I/O controllers.


### Parts Description of Analog I/O Modules

### Introduction

The following section describes the parts of an analog I/O module. Your I/O module may differ from the illustrations but the parts will be the same.

Parts
Description of an
Analog I/O
Module

The following figure shows the parts of an analog I/O module. This figure is the TWDALM3LT module.



### Legend

Label	Description
1	Expansion connector - one on each side, right side not shown
2	Removable terminal block
3	Latch button
4	LEDs
5	Clamp

### General Specifications for the Analog I/O Module

### Introduction

This section is general specifications for analog I/O modules.

# General Specifications

Reference	TWDALM3LT - TWDAMM3HT - TWDAMI2HT - TWDAMO1HT	TWDAVO2HT - TWDAMI4LT	TWDAMI8HT - TWDARI8HT
Rated power voltage		24 VDC	
Allowable voltage range	from 20.4 to 28.8 VDC	from 19.2 to 30.0 VDC including ripple	from 19.2 to 30.0 VDC including ripple
Average number of connector insertions/ removals	100 times minimum		
Internal current draw - internal power	50mA (5 VDC) 60mA (5 VDC) 0 mA (24 VDC) 0 mA (24 VDC)		•
Internal current draw - external power	40mA (24 VDC)	60mA (24 VDC)	45mA (24 VDC)
Weight	85 g (3 oz)		

### I/O Specifications for the Analog I/O Module

**Introduction** This section is I/O specifications for the analog I/O modules.

Voltage and Current Input Specifications The Analog Modules that comply with the Voltage and Current Input Specifications

are: TWDAMI2HT, TWDAMM3HT, TWDAMI4LT and TWDAMI8HT.

Specifications Voltage Input Specifications:

Analog Input Specifications	Voltage Input			
	TWDAMI2HT TWDAMM3HT	TWDAMI4LT	TWDAMI8HT	
Input range	fr	om 0 to 10 VDC	!	
Input impedance		1 MΩ min.		
Sample duration time	16 ms max.	160	) ms	
Sample repetition time	16 ms max.	4 x 160 ms	8 x 160 ms	
Total input system transfer time	32 ms + 1 scan time <sup>1</sup>	4x160 ms + 1 scan time <sup>1</sup>	8 x 160 ms + 1 scan time <sup>1</sup>	
Input type	Single-ended input	Non dif	ferential	
Operating mode		Self-scan		
Conversion mode	$\Sigma\Delta$ type ADC			
Input error - maximum error at 25°C (77°F)	±0.2 % of full scale	0.5% of full scale	1% of full scale	
Input error - temperature coefficient	±0.006% of full scale/°C	±0.005% of full scale/°C		
Input error - repeatable after stabilization time	±0.5 % of full scale	2 LSB		
Input error - nonlinear	±0.2 % of full scale	±0.002 %	of full scale	
Input error - maximum error	±1 % of full scale	0.5% of full scale	1% of full scale	
Digital resolution	4096 increments (12 bits)	12 bits	10 bits	
Input value of LSB	2.5 mV	2.5 mV	9.7 mV	
Data type in application program	0 to 4095 (12 bit data) -32768 to 32767 (optional range designation) <sup>2</sup>	0 to 4095 (12 bit) -32768 to 32767 Custom	0 to 1023 (10 bit) -32768 to 32767 Custom	
Monotonicity	Yes			
Input data out of range	Detectable <sup>3</sup>			
Noise resistance - maximum temporary deviation during electrical noise tests	±3% maximum when a 500 V clamp voltage is applied to the power and I/O wiring	±0.5% of full scale	±1% of full scale	

Analog Input Specifications	Voltage Input			
	TWDAMI2HT TWDAMM3HT	TWDAMI4LT	TWDAMI8HT	
Noise resistance - common mode characteristics	Common mode reject ratio (CMRR): -50 dB		eject ratio (CMRR): 0 dB	
Noise resistance - common mode voltage	16 VDC	15 VDC	15 VDC	
Noise resistance - input filter	No	ADC's n	otch filter	
Noise resistance - cable	Twisted-pair shielded cable is recommended for improved noise immunity	Cable	<30 m	
Noise resistance - crosstalk	2 LSB maximum	1 LSB maximum	1 LSB maximum	
Dielectric strength	500 V between input and power circuit	2500 V between inp	out and power circuit	
Type of protection	Photocoupler be	tween input and inte	rnal circuit	
Maximum permanent allowed overload (no damage)	no 13 VDC			
Selection of analog input signal type	Using software programming		g	
Calibration or verification to maintain rated accuracy	Approximately 10 years			

### **Current Input Specifications:**

Analog Input Specifications		Current Input	
	TWDAMI2HT TWDAMM3HT	TWDAMI4LT	TWDAMI8HT
Input range	from 4 to 20 mA DC	from 0 t	to 20 mA
Input impedance	10 Ω	47	0 Ω
Sample duration time	16 ms max.	160	) ms
Sample repetition time	16 ms max.	4x160 ms	8x160 ms
Total input system transfer time	32 ms + 1 scan time <sup>1</sup>	4x160 ms + 1 scan time <sup>1</sup>	8x160 ms + 1 scan time <sup>1</sup>
Input type	Differential input	Non dif	ferential
Operating mode		Self-scan	
Conversion mode		$\Sigma\Delta$ type ADC	
Input error - maximum error at 25°C (77°F)	±0.2 % of full scale	0.5% of full scale	1% of full scale
Input error - temperature coefficient	±0.006% of full scale/°C	.006% of full scale/°C ±0.005% of full scale/°C	
Input error - repeatable after stabilization time	time ±0.5 % of full scale 2 LSB		SB
Input error - nonlinear	±0.2 % of full scale	scale ±0.002 % of full scale	

Analog Input Specifications	Current Input			
	TWDAMI2HT TWDAMM3HT	TWDAMI4LT	TWDAMI8HT	
Input error - maximum error	±1 % of full scale	±0.5% of full scale	±1 % of full scale	
Digital resolution	4096 increments (12 bits)	4096 increments (12 bits)	1024 increments (10 bits)	
Input value of LSB	4 μΑ	4.8 μΑ	19.5 μΑ	
Data type in application program	0 to 4095 (12 bit data) -32768 to 32767 (optional range designation) <sup>2</sup>	0 to 4095 (12 bit) -32768 to 32767 Custom	0 to 1023 (10 bit) -32768 to 32767 Custom	
Monotonicity		Yes	1	
Input data out of range		Detectable <sup>3</sup>		
Noise resistance - maximum temporary deviation during electrical noise tests	±3% maximum when a 500 V clamp voltage is applied to the power and I/O wiring	±0.5% of full scale	±1% of full scale	
Noise resistance - common mode characteristics	Common mode reject ratio (CMRR): -50 dB		eject ratio (CMRR):	
Noise resistance - common mode voltage	16 VDC	15 VDC	15 VDC	
Noise resistance - input filter	No	ADC's r	otch filter	
Noise resistance - cable	Twisted-pair shielded cable is recommended for improved noise immunity	Cable	<30 m	
Noise resistance - crosstalk	2 LSB maximum	1 LSB maximum	1 LSB maximum	
Dielectric strength	500 V between input and power circuit	2500 V between in	out and power circuit	
Type of protection	Photocoupler between input and internal circuit			
Maximum permanent allowed overload (no damage)	o 40 mA DC			
Selection of analog input signal type	Using software programming			
Calibration or verification to maintain rated accuracy	d Approximately 10 years			

### Thermocouple and Temperature Input Specifications

The Analog Modules that comply with the Thermocouple and/or Temperature Input Specifications are: TWDALM3LT, TWDAMI4LT, and TWDARI8HT.

Analog Input Specifications	Thermocouple	To	emperature Probe	es
	TWDALM3LT	TWDALM3LT	TWDAMI4LT	TWDARI8HT
Input range	Type K (0 to 1300 °C) (32 to 2372 °F) Type J (0 to 1200 °C) (32 to 2192 °F) Type T (0 to 400 °C) (32 to 742 °F)	(RTD) Pt 100 3-wire type (-100 to 500°C) (-148 to 932 °F)	(RTD) Pt 100, Pt 1000, Ni 100, Ni 1000 3-wire type (-100 to 500 °C) (-148 to 932 °F)	NTC or PTC thermistor 100 to 1,000 ohms temperature range
Input impedance	1 MΩ r	川 nin.	1 MΩ min.	1 MΩ min.
Sample duration time	50 ms r	nax.	160	ms
Sample repetition time	50 ms r	nax.	4x160 ms	8x160 ms
Total input system transfer time	100 ms + 1 s	100 ms + 1 scan time <sup>1</sup>		8x160 ms + 1 scan time <sup>1</sup>
Input type	Differential		l input	
Operating mode		Self-so	an	
Conversion mode		ΣΔ type	ADC	
Input error - maximum error at 25°C (77°F)	±0.2% of full scale plus reference junction compensation accuracy ±4°C max	±0.2% of full scale	0.5% of full scale	1% of full scale
Input error - temperature coefficient	±0.006% of fu	II scale/°C	±0.005% of	full scale/°C
Input error - repeatable after stabilization time	±0.5% of full scale		2 L	SB
Input error - nonlinear	±0.2% of fu	ıll scale	±0.002% c	of full scale
Input error - maximum error	±1% of full scale		±0.5% of full scale	±1% of full scale
Digital resolution	4096 increments (12	bits)	12 bits	10 bits

Analog Input Specifications	Thermocouple Temperature Probes		es	
	TWDALM3LT	TWDALM3LT	TWDAMI4LT	TWDARI8HT
Input value of LSB	K: 0.325 °C (K: 0.585 °F) J: 0.300 °C (J: 0.540 °F) T: 0.100 °C (T: 0.180 °F)	K: 0.15 °C (K: 0.27 °F)	K: 0.15 °C (K: 0.27 °F)	Depending on the probe
Data type in application program	0 to 4095 (12 bit data -32768 to 32767 (opt designation) <sup>2</sup>	•	0 to 4095 (12 bit data) -32768 to 32767 Custom	0 to 1023 (10 bit data) -32768 to 32767 Custom
Monotonicity		Yes		
Input data out of range		Detecta	ble <sup>3</sup>	
Noise resistance - maximum temporary deviation during electrical noise tests	±3% maximum when a 500 V clamp voltage is applied to the power and I/O wiring	Accuracy is not assured when noise is applied	±0.5% of full scale	±1% of full scale
Noise resistance - common mode characteristics	Common mode rejection 50 dl		Common mod (CMRR)	•
Noise resistance - common mode voltage	16 VDC		15 VDC	15 VDC
Noise resistance - input filter	No		ADC's no	otch filter
Noise resistance - cable	_		Cable	<30 m
Noise resistance - crosstalk	2 LSB maximum		1 LSB maximum	1 LSB maximum
Dielectric strength	500 V between input and power circuit		2500 V between circ	
Type of protection	Photocoupler between input and internal circuit		cuit	
Maximum permanent allowed overload (no damage)	_		_	_
Selection of analog input signal type	Using software programming No		None	
Calibration or verification to maintain rated accuracy	Approximately 10 years			

### Note:

- 1. Total input system transfer time = sample repetition x + 1 scan time.
- 2. The 12-bit data (0 to 4095) and 10-bit data (0 to 1023) processed in the Analog I/O module can be linear-converted to a value between -32768 and 32767. The optional range designation and analog I/O data minimum and maximum values can be selected using data registers allocated to analog I/O modules.
- **3.** When an error is detected, a corresponding error code is stored to a data register allocated to analog I/O operating status.

### Voltage and Current Output Specifications

The Analog Modules that comply with the Voltage and Current Output Specifications are: TWDAMO1HT, TWDAMM3HT, TWDLM3LT. One Module complies with the Voltage Output Specifications only: TWDAVO2HT.

Analog Output Specifications	Voltage output		<b>Current Output</b>
	TWDAMO1HT TWDAMM3HT TWDLM3LT	TWDAVO2HT	TWDAMO1HT TWDAMM3HT TWDLM3LT
Output range	from 0 to 10 VDC	from -10 to 10 VDC	from 4 to 20 mA DC
Load impedance	2 kΩ max	> 3 kΩ	300 Ω maximum
Application load type		Resistive load	
Settling time	20 ms	2 ms	20 ms
Total output system transfer Time	20 ms + 1 scan time	2 ms + 1 scan time	20 ms + 1 scan time
Output error - maximum error at 25°C (77°F)	±0.2% of full scale	1% of full scale	±0.2% of full scale
Output error - temperature coefficient	±0.015% of full scale/°C	±0.01% of full scale/°C	±0.015% of full scale/°C
Output error - repeatable after stabilization time	±0.5 % of full scale	±0.1% of full scale	±0.5% of full scale
Output error - output voltage drop	±1% of full scale	±0.5% of full scale	±1% of full scale
Output error - nonlinear	±0.2% of full scale		
Output error - output ripple		1 LSB maximum	
Output error - overshoot		0%	
Output error - total error		±1 % of full scale	
Digital resolution	4096 increments (12 bits)	11 bits + sign	4096 increments (12 bits)
Output value of LSB	2.5 mV	+/- 4.8 mV	4 μΑ
Data type in application program	0 to 4095 (12 bit data) -32768 to 32767 (optional range designation) <sup>1</sup>	-2048 to 2047	0 to 4095 (12 bit data) -32768 to 32767 (optional range designation) <sup>1</sup>
Monotonicity	Yes		
Current loop open	_	Not detectable	Detectable <sup>2</sup>
Noise resistance - maximum temporary deviation during electrical noise tests	±3% maximum when a 500 V clamp voltage is applied to the power and I/O wiring	±1% of full scale	±3% maximum when a 500 V clamp voltage is applied to the power and I/O wiring

Analog Output Specifications	Voltage	output	<b>Current Output</b>
	TWDAMO1HT TWDAMM3HT TWDLM3LT	TWDAVO2HT	TWDAMO1HT TWDAMM3HT TWDLM3LT
Noise resistance - cable	Twisted-pair shielded cable is recommended for improved noise immunity	Cable >30 m	Twisted-pair shielded cable is recommended for improved noise immunity
Noise resistance - crosstalk	No crosstalk because of 1 channel output		el output
Dielectric strength	500 V between output and power circuit	2500 V between output and power circuit	500 V between output and power circuit
Type of protection	Photocouple	er between output and in	ternal circuit
Selection of analog output signal type	Using software programming	None	Using software programming
Calibration or verification to maintain rated accuracy	Approximately 10 years		

### Note:

- 1. The 12-bit data (0 to 4095) processed in the Analog I/O module can be linear-converted to a value between -32768 and 32767. The optional range designation and analog I/O data minimum and maximum values can be selected using data registers allocated to analog I/O modules.
- **2.** When an error is detected, a corresponding error code is stored to a data register allocated to analog I/O operating status.

### **Analog I/O Modules Wiring Schematics**

Introduction

This section shows examples of wiring schematics for the Analog I/O modules.

TWDALM3LT Wiring Schematic




# HAZARDS OF UNINTENDED EQUIPMENT OPERATION & EQUIPMENT DAMAGE


- Do not connect any wiring to unused channels.
- Do not connect the thermocouple to a hazardous voltage (30 V<sub>RMS</sub> or 42.4 V<sub>neak</sub> or higher.)

Failure to follow this instruction can result in death, serious injury, or equipment damage.

### This schematic is for the TWDALM3LT module.

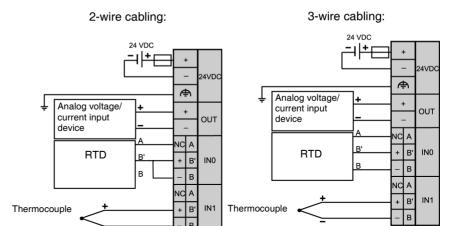

### 4-wire cabling:




**Note**: For 4-wire cabling, output A' is not connected.

- Connect a fuse appropriate for the applied voltage and current draw, at the position shown in the diagram.
- When connecting an RTD, connect the three wires to terminals A, B', and B of input channel 0 or 1.
- When connecting a thermocouple, connect the two wires to terminals B' and B of input channel 0 or 1.

### TWDAMM3HT Wiring Schematic

This schematic is for the TWDAMM3HT module.




- Connect a fuse appropriate for the applied voltage and current draw, at the
  position shown in the diagram.
- Do not connect any wiring to unused channels.

Note: The (-) poles of inputs INO and IN1 are connected internally.

### TWDAMI2HT Wiring Schematic

This schematic is for the TWDAMI2HT module.




- Connect a fuse appropriate for the applied voltage and current draw, at the position shown in the diagram.
- Do not connect any wiring to unused channels.

Note: The (-) poles of inputs IN0 and IN1 are connected internally.

### TWDAMO1HT Wiring Schematic


This schematic is for the TWDAMO1HT module



- Connect a fuse appropriate for the applied voltage and current draw, at the position shown in the diagram.
- Do not connect any wiring to unused channels.

### TWDAVO2HT Wiring Schematic


This schematic is for the TWDAVO2HT module.




- Connect a fuse appropriate for the applied voltage and current draw, at the position shown in the diagram.
- Do not connect any wiring to unused channels.

### TWDAMI4LT Wiring Schematic

This schematic is for the TWDAMI4LT module configured for temperature measurements




This schematic is for the TWDAMI4LT module configured for voltage or current input.



- Connect a fuse appropriate for the applied voltage and current draw, at the position shown in the diagram.
- Do not connect any wiring to unused channels.

### TWDAMI8HT Wiring Schematic

This schematic is for the TWDAMI8HT module




(1) Analog voltage/current output devices

- Connect a fuse appropriate for the applied voltage and current draw, at the position shown in the diagram.
- Do not connect any wiring to unused channels.

### TWDARI8HT Wiring Schematic

This schematic is for the TWDARI8HT module.



- Connect a fuse appropriate for the applied voltage and current draw, at the position shown in the diagram.
- Do not connect any wiring to unused channels.

### 2.6 AS-Interface V2 bus master module

### At a Glance

### Introduction

This section provides a review of the AS-Interface bus, presents the description, specifications and use of the AS-Interface master module **TWDNOI10M3**.

# What's in this Section?

This section contains the following topics:

Торіс	Page
Reminder about the AS-Interface bus	126
Presentation of the main constituent elements of the AS-Interface bus	129
Main specifications of the AS-Interface V2 Bus	131
Parts description of an AS-Interface master module: TWDNOI10M3	134
Technical specifications of the TWDNOI10M3 module and the AS-Interface V2 bus	135
Wiring and connections	137
TWDNOI10M3 Operating Modes and Push Buttons	140
AS-Interface module TWDNOI10M3 display panel	142

### Reminder about the AS-Interface bus

### General

The AS-Interface (abbreviation for Actuator-Sensor-Interface) bus is a field bus (level 0), and can be used to connect sensors/actuators. This allows "discrete" or analog type information to run between a bus "master" and sensor/actuator type "slave" devices.

AS-Interface is made up of three major basic elements:

- a specific supply providing a 30 VDC voltage.
- a bus master.
- one or more slave devices (sensors, actuators and others).


These components are interconnected by a two-wire cable dedicated to data transmission and power supply.

# The main types of sensors/ actuators


Table of the main types of sensors:

Type of sensor	Description
Communicating sensors/ actuators (compatible with AS- Interface)	Thanks to the integrated AS-Interface feature, they connect directly to the AS-Interface bus via a passive dispatcher or a connection T.
Traditional sensors/actuators (not compatible with AS-Interface)	They connect to the bus via an AS-Interface interface (active dispatcher). These interfaces connect the sensors and traditional actuators to the AS-Interface bus and provide them with dialog capacity on the bus.

### Illustration

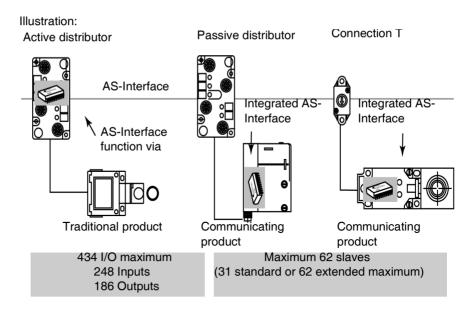

Overview of AS-Interface Products from the Schneider Catalog Non-exhaustive list of AS-Interface products from the Schneider catalog:

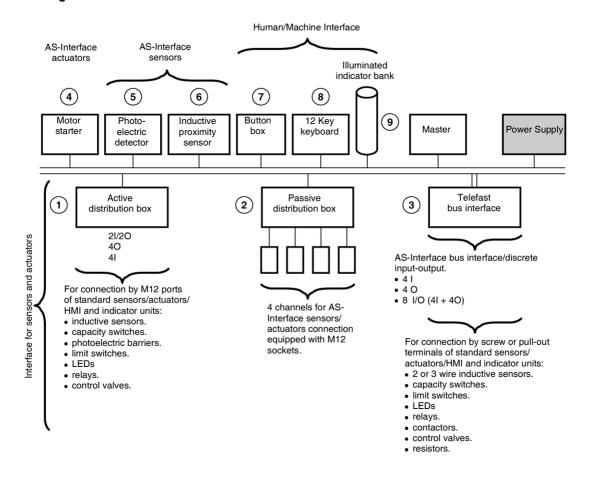

### Presentation of the main constituent elements of the AS-Interface bus

### Introduction to the Main Constituent

**Flements** 

The following table lists the main constituent elements of an AS-Interface bus:

### Part

# Illustration AS-Interface hus master Connected to a modular controller or a compact TWDLC•A24DRF or TWDLCA•40DRF series, it manages all exchange of data on the AS-Interface network. It also enables slave status to be monitored. Module TWDNOI10M3 AS-Interface Power Supply Specific AS-Interface power supplies, dedicated to 30 VDC, designed to supply the constituents connected to the AS-Interface bus. The power supply is distributed with the same medium used for data exchange. Power supply (30 VDC) Cable This transmits data and carries the power. It can be made up from: • Either a standard two-wire AS-Interface yellow ribbon cable. unshielded and polarized, • Or a standard round, shielded or unshielded two-wire cable. Guiding ribbon Round cable cable

# Slaves Different types of slaves can be connected to the AS-Interface, bus, including the sensors, actuators and splitters, as well as the analog slaves. Slaves are available as slaves with standard address settings, or as slaves with extended address settings (A/B). Sensor Actuator Passive

### Main specifications of the AS-Interface V2 Bus

### Overview

AS-Interface is a system in which exchange management is ensured by a single master which, by scanning the bus, calls each detected slave in succession and awaits a response. The master manages the inputs/outputs, parameters and identity codes of each slave, as well as their addressing.

For slaves with AS-Interface V2 standard addressing, the serial communications frame carries:

- 4 data bits (D0 to D3), which are the image of inputs or outputs according to the type of interface.
- 4 parametering bits (P0 to P3), which are used to set the operating modes of the interface

Communication series frame for slaves with extended addressing settings:

- 4 data bits (D0 to D3), which are the image of inputs or outputs according to the type of interface,
- 3 parametering bits (P0 to P2), which are used to set the operating modes of the interface.

All slave devices connected to the AS-Interface bus are identified by at least one "I/O Code" and one "ID code" which completes the functional identification of the slave. Some slaves have an ID2 and ID1 code, which define the internal functions of the slave: on analog slaves, for example, ID2 shows the slave's analog channel number. In the AS-Interface master request, outputs are positioned and AS-Interface input devices are sent back in the slave's response.

# Table of Main Specifications

Specifications	Description	
Slave Addressing	Each slave connected to the AS-Interface bus must have an address between 1 and 31, accompanied by "bank" /A or "bank" /B for extended addressing. The slaves delivered from the factory have the address 0 (the address of the slave is memorized in a non-volatile format). Addresses are programmed using a specialized addressing terminal.	
Identification of Slaves	<ul> <li>All slave devices connected to the AS-Interface bus are identified by:</li> <li>an ID identity code (coded on 4 bits) that specifies the type of slave (sensor, extended slave, etc.). For example, the ID code of an extended slave is 0xA,</li> <li>an I/O code (coded on 4 bits) that shows input/output distribution. For exampthe I/O code of a slave with 4 inputs is 0, with 4 inputs is 8 and with 2 I/2O is</li> <li>an ID2 code (coded on 4 bits) that specifies the internal functionalities of the slave,</li> <li>an ID1 code (coded on 4 bits) that specifies an additional slave identity, These identifications allow the AS-Interface master to recognize the configuration present on the bus.</li> <li>These different profiles have been developed by the AS-Interface association. The are used to distinguish between input, output and mixed modules, "intelligent" developed; etc.</li> </ul>	
Maximum number of slaves and inputs/outputs	On the same bus, an AS-Interface bus can support a maximum of:  • 31 slaves with standard address settings; each slave can have a maximum of 4 inputs and/or 4 outputs, with addresses from 1 to 31,  • 62 slaves with extended address settings; each slave can have a maximum of 4 inputs and/or 3 outputs, with addresses from 1 A/B to 31A/B.  This makes it possible to manage a maximum of 248 inputs +186 outputs (thus 434 inputs/outputs) when all extended slaves have 4 inputs and 3 outputs.	
Topology and Maximum Length of AS-Interface Bus	The topology of the AS-Interface bus is flexible. It can be perfectly adapted to meet the user's needs (point to point, on line, tree structure etc.). In every case, the total length of all the branches of the bus must not exceed 100 meters (328 ft) without a repeater.	

Specifications	Description
AS-Interface Bus Cycle Time	This is the cycle time between slave(s) and the master module. The AS-Interface system always transmits information, which is the same length to each slave on the bus. The AS-Interface cycle time depends on the number of active slaves connected to the bus.  The scan time t represents the exchange time between a master and n active slaves (a maximum of 31 on /A or /B).  So, for:  up to 19 active slaves, t = 3ms  20 to 31 active slaves t = (1+n) * 0.156ms  When two slaves A and B have the same address, each slave in the pair is scanned every two cycles.  This means that for 31 extended address setting slaves configured in /A, + 31 extended address setting slaves configured in /B. the scan time will be 10 ms.  Maximum cycle time:  maximum 5 ms for 31 standard or extended address setting slaves,  maximum 10 ms for 62 extended address setting slaves.
Reliability, Flexibility	The transmission process used (current modulation and Manchester code) guarantees dependable operation. The master monitors the line supply voltage and the data sent. It detects transmission errors as well as slave failures, and sends the information to the PLC.  The exchange of a slave or connection of a new slave during operations does not disrupt communications with the other slaves.


**Note:** When a faulty slave is replaced, the update of the replacement slave's address can be automatically carried out if the automatic addressing function is allowed on the master module.

**Note:** When there is mixed use of slaves with standard and extended address settings, a standard address setting slave only use an address from 1(A) to 31(A). The same address accompanied by "bank" /B can only be used by an extended address setting slave.

### Parts description of an AS-Interface master module: TWDNOI10M3

### Parts Description

The following diagram shows the different parts of the AS-Interface TWDNOI10M3 master module:



### **Legend** The module is made up of the following elements:

No.	Part	Description		
1	Display	<ul> <li>Status display LEDs: show AS-Interface bus status,</li> <li>I/O LEDs: show the I/O status of a slave specified by the address LEDs</li> <li>Address LEDs: show slave addresses.</li> </ul>		
2	Push Buttons	Allow selection of a slave's address and change of mode.		
3	User terminal	Is connected to the AS-Interface cable.		
4	AS-Interface cable connector	To install the terminal.		
5	Latch button	Holds/releases the module from a controller.		
6	Expansion Connector	Enables connection to the Twido module and connection to another I/O module.		
7	Product Label	Shows the module reference and specification.		

### Technical specifications of the TWDNOI10M3 module and the AS-Interface V2 bus

# AS-Interface V2

Technical specifications:

Specification	Value
Maximum cycle time of AS-Interface bus:	<ul> <li>from 1 to 19 slaves = 3ms,</li> <li>from 20 to 62 slaves = (1+n) x 0.156ms</li> <li>where n = number of active slaves.</li> <li>5 ms for 31 standard or extended address setting slaves,</li> <li>10 ms for 62 extended address setting slaves.</li> </ul>
Maximum number of slaves on the bus:	31 standard address setting slaves or, 62 extended address setting slaves.
Maximum length of AS-Interface bus cables:	all branches without repeater: 100 meters (328 ft) with two repeaters: 300 meters (984 ft)
Maximum number of I/O managed by the bus	standard address setting slaves: 124 inputs + 124 outputs extended address setting slaves: 248 inputs + 186 outputs
Nominal bus supply voltage	30 VDC

### AS-Interface TWDNOI10M3 module

Technical specifications:

Specification	Value
Operating temperature	0 to 55°C (32°F to 131°F) operating ambient temperature
Storage temperature	-25°C to +70°C (-13°F to 158°F)
Relative humidity	from 30 to 95% Rh (non-condensing)
Pollution degree	2 (IEC60664)
Degree of protection	IP20
Corrosion immunity	Free from corrosive gases
Altitude	Operation: from 0 to 2000 m (0 to 6,560 ft) Transport: 0 to 3,000 m (0 to 9,840 ft)

Specification	Value
Resistance to Vibration	When mounted on a DIN rail:
	from 10 to 57 Hz amplitude 0.075 mm, from 57 to 150 Hz
	acceleration 9.8 ms <sup>2</sup> (1G), 2 hours per axis on each of
	three mutually perpendicular axes.
	When mounted on a panel surface:
	from 2 to 25 Hz amplitude 1.6 mm, from 25 to 100 Hz
	acceleration 39.2 ms <sup>2</sup> (4G) Lloyd's 90 min per axis on
	each of three mutually perpendicular axes.
Resistance to Shock	147 ms <sup>2</sup> (15G), 11 ms duration, 3 shocks per axis, on
	three mutually perpendicular axes (IEC 61131).
Allowable voltage range	from 29.5 to 31.6 VDC
Current consumed on the AS-Interface bus	Typically 65 mA / 110 mA maximum
Protection against polarity inversion on bus inputs	Yes
Connector on mother board	MSTB2.5/3-GF-5.08BK (Phoenix contact)
Average number of connector insertions/removals	100 times minimum
Power consumption	At 5 VDC: 80 mA
	At 24 VDC: 0 mA
Power dissipation	540 mW (24 VDC)
Weight	85 g (3 oz)

## **A** CAUTION

### CONNECTION OF OTHER EXPANSION MODULES

- When an AS-Interface module is connected to a Twido module, do not connect
  more than five I/O expansion modules (if Twido can usually accept seven)
  because of the amount of heat that is generated.
- The AS-Interface master module can accept a maximum of seven analog I/O slaves; otherwise the AS-Interface system will not operate correctly.

Failure to follow this instruction can result in injury or equipment damage.

### Wiring and connections

# Different Cable Types

The AS-Interface bus cables carry the signals and provide a 30 VDC power supply to the sensors and actuators connected to this bus.

Types of AS-Interface cables:

Cable type	Specifications	Illustration
Polarized AS-Interface ribbon cable	Jacket color: yellow Wire cross-section: 1.5 mm <sup>2</sup> (AWG 16)	AS-i - AS-i + (Blue) (Brown)
Standard round cable or separated cables	Wire cross-section: - stranded: from 0.5 mm² to 1.0 mm² - solids: from 0.75 mm² to 1.5 mm² (AWG: from 16 to 20)	AS-i - AS-i + (Blue) (Brown)

Procedure for Connecting the AS-Interface Master Module to the Bus

The following table describes the connection procedure:

Steps	Description
1	Remove the terminal from the module bus connector.
2	Respect the polarities of the AS-Interface cable: brown cable for the AS-i+ pole and blue cable for the AS-i- pole. Connect the cable according to the colors shown on the terminal.
3	Connect the AS-Interface ground terminal block to the DIN rail (see diagram).
4	Using a screwdriver, tighten the screws on the terminal between 0.5 to 0.6 N.m (4.4 to 5.3 lbf.in) of torque. The use of end ferrules crimped at the stranded or solid wires terminators will prevent the cable from slipping out of the terminal.
5	Insert the terminal into the module connector on the module. Using a screwdriver, tighten the mounting screws on the terminal between 0.3 to 0.5 N.m (2.6 to 4.4 lbf.in) of torque.



# **▲** CAUTION


### **ELECTRIC SHOCK HAZARD**

Do not touch the cable terminators, including immediately after the module has been switched off.

Failure to follow this instruction can result in injury or equipment damage.

# Illustration of

### Illustration of Connection:

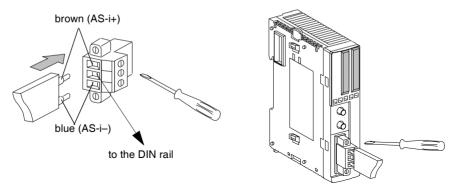

# **A** CAUTION

### **AS-INTERFACE V2 BUS SUPPLY**

Use an AS-Interface SELV (Very Low Safety Voltage) supply, with nominal voltage of 30VDC.

Failure to follow this instruction can result in injury or equipment damage.


### **TWDNOI10M3 Operating Modes and Push Buttons**

### At a Glance

The actions performed using the push buttons PB1 and PB2 on the front panel of the AS-Interface module depend on the length of time for which they are pressed. A "long press" selects the operating mode and a "short press" selects the address of the slave on which you wish to perform diagnostics. If the length for which the buttons are pressed does not correspond to either of those mentioned above or the two buttons are pressed simultaneously, the status of the module remains unchanged.

### Illustration

The following illustration shows the position of the buttons:



# Pressing Buttons

The following table describes the function of the buttons:

Action	Description
Long press	A "long press" is effective when the button is pressed for 3 seconds or more. Use a long press to change the operating mode of the AS-Interface master.
Short press	A "short press" corresponds to pressing the button for not more than 0.5 seconds. Use a short press to change the address of the slave for which you wish to view the I/O status via the LEDs on the AS-Interface master. Pressing PB1 increments the slave address, and PB2 decrements it. When the last address 31B is reached, pressing PB1 returns you to the first address 0A.

### AS-Interface Master Module Operating Modes

As soon as it is powered up, the AS-Interface module goes into online mode. The Twido module can then communicate with the AS-Interface master to allow viewing and checking of the status of each slave. Online mode consists of the three following modes:

### Normal protected mode:

On power up, the AS-Interface master initially goes into this mode if no error occurs. This is the normal operating mode in which the AS-Interface master exchanges communication data with slaves connected to it.

### • Normal protected mode - Offline (software not connected):

To enter this mode from the previous mode, press and hold down ("long press") the push button PB2. The AS-Interface master then stops all communication with slaves allowing you to perform operations such as the initialization of the master module. In this mode, the Twido module cannot display the status of slaves. The OFF LED (See *Display of AS-Interface Master Operating Modes, p. 144*) of the AS-Interface master illuminates to indicate that the module is in Offline mode. To return to the previous mode, press and hold down ('long press") push button PB2 a second time.

### Normal protected mode - Data Exchange Off:

This mode can be entered and exited only by a user program in TwidoSoft. In this mode all forms of communication with slaves is prohibited.


### AS-Interface module TWDNOI10M3 display panel

At a Glance

The AS-Interface master module **TWDNOI10M3** is equipped with a display consisting of status LEDs. input/output LEDs and address LEDs.

Illustration

Illustration of display panel:

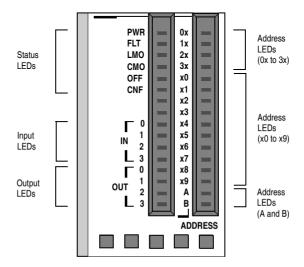

# Display of Module Status

Module status is displayed by the status LEDs on the module which provide information depending on their state (indicator extinguished or illuminated) on the module operating mode.

Status LED descriptions

LED	Status	Description
PWR		Indicates that the AS-Interface module is not powered up.
		Indicates that insufficient power is being delivered to the AS-Interface module.
FLT	•	Indicates that the configuration loaded onto the AS-Interface master is not correct or that an error has occurred on the AS-Interface bus.
		Module OK.
LMO		Indicates that the module is not in offline mode (the module is online from power up).  Note: Flickers on power up.
СМО		Indicates that the module is in online mode.
OFF		Indicates that the module is in offline normal protected mode.
		Indicates that the module is in another operating mode.
CNF		This indicator is no longer used. Note: Flickers on power up.
Extinguished		Illuminated

### Display of AS-Interface Master Operating Modes

The operating modes of the AS-Interface module can be changed using the push buttons or TwidoSoft programming software. The status LEDs also allow you to determine what mode the AS-Interface module is in.

Mode display table

Operating modes	PWR	FLT	LMO	СМО	OFF	CNF
Normal Protected Mode						$\bigcirc$
Normal Protected Mode (Offline)			$\bigcirc$			
Normal Protected Mode (Data Exchange OFF)			$\bigcirc$		$\bigcirc$	$\bigcirc$
Extinguished Illuminated						

# Diagnostics of the AS-Interface Bus

The input/output LEDs and address LEDs can be used to view slaves on the AS-Interface bus and determine their operating status. Diagnostics table:

State of address LEDs	State of IN/ OUT LEDs	Description
•	or •	There is a slave at this address and its inputs/outputs are on and active.
•	•	There is a slave at this address, but an error has occurred.
•	0	No slave is assigned to this address.
		Communication on the AS-Interface bus has been interrupted because no power is being supplied or because the AS-Interface module is offline normal protected mode.
Extinguished		Flashing Illuminated

The slave address is selected using the buttons PB1 and PB2. An address with an assigned slave can be read using the address LEDs as shown in the following example:

If LEDS 2x, x5 and B are illuminated, this indicates that there is a slave assigned to address 25B.

### 2.7 CANopen fieldbus master module

#### At a Glance

#### Introduction

This section provides a review of the CANopen fieldbus, provides a description of the module, and describes the specifications and use of the CANopen master module**TWDNC01M**.

### What's in this Section?

This section contains the following topics:

Торіс	Page
About the CANopen Fieldbus	146
CANopen Fieldbus Topology	147
Cable Length and Transmission Speed	149
Dimensions of the CANopen master module: TWDNCO1M	150
Parts description of a CANopen master module: TWDNCO1M	151
Technical specifications of the TWDNCO1M module and the CANopen fieldbus	152
CANopen Wiring and Connections	154

#### **About the CANopen Fieldbus**

#### Introduction

Originally developed for automotive vehicle borne systems, the CAN communication bus is now used in many areas, such as:

- transport,
- moving part devices,
- medical devices.
- building.
- industrial control.

The advantages of the CAN system are:

- the bus allocation system,
- error detection.
- data exchange reliability.

### Master/slave structure

The CAN bus has a master/slave structure for bus management.

The master manages

- slave initialization,
- · communication errors,
- slave status.

### Peer to peer communication

Communications on the bus are made **peer to peer**; at any moment, each device can send a request on the bus and the relevant devices reply. The priority of the requests circulating on the bus is determined by an identifier at individual message level.

#### **CAN** identifiers

Explicit exchanges of CAN PDUs at link level use extended identifiers over 29 bits (CAN standard V2.0B).

11 bit identifiers (CAN standard V2.0A) can only be used for sending and receiving.

#### **CANopen Fieldbus Topology**

#### At a Glance

The CANopen architecture of a Twido system consists of:


- a Twido PLC (compact base or modular base)<sup>1</sup>,
- a CANopen fieldbus master module (TWDNCO1M module) installed on the Twido PLC's expansion bus<sup>2</sup>,
- CANopen slave devices<sup>3,4</sup>.

#### Note:

- The TWDNCO1M CANopen master module is supported by the following Twido base controllers:
  - Compact bases: TWDLC•A24DRF and TWDLCA•40DRF series
  - All modular bases: TWDLMDA20 •• and TWDLMDA40 •• series
- 2. Only 1 TWDNCO1M CANopen master module can be installed on the Twido system expansion bus.
- 3. The TWDNCO1M CANopen master module can manage up to 16 CAN slave devices on a single bus segment.
- The TWDNCO1M CANopen fieldbus does not support extended addressing for CAN slave devices.

The baud rate of the bus depends on its length and the cable type used (See *Cable Length and Transmission Speed. p. 149*).

Twido CANopen Fieldbus Topology The following figure shows the Twido CANopen fieldbus topology:

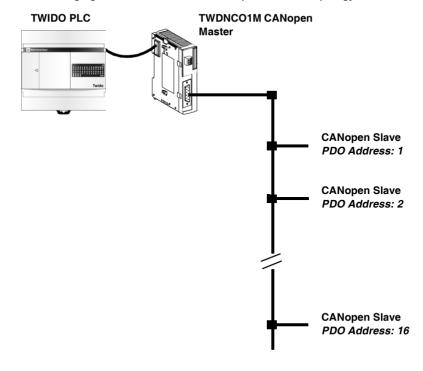

#### **Cable Length and Transmission Speed**

#### At a Glance

The TWDNCO1M CANopen master allows up to 16 slave devices on the bus. Transmission speed depends strictly on the bus length and the type of cable used. The following two tables enable you to evaluate authorized values.

#### Baud Rate versus Cable Length

The following table describes the relationship between the maximum transmission speed and the bus length (on a single CAN segment without repeater).

Maximum transmission baud rate	Bus length
1 Mbit/s	25 m (82 ft)
800 Kbit/s	50 m (164 ft)
500 Kbit/s	100 m (328 ft)
250 Kbit/s	250 m (820 ft)
125 Kbit/s	500 m (1,640 ft)
50 Kbit/s	600 m (1,968 ft)
20 Kbit/s	800 m (2,624 ft)
10 Kbit/s	1,000 m (3,280 ft)

#### Baud Rate and Cable Length versus Cable Impedance and Type


The following table describes the relationship between the maximum transmission speed for a given bus length in relation to the type of cable used (cable gauge and impedance).

Maximum baud rate	Bus length	Cable impedance	Cable section/gauge
1 Mbit/s @ 40 m (131 ft)	0 - 40 m (0 - 131 ft)	70 mΩ/m (21.3 mΩ/ft)	0.25 - 0.34 mm <sup>2</sup> , (e.g. AWG 24, AWG 22)
500 Kbit/s @ 100 m (328 ft)	40 - 300 m (131 - 984 ft)	$< 60 \text{ m}\Omega/\text{m}$ (< 18.3 mΩ/ft)	0.34 - 0.6 mm <sup>2</sup> , (e.g. AWG 22, AWG 20)
125 Kbit/s @ 500 m (1,640 ft)	300 - 600 m (984 - 1,968 ft)	$< 40 \text{ m}\Omega/\text{m}$ (< 12.2 mΩ/ft)	0.5 - 0.6 mm <sup>2</sup> , (e.g. AWG 20)
50 Kbit/s @ 600 m (1,968 ft)	600 - 1000 m (1,968 - 3,280 ft)	< 26 mΩ/m ( $<$ 7.9 mΩ/ft)	0.75 - 0.8 mm <sup>2</sup> , (e.g. AWG 18)

#### Dimensions of the CANopen master module: TWDNCO1M

#### CANopen Master Module Dimensions


The following diagram shows the dimensions of the CANopen Master module TWDNCO1M:

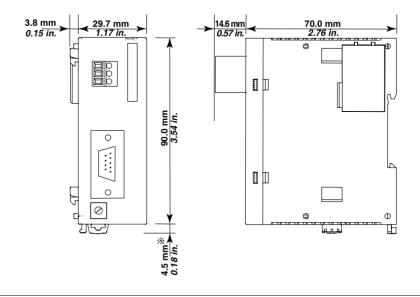

#### Parts description of a CANopen master module: TWDNCO1M

#### Parts Description

The following diagram shows the different parts of the CANopen TWDNCO1M master module:



#### Legend

The module is made up of the following elements:

No.	Part	Description
1	Power supply connector	3-point connector used to connect a 24 VDC power supply.
2	CANopen status LED	Shows the CANopen bus status. (See CANopen Status LED, p. 260.)
3	DSUB (DB9) terminal	To connect the CANopen interface cable.
4	PE ground	Protective earth (PE) ground (M3 screw terminal).
5	Latch button	Holds/releases the module from a controller.
6	Module name	Shows the module reference and specification.
7	Expansion Connector	Enables connection to the Twido module and connection to another I/O module.

#### Technical specifications of the TWDNCO1M module and the CANopen fieldbus

#### CANopen Fieldbus

Technical specifications:

Specification	Value
Maximum number of slaves on the bus	16 CANopen slave devices, not to exceed a total of 16 TPDOs and 16 RPDOs over the CAN bus.
Maximum length of CANopen fieldbus cables	According to the CAN specification (see Cable Length and Transmission Speed, p. 149.)
Maximum number of PDOs managed by the bus	16 TPDOs + 16 RPDOs

#### CANopen TWDNCO1M module

Technical specifications:

Specification	Value
Operating temperature	0 to 55°C (32°F to 131°F) operating ambient temperature
Storage temperature	-40°C to +70°C (-40°F to 158°F)
Relative humidity	from 10 to 95% Rh (non-condensing)
Pollution degree	Housing:3 (IEC60664-1) PCB:2 (IEC60664-1)
Degree of protection	IP20
Corrosion immunity	Free from corrosive gases
Altitude	Operation: from 0 to 2000 m (0 to 6,565 ft) Transport: 0 to 3,000 m (0 to 9,840 ft)
Resistance to Vibration	When mounted on a DIN rail: from 10 to 57 Hz amplitude 0.75 mm, from 57 to 150 Hz acceleration 9.8 ms² (1G), 2 hours per axis on each of three mutually perpendicular axes. When mounted on a panel surface: from 2 to 25 Hz amplitude 1.6 mm, from 25 to 100 Hz acceleration 9.8 ms² (1G) Lloyd's 90 min per axis on each of three mutually perpendicular axes.
Resistance to Shock	147 ms <sup>2</sup> (15G), 11 ms duration, 3 shocks per axis, on three mutually perpendicular axes (IEC 61131).
Allowable voltage range	from 19.2 to 30 VDC
Protection against polarity inversion on bus inputs	Yes
CANopen fieldbus interface connector	D SUB (DB9)

Specification	Value
Power consumption	At 5 VDC: 50 mA (INTERNAL BUS) At 24 VDC: 50 mA (EXTERNAL POWER SUPPLY)
Power dissipation	1.2W (@24 VDC)
Weight	100 g ( 3.5 oz.)
Overall dimensions	29.7mm(W) x 84.6mm(H) x 90mm(D) 1.17in(W) x 3.33in(H) x 3.54in(D)

### **A** CAUTION

#### **CONNECTION OF OTHER EXPANSION MODULES**

- When a CANopen master module is connected to a Twido module, do not connect more than 6 additional I/O expansion modules on the Twido internal bus (not to exceed a maximum of 450 mA of current on the Twido internal bus).
- The CANopen master module can accept a maximum of sixteen CAN slave devices (not to exceed a total of 16 TPDOs and 16 RPDOs over the CAN bus); otherwise the CANopen system will not operate correctly.

Failure to follow this instruction can result in injury or equipment damage.

#### **CANopen Wiring and Connections**

#### Introduction

This sub-section describes how to connect the CANopen power supply and the CANopen bus.

Procedure for Connecting the CANopen Power Supply

The following procedure describes how to connect the 24 VDC power supply to the CANopen power supply terminal

Steps	Description
1	Remove the power supply connector from the CANopen master module.
2	Plug the external power supply leads into the removable connector, observing the correct polarity as indicated by the connection diagram below.
3	Using a screwdriver, tighten the screws on the removable connector to 0.2 N·m (1.77 lbf·in) of torque. The use of end ferrules crimped at the multifilament or solid wires terminators will prevent the cable from slipping out of the terminal.
4	Place the removable connector back onto the CANopen master module.
5	Connect the CANopen protective earth (PE) ground screw terminal to the proper earth ground in your facility.



#### UNINTENDED EQUIPMENT OPERATION

- Do not use the Twido controller's 24VDC sensor power supply to provide +24VDC power to the CANopen module for this will make the photocoupler isolation inoperative.
- Use only dedicated external power supply to provide power to the CANopen module

Failure to follow this instruction can result in death, serious injury, or equipment damage.



#### HAZARD OF ELECTRIC SHOCK

Do not touch the cable terminators, including immediately after the module has been switched off.

Failure to follow this instruction can result in injury or equipment damage.


#### Procedure for Turning On the CANopen Devices

Turn on your equipment connected to the CANopen master module in the following order:

Step	Action
1	Turn on all CANopen slave devices connected to the CANopen master module.
2	Turn on the CANopen master module by applying the specified CANopen power supply. (See <i>Procedure for Connecting the CANopen Power Supply, p. 154</i> ) <b>Note:</b> Allow sufficient time for the CANopen master module to complete its power-up sequence before you proceed to the next step.
3	Turn on the Twido controller connected to the CANopen master module.
Please follow the above power-on sequence to ensure that all equipment present on the CANopen bus are detected correctly by the Twido controller.	


#### Power Supply Connector Pin Assignment

The following figure illustrates the pin assignment for the TwidoPort's CANopen power supply connector:



#### Illustration of Power Supply Connection

Illustration of power supply connection:

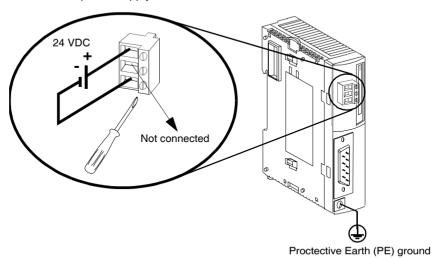

### Proper Grounding


### **A** WARNING

#### HAZARD OF ELECTRIC SHOCK

The grounding screw terminal (PE) must be used to provide protective earth at all times. Make sure that PE is attached before connecting or disconnecting the D-SUB CAN fieldhus cable the device

Failure to follow this instruction can result in death, serious injury, or equipment damage.

The following figure describes the grounding screw terminal (PE):



#### **Ground Cable**


The PE ground must be capable of supporting 30 A of current for 2 minutes and have no more than 100 m $\Omega$  of resistance. The recommended PE wire size is AWG #12 (2.5 mm²). The maximum allowable length of the wire at AWG #12 is less than 2 meters. Use the shortest wire length possible.

#### **PE Ground Screw Terminal**

Using a screwdriver, tighten the screw on the PE ground terminal to a 0.5 N·m (4.4 lbf·in) torque.

# Connection to the CANopen Field Bus

The CANopen field bus connector is located in the lower pane of the master module front-panel:

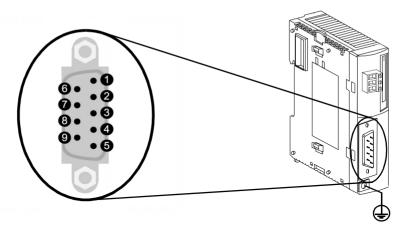

We recommend you use a D-SUB 9-pin female metal connector compliant with standard DIN 41652, or with the corresponding international standard to connect the network field bus cable to the master module. The connection must conform to the following pin assignment:

Contacts	Signal	Description
1	Unused	Reserved
2	CAN_L	CAN-L bus line (low dominant)
3	CAN_GND	CAN earth
4	Unused	Reserved
5	CAN_SHLD	Optional CAN shielding
6	GND	Optional ground
7	CAN_H	CAN-H bus line (high dominant)
8	Unused	Reserved
9	CAN_V+	NC (not connected)

**Note 1:** The contacts pinout corresponds to the legend of the above figure.

Note 2: Reserved contacts will be used in a future specification.

#### CANopen Network Connectors and Cables

The branch cable between the field bus and the master module must have a female connector complying with the above contact assignment diagram. The CANopen network cable is a shielded twisted double-pair cable complying with the CANopen standard CiA DR-303-1. No wire interruption is authorized in the bus cable. This enables the reserved contacts to be used in a future specification.

### 2.8 Communication Options

#### At a Glance

#### Introduction

This section provides an overview, parts description, and specifications of the communication options.

### What's in this Section?

This section contains the following topics:

Topic	Page
Overview of Communication Adapters and Expansion Modules	159
Parts Description of Communication Adapters and Expansion Modules	160
Specifications for Communication Adapters and Expansion Modules	162

#### **Overview of Communication Adapters and Expansion Modules**

#### Introduction

The following section provides an overview of the TWDNAC232D, TWDNAC485D, and TWDNAC485T communication adapters and the TWDNOZ232D, TWDNOZ485D, and TWDNOZ485T communication expansion modules.

#### Overview

All Twido controllers have one RS485 communication serial port 1. Moreover, TWDLC•A16DRF, TWDLC•A24DRF and TWDLCA•40DRF controllers have a serial port 2 connector for an optional second RS485 or RS232 serial port. An optional communication adapter (TWDNAC232D, TWDNAC485D, and TWDNAC485T) is available to install on the serial port 2 connector. Note that the TWDLCAA10DRF series does not have a serial port 2 connector.

In addition, the TWDLCAE40DRF series compact controllers have a built-in RJ-45 Ethernet network communications port.

A communication expansion module (TWDNOZ232D, TWDNOZ485D, and TWDNOZ485T) is available to attach to any Modular controller for an optional second RS485 or RS232 serial port. Also, an operator display expansion module (TWDXCPODM) is available to attach to a Modular controller where an optional communication adapter (TWDNAC232D, TWDNAC485D, and TWDNAC485T) can be installed to the serial port 2 connector on the operator display expansion module.


#### Parts Description of Communication Adapters and Expansion Modules

#### Introduction

The following section describes the parts of the TWDNAC232D, TWDNAC485D, and TWDNAC485T communication adapters and the TWDNOZ32D, TWDNOZ485D, and TWDNOZ485T communication expansion modules.

# Parts Description of a Communication Adapter

The following figure shows the parts of the TWDNAC232D, TWDNAC485D, and TWDNAC485T communication adapters.




#### Legend

Label	Part	Description
1	Serial port 2	Adds an optional second RS485 or RS232 serial port.
2	Connector	Connects to the serial port 2 connector on TWDXCPODM operator display expansion module or TWDLCAA16DRF and TWDLCAA24DRF controllers.

# Parts Description of a Communication Expansion Module

The following figure shows the parts of the TWDNOZ232D, TWDNOZ485D, and TWDNOZ485T communication expansion modules.

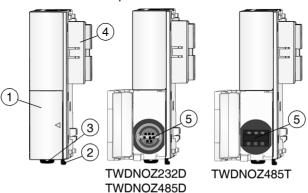

#### Legend

Label	Part	Description
1	Hinged door	Opens to access the serial port 2.
2	Clamp	Secures the module to a DIN rail.
3	Latch button	Holds/releases the module from a controller.
4	Communication connector	Connects to a Modular controller.
5	Serial port 2	Adds an optional second RS485 or RS232 serial port to a Modular controller.

#### **Specifications for Communication Adapters and Expansion Modules**

#### Introduction

This section presents the specifications for the TWDNAC232D, TWDNAC485D, and TWDNAC485T communication adapters and the TWDNOZ232D, TWDNOZ485D, and TWDNOZ485T communication expansion modules.

#### Communication Adapter and Expansion Module Specifications

The following table describes the communication adapter and expansion module specifications.

Reference number	TWDNAC232D TWDNOZ232D	TWDNAC485D TWDNOZ485D	TWDNAC485T TWDNOZ485T
Standards	RS232	RS485	RS485
Maximum baud rate	19,200 bps	PC Link: 19,200 bps Remote Link: 38,400 bps	PC Link: 19,200 bps Remote Link: 38,400 bps
Communication Modbus (RTU master/slave)	Possible	Possible	Possible
ASCII communication	Possible	Possible	Possible
Remote link communication:	Not possible	7 links possible	7 links possible
Maximum cable length	Maximum distance between the base controller and the remote controller: 10 m (32.8 ft)	Maximum distance between the base controller and the remote controller: 200 m (656 ft)	Maximum distance between the base controller and the remote controller: 200 m (656 ft)
Isolation between internal circuit and communication port	Not isolated	Not isolated	Not isolated

### 2.9 Operator Display Options

#### At a Glance

#### Introduction

This section provides an overview, parts description, and specifications of the operator display options.

### What's in this Section?

This section contains the following topics:

Topic	Page
Overview of Operator Display Modules and Expansion Modules	164
Parts Description of Operator Display Module and Expansion Module	165
Specifications for Operator Display Modules and Expansion Modules	167

#### Overview of Operator Display Modules and Expansion Modules

#### Introduction

The following section provides an overview of the TWDXCPODC operator display module and the TWDXCPODM operator display expansion module.

#### Overview

The operator display is an optional module that can be added to any of the controllers. It is installed into a Compact controller as a operator display module (TWDXCPODC) and it is assembled to a Modular controller using the operator display expansion module (TWDXCPODM). See *How to Install the Operator Display Module and Operator Display Expansion Module*, p. 213.

The operator display provides the following services:

- Displays the controller state information
- Allows the user to control the controller
- Allows the user to monitor and tune application data objects

The operator display has two states:

- Display state Displays data
- Edit state Allows the user to change data

#### Parts Description of Operator Display Module and Expansion Module

Introduction

The following section describes the parts of the TWDXCPODC operator display module and the TWDXCPODM operator display expansion module.

Parts
Description of a
Operator Display
Module

The following figure shows the parts of the TWDXCPODC operator display module.




#### Legend

Label	Part	Description
1	Display screen	Shows menus, operands, and data.
2	ESC button	In Edit state - Returns to the previous display state and rejects changes made by the user.
3	Up arrow button	In Edit state - Changes the current edit element to the next value.
4	Right arrow button	In Display state - Advances to the next display state. In Edit state - Advances to the next editing element. The current editing element blinks.
5	MOD/ENTER button	In Display state - Works in MOD function, goes to the corresponding edit state. In Edit state - Works in ENTER function, returns to previous display state and accepts changes made by the user.
6	Operator display connector	Connects to the Compact controller.

Parts
Description of a
Operator Display
Expansion
Module

The following figure shows the parts of the TWDXCPODM operator display expansion module.



#### Legend

Label	Part	Description
1	Display screen	Shows menus, operands, and data.
2	ESC button	In Edit state - Returns to the previous display state and rejects changes made by the user.
3	Up arrow button	In Edit state - Changes the current edit element to the next value.
4	Right arrow button	In Display state - Advances to the next display state. In Edit state - Advances to the next editing element. The current editing element blinks.
5	MOD/ENTER button	In Display state - Works in MOD function, goes to the corresponding edit state. In Edit state - Works in ENTER function, returns to previous display state and accepts changes made by the user.
6	Operator display connector	Connects to a Modular controller.
7	Hinged door	Opens to access the serial port 2.
8	Latch button	Holds/releases the module from a controller.
9	Clamp	Secures the module to a DIN rail.
10	Serial port 2 connector	Connects to the connector on an optional TWDNAC232D, TWDNAC485D, or TWDNAC485T communication adapter.

#### **Specifications for Operator Display Modules and Expansion Modules**

#### Introduction

This section is specifications for the TWDXCPODC operator display module and the TWDXCPODM operator display expansion module.

#### Operator Display Module Specifications

The following table describes the operator display module specifications.

Part Number	TWDXCPODC
Power voltage	5 VDC (supplied from the controller)
Internal current draw	200 mA DC
Weight	20 g (0.7 oz)

#### Operator Display Expansion Module Specifications

The following table describes the operator display expansion module specifications.

Part Number	TWDXCPODM
Weight	78 g (2.75 oz)
Internal current draw	200 mA DC

### 2.10 Options

#### At a Glance

#### Introduction

This section provides an overview and specifications of the options.

### What's in this Section?

This section contains the following topics:

Topic	Page
Overview of the Options	
Specifications for the Options	170

#### **Overview of the Options**

#### Introduction

The following section provides an overview of the TWDXCPMFK32 and TWDXCPMFK64 memory cartridges, the TWDXCPRTC Real Time Clock (RTC) cartridge, and the TWDXSM6, TWDXSM9, and TWDXSM14 input simulators.

#### Overview of the Memory Cartridges

There are two optional memory cartridges, 32 KB (TWDXCPMFK32) and 64 KB (TWDXCPMFK64), available. The memory cartridges provide additional memory for application storage. The memory cartridges are used to:

- Provide a removable backup of the application.
- Load an application into a controller if certain conditions exist.
- Increase the program memory capacity.

The following table presents the available memory cartridge for each controller.

Memory Cartridge	Compact 10 I/O	Compact 16 I/O	Compact 24 I/O	Compact 40 I/O	20 I/O modular	40 I/O modular
TWDXCPMFK32	yes	yes	yes	yes	yes	yes
TWDXCPMFK64	no	no	no	yes	yes	yes

The TWDXCPMFK32 memory cartridge is for back up only. The TWDXCPMFK64 memory cartridge is for back up and expansion.

# Overview of the Real Time Clock (RTC) Cartridge

An optional Real Time Clock cartridge (TWDXCPRTC) is available for all controllers. (Note that 40 I/O compact controllers have RTC onboard.)

The Real Time Clock cartridge provides the controller with the current time and date. The RTC is required for the Schedule Blocks to operate.

When the controller is powered down, the Real Time Clock (RTC) will keep time for 1000 hours at 25 °C (77°F) or 300 hours at 55°C (131°F) when using a fully charged battery.

#### Overview of the Input Simulators

There are three input simulators: 6, 9, and 14 point. These are used only on the three Compact controllers. Used for debugging, you can control the inputs to test your application logic.

#### **Specifications for the Options**

#### Introduction

This section is specifications for the TWDXCPMFK32 and TWDXCPMFK64 memory cartridges and the TWDXCPRTC RTC cartridge.

#### Memory Cartridge Specifications

The following table describes the memory cartridge specifications.

Memory Type	EEPROM
Accessible memory capacity	32 KB: TWDXCPMFK32 64 KB: TWDXCPMFK64
Hardware for storing data	Twido controller
Software for storing data	Twido Soft
Quantity of stored programs	One user program is stored on one memory cartridge.
Program execution priority	When a memory cartridge is installed and enabled, the external user program will be loaded and executed if it differs from the internal program.

#### Real Time Clock Cartridge Specifications

The following table describes the Real Time Clock cartridge specifications.

Accuracy	30 s/month (typical) at 25°C (77°F)
Backup duration	Approximately 30 days (typical) at 25°C (77°F) after backup battery fully charged
Battery	Lithium secondary battery
Charging time	Approximately 10 hours for charging from 0% to 90% of full charge
Replaceable	Not possible

## 2.11 The ConneXium TwidoPort Ethernet Interface Module

#### At a Glance

#### Introduction

This section provides an overview and describes external features and specifications of the 499TWD01100 ConneXium TwidoPort Ethernet interface module.

### What's in this Section?

This section contains the following topics:

Торіс	Page
Overview of the ConneXium TwidoPort Ethernet Interface Module	
TwidoPort's External Features	173
TwidoPort's LED-Panel Description	174
TwidoPort's Wiring	176
General Specifications	

#### Overview of the ConneXium TwidoPort Ethernet Interface Module

#### Introduction

The ConneXium TwidoPort adds Ethernet connectivity to Telemecanique's Twido product line. It is the gateway between a single Twido Modbus/RTU (RS-485) device and the physical layer of Modbus/TCP networks in slave mode.

TwidoPort does not require a separate power supply because it gets power from the Twido controller through its serial port.

This gateway module supports slave mode only.

#### Package Contents

The ConneXium TwidoPort 499TWD01100 package contains:

- One 499TWD01100 TwidoPort module
- One Quick Reference Guide
- One adapter cable (mini-din, RJ-45 male, 50 cm length)


### Product Designation

The 499TWD01100 ConneXium TwidoPort Ethernet interface module will be referred to as **TwidoPort** in the remainder of this document.

#### TwidoPort's External Features

### External Features

The following figure shows the parts of the 499TWD01100 TwidoPort Ethernet interface module.

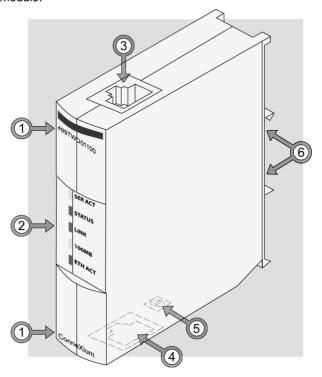

#### Legend


The following table describes the external features of the 499TWD01100 TwidoPort Ethernet interface module.

Feature		Function
1	Model number Model name	499TWD01100 ConneXium
2	LED display	visual indications of TwidoPort's operating status
3	RJ-45 modular jack	power and communications connection to Twido's RS-485 port (over the supplied cable)
4	RJ-45 modular jack	connection to TCP/IP over Ethernet cable (not supplied)
5	PE ground	protective earth (PE) ground (M3 screw terminal)
6	DIN rail connector	for DIN rail mounting

#### **TwidoPort's LED-Panel Description**

#### LED-Panel

The five LEDs implemented in TwidoPort are visual indications of the operating status of the module:

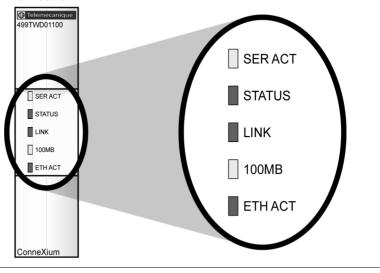

#### Description of the Communication LEDs

This table describes the condition(s), colors, and blink patterns that indicate the operating status of the module:

Label	Meaning	Pattern	Indication(s)
SER ACT	serial active	on	serial activity
(yellow)		off	no serial activity
STATUS	module status	on	normal condition
(green)		off	abnormal condition
		blink: 2	invalid MAC address
		blink: 3	link not connected
		blink: 4	duplicate IP connection
		blink: 5	attempting to get IP condition through BootP
		blink: 6	default IP condition
		blink: 7	kernel mode
LINK	Ethernet link	on	link is active
(green)		off	link is not active
100MB (yellow)	speed	on	100 MB/sec (half duplex only, no full duplex support)
		off	10 MB/sec (full/half duplex)
ETH ACT	Ethernet activity	on	Ethernet is active
(green)		off	Ethernet is not active

**Note:** During the autobaud process, the serial activity LED blinks at a 50Hz rate and appears to be on solid. When the serial activity LED goes off, the autobaud process is complete.

### Using the LED Table

Individual blinks are approximately 200 ms. There is a one-second interval between blink sequences. For example:

- blinking—blinks steadily, alternating between 200 ms on and 200 ms off
- blink 1-blinks once (200 ms), then 1 second off
- blink 2—blinks twice (200 ms on, 200 ms off, 200 ms on), then one second off, etc.


#### TwidoPort's Wiring

#### **Ethernet Wiring**

TwidoPort contains an RJ-45 10/100 Mbps port. The port negotiates speed to the fastest condition that the end device can support.

#### Ethernet Connector Pin Assignment

The following figure illustrates the pin assignment for TwidoPort's Ethernet port:



#### **General Specifications**

#### Environmental

Specification	Specified value
operating temperature	0 to 55 °C (32 °F to 131 °F)
storage temperature	-40 °C to +70 °C (-40 °F to 158 °F)
relative humidity	10 to 95% (non-condensing)
pollution degree	2
degree of protection	IP20
corrosion immunity	free from corrosive gases
altitude	operation: 0 to 2,000 m (0 to 6,565 ft) storage: 0 to 3,040 m (0 to 10,000 ft)
vibration resistance	When mounted on a DIN rail:  10 to 57 Hz: 0.075 mm double amplitude (peak-to-peak) displacement.  57 to 100 Hz: 9.8 m ms2 (1g) constant acceleration.  duration: 10 sweeps at 1 octave/min on each of three mutually perpendicular axes.
shock resistance	147 ms2 (15g), 11 ms duration, 3 shocks per axis, on three mutually perpendicular axes (IEC 61131-2)
weight	< 200g (7 oz)

#### **Electrical**

Specification	Specified value
max. current draw	180 mA @ 5 VDC
supply voltage	5 +/- 0.5 VDC

#### Agency Certification

Specification					
UL 508, UL 1604 hazardous class 1, Div. 2, groups A, B, C, D					
CSA C22.2 No. 142					
CSA C22.2 No. 213 hazardous class 1, Div. 2, groups A, B, C, D					
CE	EN 61131-2				
	EN 55011 (class A)				
(IEC 61000-4-2)	4KV contact				
Electrostatic Discharge (ESD)	4KV air				
(IEC 61000-4-3) RFI Immunity (RS)	80 MHz to 2.0 GHz 10V/m, 1 KHz 80% AM				
(IEC 61000-4-4) Fast Transients (EFT)	communications ports/cables +/- 1KV				
(IEC 61000-4-5)	1.2 x 50 μs				
surge withstand capability (transients)	shielded communications cable 1KVCM $2\Omega$				
EN61000-4-6	3Vrms 150KHz to 80 MHz, 1 KHz 80% AM				
flammability	connector: UL 94V-0				
	enclosure: UL 94V-0				
Note: This product complies with the requirements of EN 61132-3: 2003.					

### 2.12 Telefast® Pre-Wired Systems for Twido

#### At a Glance

#### Introduction

This section provides an overview, specifications and base wiring schematics of the Telefast<sup>®</sup> pre-wired systems for Twido.

### What's in this Section?

This section contains the following topics:

Topic	Page
Overview of the Telefast® Pre-Wired System for Twido	180
Specifications for the Telefast® Bases	183
Telefast® Bases Wiring Schematics	185

### Overview of the Telefast® Pre-Wired System for Twido

#### Introduction

The following section provides an overview of the ABE 7B20MPN20, ABE 7B20MPN22, ABE 7B20MRM20, ABE 7E16EPN20, ABE 7E16SPN20, ABE 7E16SPN22 and ABE 7E16SRM20 Telefast<sup>®</sup> pre-wired systems for Twido.

# Illustration The following illustration shows the Telefast® system for Twido:

#### Legend

Telefast system parts shown in the previous illustration are listed below:

- 1. Modular base controller with 26-way HE 10 connectors. The modular sizes available are 20 or 40 I/O.
- 2. Input and output modules with 20-way HE 10 connectors. The modular sizes available are 16 or 32 I/O.
- 3. Cable (ABF T26B••0) equipped with a 26-way HE 10 connector at each end. This cable is available in 0.5, 1 and 2 meter lengths (AWG 28/0.08 mm<sup>2</sup>).
- **4.** Cable (ABF T20E••0) equipped with a 20-way HE 10 connector at each end. This cable is available in 0.5. 1, 2 and 3 meter lengths (AWG 28/0.08 mm<sup>2</sup>).
- 5. 20 channel sub-base (ABE 7B20MPN2• or ABE 7B20MR20) for modular base controllers.
- **6.** 16 channel sub-base (ABE 7E16SPN22 or ABE 7E16SRM20) for output extension modules.
- 7. 16 channel sub-base (ABE 7E16EPN20 or ABE 7E16SPN20) for input or output extension modules.

### Compatibility Table

The following table describes compatibility between Twido (modular bases and I/O modules) and Telefast® components (bases and cables):

	Modular base controllers	Discrete I/O modules	
	Inputs/outputs	Inputs	Outputs
Incorporated in Twido programmable controllers	TWD LMDA 20DTK (12 I/8 O) TWD LMDA 40DTK (24 I/16 O)	TWD DDI 16DK (16 I) TWD DDI 32DK (32 I)	TWD DDO 16TK (16 O) TWD DDO 32TK (32 O)
Terminal block types	HE 10 connector, 26-way	HE 10 connector, 20-wa	ay
Connection to Twido programmable controller	<b>ABF T26B••0</b> (HE 10, 26-way)	<b>ABF T20E••0</b> (HE 10, 2	(0-way)

#### Passive connection sub-bases

20 channels	ABE 7B20MPN2•	Yes		
16 channels	ABE 7E16EPN20		Yes	
	ABE 7E16SPN2•			Yes

#### Output adapter bases

20 channel	ABE 7B20MRM20	Yes	
16 channels	ABE 7E16SRM20		Yes

#### Specifications for the Telefast® Bases

#### Introduction

This section provides specifications for the Telefast<sup>®</sup> bases.

See Catalog 8501CT9801, "Advantys, TeleFast<sup>®</sup> pre-wired system for Twido" for

more specifications on these Telefast® bases.

#### Supply Specifications (controller side)

The following table provides supply specifications on the Telefast<sup>®</sup> bases at controller side:

Supply voltage	Conforming to IEC 61131-2	V DC	1930 (Un = 24)
Maximum supply current per sub-base		A	2
Voltage drop on supply for	use	V DC	0.3
Supply overload and short-circuit protection by quick-blow fuse (include	d)	A	2

#### Control Circuit Specifications (sensor/ controller side)

The following table provides specifications on the Telefast® bases control circuit (per channel) at sensor/controller side:

Sub-base type			Passive connection sub-bases for discrete signals			Connection sub-bases with soldered relays	
	ABE 7	Unit	B20MPN2•	E16EPN20	E16SPN2•	B20MRM20	E16SRM20
Number of channels	Passive input		12	16	-	12	-
	Passive output		8	-	16	-	-
	Solid state output		-	-	-	2	-
	Relay output		-	-	-	6	16
Rated voltage Ue		V DC	24				
Min/max voltage	Conforming to IEC 61131-2	V DC	20.4/26.4		20.4/28.8	19/30	
Internal current per channel at Ue Passive input		mA	- (3.2 for ABE 7 B20MPN22)				
	Passive output	mA	- (3.2 for ABE 7 B20MPN22)	-	(3.2 for ABE 7 E16SPN22)	-	
	Solid state output	mA	-	•		4.5	_
	Relay output	mA	-			9	
State 1 guaranteed	Solid state output	V/mA	-			16/5.5	_
	Relay output	٧	-			16.8	
State 0 guaranteed	Solid state output	V/mA	-			10/0.4	_
	Relay output	٧	-			2	*
Conformity	Conforming to IEC 61131-2		Type 1	Type 1	-	Type 1	-

#### Output Circuit Specifications (preactuator side)

The following table provides specifications on the Telefast  $^{\! (\! ^{R}\! )}$  bases output circuit (per channel) at preactuator side:

Sub-base type				Passive connect for discrete sign			Connection sub-bases with soldered relays	
		ABE 7	Unit	B20MPN2•	E16EPN20	E16SPN2•	B20MRM20	E16SRM20
Number of char	nnels	Passive output		8	_	16	_	-
		Solid state output		-	-	-	2	-
		Relay output		-	-	-	6	16
Contact arrange	ement			-			1 N/O relay	
Rated voltage a	t Ue	Passive output	V DC	24			-	
		Solid state output	V DC	_		24	-	
		Relay output	V DC	_			530	
i			V AC	_	-			
Current switche	ed per I/O channel	Passive input/output	mA	15/300	15/-	-/100	15/-	-
		Solid state output	Α	-		2	-	
		Relay output	Α	-		3		
Maximum curre	ent per common	Passive output	Α	2	-	1.6	-	
		Solid state output	Α	-		4	-	
		Relay output	Α	-			10	5
	nal current (60 °C	DC 12	Α	-		2/3	-/3	
max)		DC 13	Α	-			2/0.5	-/0.5
(for 500 000 ope	rations)	AC 12, relay	Α	_			2	
Ì		AC 15, relay	Α	-			0.4	
Minimum curre	nt		mA	-		1/100	-/100	
Rated insulation	n voltage		٧	Not isolated			300	
Maximum	From state 0 to	Solid state output	ms	-		0.01	-	
response time	state 1	Relay output	ms	-		5	5	
	From state 1 to	Solid state output	ms	-			0.4	-
state 0		Relay output	ms	_			2.5	2.5
Channel fuse protection			mA	- (315 for ABE 7 B20MPN22)	-	- (125 for ABE 7 E16SPN22)	-	

#### Telefast® Bases Wiring Schematics

#### Introduction

This section provides wiring schematics for the Telefast® bases.




#### INTERNAL FUSE MAY NOT DEACTIVATE OUTPUTS

When multiple ABE7 modules are connected to a single PLC output source, module outputs may remain active after an internal fuse is removed or blown. To deactivate module outputs or to service the equipement, halt the PLC, disconnect all power and disconnect the HE10.

Failure to follow this instruction can result in death, serious injury, or equipment damage.

#### ABE7B20MPN20

The following diagram provides specifications for the ABE7B20MPN20 Telefast<sup>®</sup> base wiring.

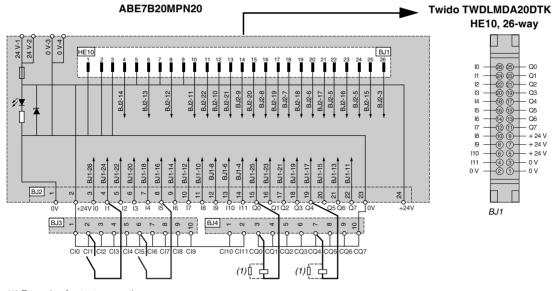


(1) Example of output connections.

When connecting an inductive load, include a diode or a varistor.

#### ABE7B20MPN22

The following diagram provides specifications for the ABE7B20MPN22 Telefast<sup>®</sup> base wiring.

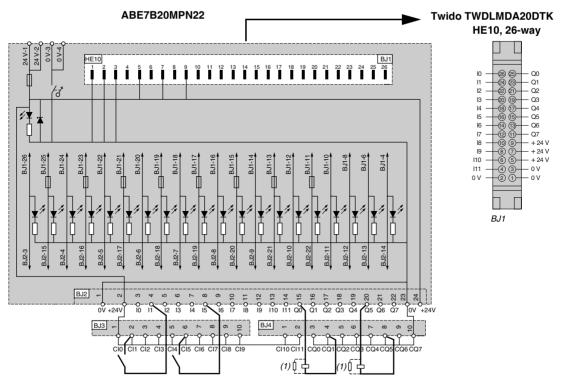


(1) Example of output connections.

When connecting an inductive load, include a diode or a varistor.

#### ABE7B20MRM20

The following diagram provides specifications for the ABE7B20MRM20 Telefast® base wiring.

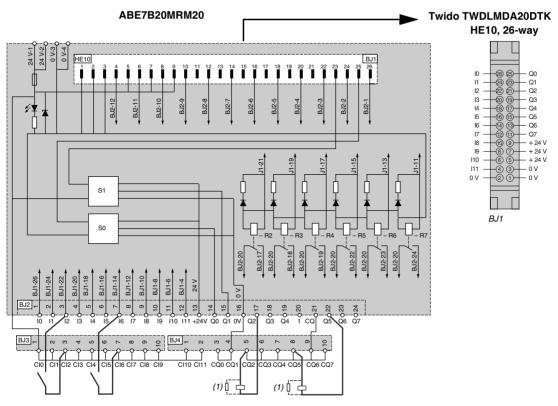


(1) Example of output connections.

When connecting an inductive load, include a diode or a varistor.

#### ABF7F16FPN20

The following diagram provides specifications for the ABE7E16EPN20 Telefast<sup>®</sup> base wiring.

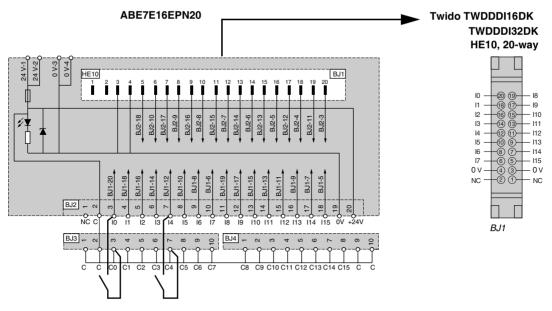


(1) Example of output connections.

When connecting an inductive load, include a diode or a varistor.

#### ABE7E16SPN20

The following diagram provides specifications for the ABE7E16SPN20 Telefast<sup>®</sup> base wiring.

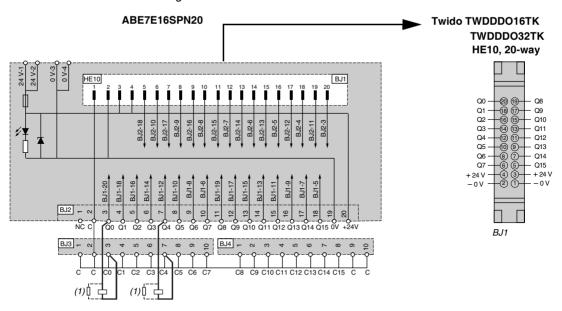


(1) Example of output connections.

When connecting an inductive load, include a diode or a varistor.

#### ABE7E16SPN22

The following diagram provides specifications for the ABE7E16SPN22 Telefast<sup>®</sup> base wiring.

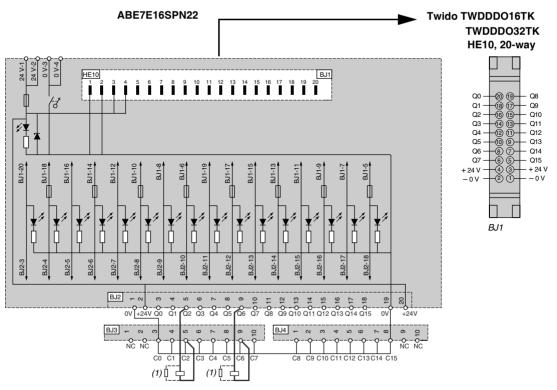


#### (1) Example of output connections.

When connecting an inductive load, include a diode or a varistor.

#### ABE7E16SRM20

The following diagram provides specifications for the ABE7E16SRM20 Telefast<sup>®</sup> base wiring.

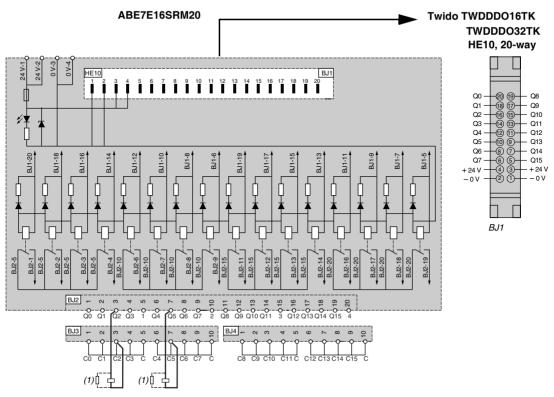

(1) Example of output connections.

When connecting an inductive load, include a diode or a varistor.

#### At a Glance

#### Introduction

This chapter provides dimensions, installation, and mounting instructions for the controllers, digital and analog expansion I/O modules, and options.

# What's in this Chapter?

This chapter contains the following topics:

Торіс	Page
Dimensions of the Compact Controllers	195
Dimensions for the Modular Controllers	197
Dimensions for the Digital and Analog I/O Modules	199
Dimensions of AS-Interface V2 bus master module: TWDNOI10M3	202
Dimensions for the Operator Display Module, Operator Display Expansion Module, and Communication Expansion Modules	203
Dimensions of the Telefast <sup>®</sup> Bases	205
Installation Preparation	206
Controller, Expansion I/O Module, AS-Interface Bus Master Module and CANopen Fieldbus Master Module Mounting Positions	207
Assembling an expansion I/O, an AS-Interface bus master module or a CANopen fieldbus master module to a controller	209
Disassembling an Expansion I/O, an AS-Interface Bus Master Module or a CANopen Fieldbus Master Module from a Controller.	211
How to Install the Operator Display Module and Operator Display Expansion Module	213
Installing a Communication Adapter and an Expansion Module	217
How to Install the TwidoPort Ethernet Interface Module	221
How to Install a Memory or RTC Cartridge	224
Removing a Terminal Block	226
How to Install and Remove a Controller, an Expansion I/O Module, an AS- Interface Bus Interface Module or a CANopen Fieldbus Master Module from a DIN Rail	227
How to Direct Mount on a Panel Surface	230
Minimum Clearances for Controllers and Expansion I/O Modules in a Control Panel	236
How to Connect the Power Supply	238
How to Install and Replace an External Battery	241

#### **Dimensions of the Compact Controllers**


#### Introduction

The following section shows the dimensions for all Compact controllers.

# TWDLC•A10-DRF and TWDLC•A16-DRF

The following diagrams show the dimensions for the TWDLC•A10DRF and TWDLC•A16DRF series Compact controllers.


Illustration showing TWDLC•A10DRF series controller:

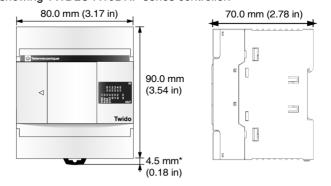

Note: \* 8.5 mm (0.33 in) when the clamp is pulled out.


#### TWDLC•A24-DRF

The following diagrams show the dimensions for the TWDLC•A24DRF series Compact controller.

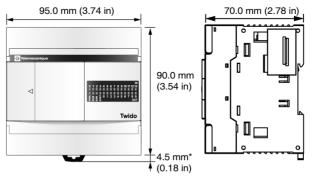

Note: \* 8.5 mm (0.33 in) when the clamp is pulled out.

# **TWDLCA•40-DRF** The following diagrams show the dimensions for the TWDLCA•40DRF series Compact controller.

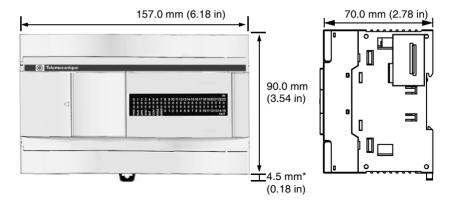

Note: \* 8.5 mm (0.33 in) when the clamp is pulled out.


#### **Dimensions for the Modular Controllers**

#### Introduction

The following section shows the dimensions for all Modular controllers.


#### TWDLMDA20-DRT Dimensions

The following diagrams show the dimensions for the TWDLMDA20DRT Modular controller.

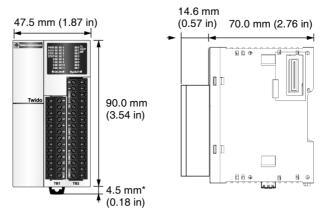


Note: \* 8.5 mm (0.33 in) when the clamp is pulled out.

TWDLMDA20-DUK and TWDLMDA20-DTK Dimensions The following diagrams show the dimensions for the TWDLMDA20DUK and TWDLMDA20DTK Modular controllers

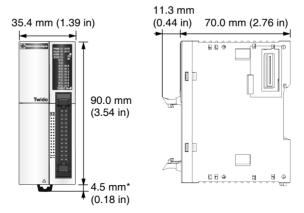

Note: \* 8.5 mm (0.33 in) when the clamp is pulled out.

TWDLMDA40-DUK and TWDLMDA40-DTK Dimensions The following diagrams show the dimensions for the TWDLMDA40DUK and TWDLMDA40DTK Modular controllers.

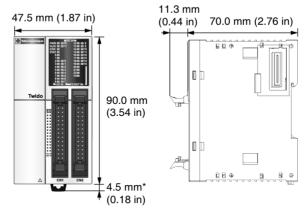

Note: \* 8.5 mm (0.33 in) when the clamp is pulled out.


#### Dimensions for the Digital and Analog I/O Modules

#### Introduction

The following section shows the dimensions for all digital and analog I/O modules.

Digital I/O Modules (8 In and/or Out) and Analog Modules The following diagrams show the dimensions for the 8 inputs and/or outputs digital modules: TWDDDI8DT, TWDDAI8DT, TWDDRA8RT, TWDDDO8TT, TWDDDO8UT, TWDDMM8DRT and for all the analog I/O modules.


Illustrations showing a TWDDDI8DT or a TWDDAI8DT module:

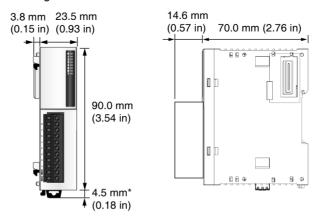

Note: \* 8.5 mm (0.33 in) when the clamp is pulled out.

Digital I/O Modules (16 In or Out with a Terminal Block) The following diagrams show the dimensions for the TWDDDI16DT and TWDDRA16RT digital I/O modules.


Illustrations showing a TWDDDI16DT module:

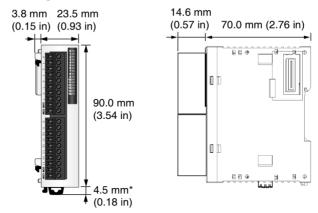

Note: \* 8.5 mm (0.33 in) when the clamp is pulled out.


#### Digital I/O Module (16 In and 8 Out)

The following diagrams show the dimensions for the TWDDMM24DRF digital I/O module.

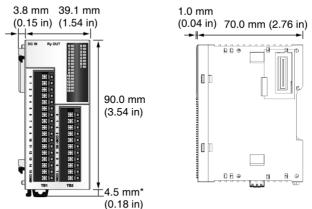

Note: \* 8.5 mm (0.33 in) when the clamp is pulled out.


Digital I/O Modules (16 In or Out with a Connector) The following diagrams show the dimensions for the TWDDDI16DK, TWDDDO16TK, and TWDDDO16UK digital I/O modules. Illustrations showing a TWDDDI16DK module:

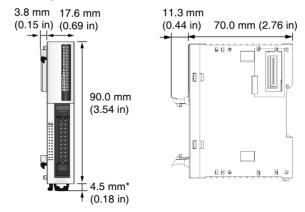

Note: \* 8.5 mm (0.33 in) when the clamp is pulled out.

#### Digital I/O Modules (32 In or Out)

The following diagrams show the dimensions for the TWDDDI32DK, TWDDDO32TK, and TWDDDO32UK digital I/O modules. Illustrations showing a TWDDDI32DK module:

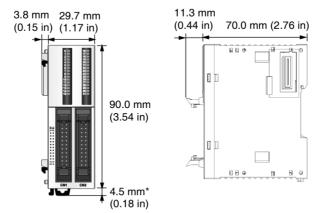


Note: \* 8.5 mm (0.33 in) when the clamp is pulled out.

#### Dimensions of AS-Interface V2 bus master module: TWDNOI10M3

#### AS-Interface Master Module Dimensions

The following diagram shows the dimensions of the AS-Interface Master module TWDNOI10M3:

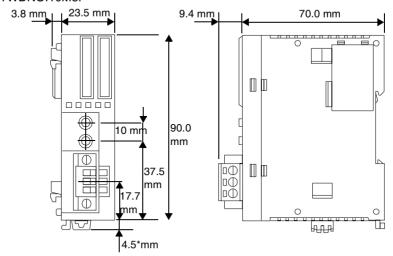

Note: \* 8.5 mm (0.33 in) when the clamp is pulled out.

# Dimensions for the Operator Display Module, Operator Display Expansion Module, and Communication Expansion Modules

#### Introduction

The following section shows the dimensions for the operator display module (TWDXCPODC), operator display expansion module (TWDXCPODM), and for all communication expansion modules (TWDNOZ232D, TWDNOZ485T, and TWDNOZ485D).


#### Operator Display Module Dimensions

The following diagram shows the dimensions for the operator display module (TWDXCPODC).




#### Operator Display Expansion Module Dimensions

The following diagram shows the dimensions for the operator display expansion module (TWDXCPODM).



Note: \* 8.5 mm (0.33 in) when the clamp is pulled out.

Communication Expansion Module Dimensions The following diagram shows the dimensions for all communication expansion modules (TWDNOZ32D, TWDNOZ485T, and TWDNOZ485D). Illustration of the TWDNOZ485T module:



Note: \* 8.5 mm (0.33 in) when the clamp is pulled out.

#### Dimensions of the Telefast® Bases


#### Introduction

The following section shows the dimensions for the Telefast<sup>®</sup> bases.


ABE7B20MPN20 ABE7B20MPN22 ABE7B20MRM20 ABE7E16SPN22 ABE7E16SRM20 The following diagrams show the dimensions for the ABE7B20MPN20, ABE7B20MPN22, ABE7B20MRM20, ABE7E16SPN22 and ABE7E16SRM20 Telefast<sup>®</sup> bases

#### Mounting on 35 mm ☐ rail

# 62.5 mm 2.46 in 2.66 in



#### Screw fixing (retractable lugs)





(1) ABE 7BV20, ABE 7BV20TB

#### ABE7E16EPN20 ABE7E16SPN20

The following diagrams show the dimensions the dimensions for the ABE7E16EPN20 and ABE7E16SPN20 Telefast<sup>®</sup> bases.

#### Mounting on 35 mm ☐ rail





(1) ABE 7BV20, ABE 7BV20TB

#### Installation Preparation

#### Introduction

The following section provides information on preparation for all Twido controllers, expansion I/O modules, AS-Interface bus and CANopen fieldbus interface modules.

#### **Before Starting**

Before installing any of the Twido products read the Safety Information at the begging of this book.



#### **FQUIPMENT DAMAGE**

Before adding/removing any module or adapter, turn off the power to the controller. Otherwise, the module, adapter, or controller may be damaged, or the controller may not operate correctly.

Failure to follow this instruction can result in injury or equipment damage.

**Note:** All options, expansion I/O, AS-Interface bus and CANopen fieldbus interface modules should be assembled before installing a Twido system on a DIN rail, onto a mounting plate, or in a control panel. The Twido system should be removed from a DIN rail, a mounting plate, or a control panel before disassembling the modules.

# Controller, Expansion I/O Module, AS-Interface Bus Master Module and CANopen Fieldbus Master Module Mounting Positions


#### Introduction

This section shows the correct and incorrect mounting positions for all controllers, expansion I/O modules, AS-Interface bus master modules and CANopen fieldbus master module


**Note:** Keep adequate spacing for proper ventilation and to maintain an ambient temperature between 0°C (32°F) and 55°C (131°F).

Correct
Mounting
Position for all
Controllers,
Expansion I/O
Modules, ASInterface Bus
Master Modules
and CANopen
Fieldbus Master
Module

Controllers, expansion I/O modules, AS-Interface bus and CANopen fieldbus interface modules must be mounted horizontally on a vertical plane as shown in the figures below.

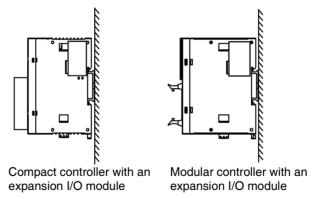


Correct and Incorrect Mounting Positions for the Compact Controller A Compact controller should only be positioned as shown in "Correct Mounting Position for all Controllers, Expansion I/O Modules, AS-Interface Bus Master Modules and CANopen Fieldbus Master Module" figure. When the ambient temperature is 35°C (95°F) or below, the Compact controller can also be mounted upright on a horizontal plane as shown in (1). When the ambient temperature is 40°C (113°F) or below, the Compact controller can also be mounted sideways on a vertical place as shown in figure (2). Figure (3) shows an incorrect mounting position.

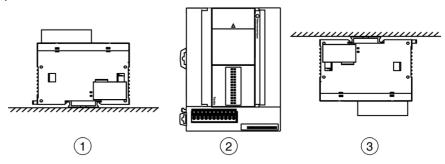

Incorrect
Mounting
Positions for the
Modular
Controllers

A Modular controller should only be positioned as shown in "Correct Mounting Position for all Controllers, Expansion I/O Modules, AS-Interface Bus Master Modules and CANopen Fieldbus Master Module" figure. The figures below show the incorrect mounting positions for all Modular controllers.



#### **▲** CAUTION

#### PLACING HEAT GENERATING DEVICES NEAR THE CONTROLLER SYSTEM

Do not place heat generating devices such as transformers and power supplies underneath the controllers or expansion I/O modules.

Failure to follow this instruction can result in injury or equipment damage.

# Assembling an expansion I/O, an AS-Interface bus master module or a CANopen fieldbus master module to a controller

#### Introduction

This section shows how to assemble an expansion I/O, an AS-Interface bus master module or a CANopen fieldbus master module to a controller. This procedure is for both Compact and Modular controllers. Your controller, expansion I/O module, or AS-Interface bus master module may differ from the illustrations in this procedure.



#### UNEXPECTED FOUIPMENT OPERATION

- If you change the hardware configuration of the I/O expansion bus, AS-Interface bus master module or CANopen fieldbus master module and do not update the software to reflect that change, the expansion bus will no longer operate.
- Be advised that the local base inputs and outputs will continue to operate.

Failure to follow this instruction can result in injury or equipment damage.

Assembling an Expansion I/O, an AS-Interface Bus Master Module or a CANopen Fieldbus Master Module to a Controller.

The following procedure shows how to assemble a controller and an expansion I/O, an AS-Interface bus master module or a CANopen fieldbus master module together.

Step	Action
1	Remove the expansion connector cover from the controller.
2	Make sure the black latch button on the I/O, AS-Interface or CANopen module is in the up position.
3	Align the connector on the left side of the Expansion I/O module, the AS-Interface master module or the CANopen fieldbus master module with the connector on the right side of the controller.
4	Press the expansion I/O, the AS-Interface bus master module or the CANopen fieldbus master module to the controller until it "clicks" into place.
5	Push down the black latch button on the top of the expansion I/O, the AS-Interface bus master module or the CANopen fieldbus master moduleto lock the module to the controller.

# Disassembling an Expansion I/O, an AS-Interface Bus Master Module or a CANopen Fieldbus Master Module from a Controller.

#### Introduction

This section shows how to disassemble an expansion I/O, an AS-Interface bus master module or a CANopen fieldbus master module from a controller. This procedure is for both Compact and Modular controllers. Your controller, expansion I/O module, AS-Interface bus master module or CANopen fieldbus master module may differ from the illustrations in these procedures but the basic mechanism procedures are still applicable.

Disassembling an Expansion I/O, an AS-Interface Bus Master Module or a CANopen Fieldbus Master Module from a Controller. The following procedure shows how to disassemble an expansion I/O, an AS-Interface bus master module or a CANopen fieldbus master module from a controller.


Step	Action
1	Remove the assembled controller and module from the DIN rail before disassembling them. See <i>How to Install and Remove a Controller, an Expansion I/O Module, an AS-Interface Bus Interface Module or a CANopen Fieldbus Master Module from a DIN Rail, p. 227.</i>
2	Push up the black latch from the bottom of the expansion I/O module, the AS-Interface bus master module or the CANopen fieldbus master module to disengage it from the controller.
3	Pull apart the controller and module.


# How to Install the Operator Display Module and Operator Display Expansion Module

#### Introduction

This section describes installation of the operator display module TWDXCPODC, as well as installation and removal of the operator display expansion module TWDXCPODM.

Installing the Operator Display Module into a Compact Controller The following procedure shows how to install the TWDXCPODC operator display module into a Compact controller.

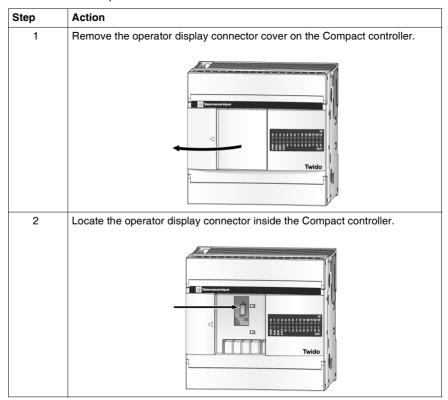

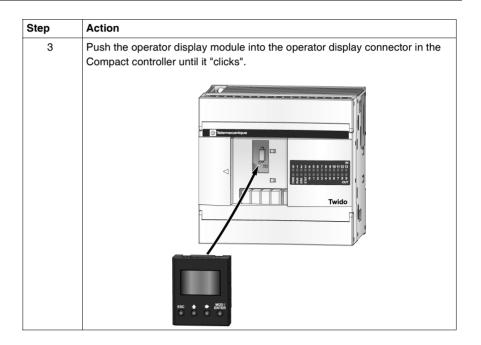

Assembling the Operator Display Expansion Module to a Modular Controller The following procedure shows how to assemble the TWDXCPODM operator display expansion module to a Modular controller.

Step	Action
1	Remove the communication connector cover on the left side of the Modular controller.
2	Make sure the black latch button on the operator display expansion module is in the up position.
3	Align the connector opening on the left side of the Modular controller to the connector on the right side of the operator display expansion module.
	Twido and the second se
4	Press the operator display expansion module to the Modular controller until it "clicks" into place.
5	Push down the black latch button on the top of the operator display expansion module to lock the module to the Modular controller.

Disassembling an Operator Display Expansion Module from a Modular Controller To remove the TWDXCPODM operator display expansion module from a Modular controller, see *Disassembling an Expansion I/O, an AS-Interface Bus Master Module or a CANopen Fieldbus Master Module from a Controller., p. 211.* 

#### Installing a Communication Adapter and an Expansion Module

#### Introduction

This section shows how to install the TWDNAC232D, TWDNAC485D, or TWDNAC485T communication adapter into a Compact controller's port 2 and in a TWDXCPODM operator display expansion module. This section also shows how to assemble and disassemble the TWDNOZ232D, TWDNOZ485D, and TWDNOZ485T communication expansion module to a Modular controller. Your controller may differ from the illustrations in these procedures but the basic mechanism procedures are applicable.

Installing the Communication Adapter into a Compact Controller's Port 2 The following procedure shows how to install the TWDNAC232D, TWDNAC485D, or TWDNAC485T communication adapter into a Compact controller's port 2.

Step	Action	
1	Open the hinged lid.	
2	Remove the cartridge cover located on the bottom of the Compact controller.	
3	Push the communication adapter's connector into the Compact controller's port 2 connector until it "clicks".	
	Or	
4	Look in the opening at the bottom of the Compact controller where the cartridge cover resided and make sure the communication adapter's connector is seated in the Compact controller's port 2 connector. Adjust the adapter if it is not seated correctly.	
5	Attach the cartridge cover.	

Installing a Communication Adapter in the Operator Display Expansion Module The following procedure shows how to install the TWDNAC232D, TWDNAC485D, or TWDNAC485T communication adapter in a TWDXCPODM operator display expansion module.

Step	Action
1	Open the hinged lid.
2	Push the communication adapter's connector into the operator display expansion module's connector until it "clicks".
3	Close the hinged lid.

Assembling a
Communication
Expansion
Module to a
Modular
Controller

The following procedure shows how to assemble the TWDNOZ485D, TWDNOZ232D, or TWDNOZ485T communication expansion module to a Modular controller.

Step	Action	
1	Remove the communication connector cover on the left side of the Modular controller.	
2	Make sure the black latch button on the communication expansion module is in the up position.	
3	Align the connector opening on the left side of the Modular controller to the connector on the right side of the communication expansion module.	
4	Press the communication expansion module to the Modular controller until it "clicks" into place.	
5	Push down the black latch button on the top of the communication expansion module to lock the module to the Modular controller.	

Disassembling a Communication Expansion Module from a Modular Controller To disassemble a communication expansion module from a Modular controller, see Disassembling an Expansion I/O, an AS-Interface Bus Master Module or a CANopen Fieldbus Master Module from a Controller., p. 211.

#### How to Install the TwidoPort Ethernet Interface Module

#### Introduction

This section shows how to install the TwidoPort Ethernet interface module and connect it to a Twido controller.

#### Foreword

The equipment is delivered in ready-to-operate condition. The following procedure is appropriate for installation.

# Proper Grounding



#### **RISK OF ELECTRIC SHOCK**

The grounding screw terminal (PE) must be used to provide protective earth at all times. Make sure that PE is attached before connecting or disconnecting any Ethernet shielded cables to the device.

Failure to follow this instruction can result in death, serious injury, or equipment damage.

#### **Ground Cable**

The PE ground must be capable of supporting 30 A of current for 2 minutes and have no more than 50 m $\Omega$  of resistance. The recommended PE wire size is AWG #12 (3.2 mm $^2$ ) through #18 (0.87 mm $^2$ ). The maximum allowable length of the wire at AWG # 8 is less than 2 meters (6.56 ft).

The TwidoPortto-Twido Controller Connecting Cable The supplied TwidoPort-to-Twido cable is 50 cm (1.64 ft) long. It has a mini-din connector at one end and a modular plug at the other:



#### Mounting Instructions


Usually, TwidoPort is mounted on a DIN rail or a panel with the Twido panel mount kit (TWDXMT5).

**Note:** Before installing a TwidoPort module, read the Safety Information at the beginning of this guide as well as the instructions for Proper Grounding (See *Proper Grounding, p. 221*) in this section.

To connect TwidoPort to the DIN rail, take the following steps (as shown in the diagram below):


Step	Action	Comment
1	Attach the hinges on the back of TwidoPort to the DIN rail, then press down to align TwidoPort vertically with the rail.	Make sure the DIN rail latch is pulled down to the open position.
2	Lock TwidoPort to the DIN rail.	Push up the plastic DIN rail clip on the bottom.

The following figure shows TwidoPort being mounted on a DIN rail:

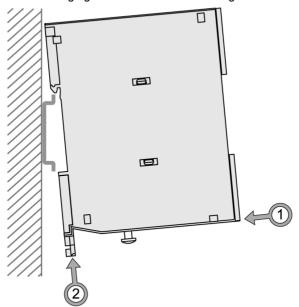

#### TwidoPort Dimensions

The following diagram shows the dimensions of TwidoPort:

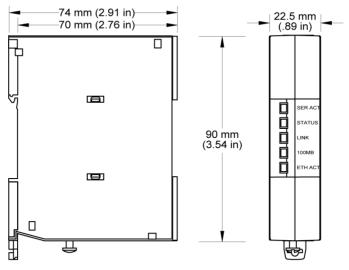

#### How to Install a Memory or RTC Cartridge

#### Introduction

This section shows how to install the TWDXCPMFK32 memory cartridge in a Compact controller, the TWDXCPMFK32 or TWDXCPMFK64 memory cartridge in a Modular controller, and the TWDXCPRTC RTC cartridge in a Compact controller and Modular controller.

#### Installing a Cartridge in a Compact Controller


The following procedure shows how to install the TWDXCPMFK32 memory or the TWDXCPRTC RTC cartridge in a Compact controller. Only one of these cartridges can be installed in the Compact controller.



#### **EQUIPMENT DAMAGE**

When handling the cartridges, do not touch the pins. The cartridge's electrical elements are sensitive to static electricity. Use proper ESD procedures when handling a cartridge.

Failure to follow this instruction can result in injury or equipment damage.

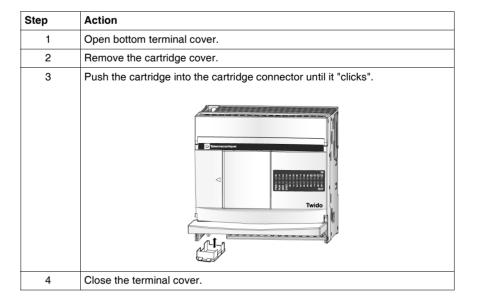

#### Installing a Cartridge in a Modular Controller

The following procedure shows how to install the TWDXCPMFK32 or TWDXCPMFK64 memory cartridge or the TWDXCPRTC RTC cartridge in a Modular controller. Only one RTC cartridge can be installed. A memory cartridge and an RTC cartridge can be installed at the same time.

Step	Action
1	Open the hinged door.
2	Remove the cartridge cover by holding and pulling the opposite edges of the cover until it is out.
3	Push the cartridge into the Modular controller's connector until it "clicks".
4	Close the hinged door.

#### **Removing a Terminal Block**

#### Introduction

This section shows how to remove a terminal block from the TWDLMDA20DRT Modular controller.

# Removing a Terminal Block

The following procedure shows how to remove a terminal block from the TWDLMDA20DRT Modular controller.

Step	Action
1	Power off to the Modular controller and disconnect all wires.  Note: The terminal block on the left (1) must be removed before the terminal block on the right (2).
	Twide 2
2	Remove the terminal block by holding the center of the terminal block and pulling it out straight.



#### **TERMINAL BLOCK DAMAGE**

Do not pull the terminal block out from the top or bottom of the block.

Failure to follow this instruction can result in injury or equipment damage.

#### How to Install and Remove a Controller, an Expansion I/O Module, an AS-Interface Bus Interface Module or a CANopen Fieldbus Master Module from a DIN Rail

#### Introduction

This section describes how to install and remove controllers, expansion I/O modules, AS-Interface bus master modules or CANopen fieldbus master module from a DIN rail. The device you want to install or remove may differ from the illustrations in these procedures but the basic mechanism procedures are applicable.

**Note:** When mounting controllers on a DIN rail, use two end stops, type AB1-AB8P35 or equivalent.

How to Install a Controller, Expansion I/O Module, AS-Interface Bus Interface Module or CANopen Fieldbus Master Module on a DIN Rail The following procedure shows how to install a controller, expansion I/O module, AS-Interface bus master module or CANopen fieldbus master module on a DIN rail.

Step	Action	
1	Fasten the DIN rail to a panel using screws.	
2	Pull out the clamp at the bottom of the controller and module assembly.	
3	Put the top groove of the controller and module on the DIN rail and press the modules toward the DIN rail.  Groove  35 mm wide DIN rail	
4	Push the clamp into the DIN rail.	
5	Place mounting clips on both sides of the modules to prevent the system from moving sideways.	

How to Remove a Controller, Expansion I/O Module, AS-Interface Bus Interface Module or CANopen Fieldbus Master Module from a DIN Rail The following procedure shows how to remove a controller, an expansion I/O module, an AS-Interface bus master module or a CANopen fieldbus master module from a DIN rail.

Step	Action
1	Insert a flat screwdriver into the slot in the clamp.
2	Pull out the clamp.
3	Pull the controller and the associated module off the DIN rail from the bottom.

#### How to Direct Mount on a Panel Surface

#### Introduction


This section shows how to install mounting strips directly on modular controllers, expansion I/O modules, AS-Interface bus interface modules, the CANopen fieldbus interface module, the operator display expansion module, and communication expansion modules. This section also provides mounting hole layouts for each controller and module. Your controller or module may differ from the illustrations in these procedures but the basic mechanism procedures are applicable.


#### Installing a Mounting Strip

The following procedure shows how to install a mounting strip.


Step	Action
1	Remove the clamp from the back side of the module by pushing the clamp inward.
2	Insert the mounting strip, with the hook entering last, into the slot where the clamp was removed.
3	Slide the mounting strip into the slot until the hook enters into the recess in the module.

Mounting Hole Layout for Compact Controllers The following diagram shows the mounting hole layout for all the Compact controllers.

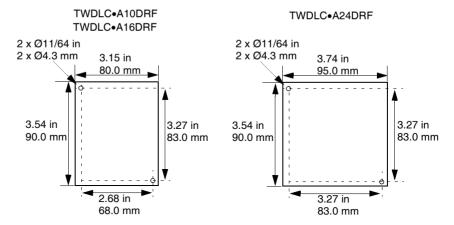

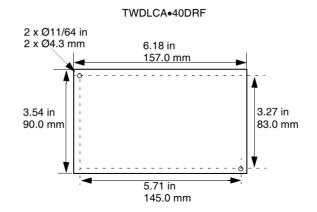


Mounting Hole Layout for Modular Controllers The following diagram shows the mounting hole layout for all the Modular controllers.

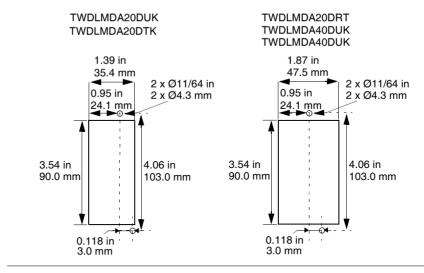


Mounting Hole Layout for Expansion I/O Modules The following diagram shows the mounting hole layout for the expansion I/O modules

TWDDDI8DT	TWDALM3LT
TWDDAI8DT	TWDAMM3HT
TWDDDI16DT	TWDAMI2HT
TWDDRA8RT	TWDAMO1HT
TWDDRA16RT	TWDAVO2HT
TWDDDO8UT	TWDAMI4LT
TWDDDO8TT	TWDAMI8HT
TWDDMM8DRT	TWD4BI8HT


TWDDDI16DK TWDDDO16TK TWDDDO16UK







TWDDDI32DK TWDDDO32TK TWDDDO32UK

TWDDMM24DRF







Mounting Hole Layout for the AS-Interface Bus Interface Module The following diagram shows the mounting hole layout for the TWDNOI10M3 AS-Interface bus interface module:



Mounting Hole Layout for the CANopen Fieldbus Master Module The following diagram shows the mounting hole layout for the TWDNCO1M CANopen fieldbus master module:



Mounting Hole Layout for Communication Expansion and Operator Display Expansion Modules The following diagram shows the mounting hole layout for the communication expansion and operator display expansion modules.

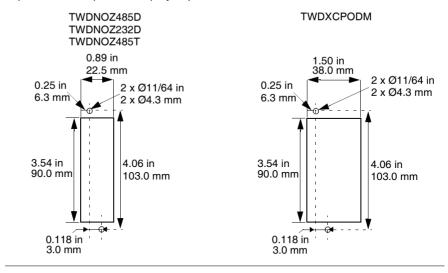


# Minimum Clearances for Controllers and Expansion I/O Modules in a Control Panel

#### Introduction


This section provides the minimum clearances for controllers and expansion I/O modules in a control panel.

Minimum
Clearances for a
Compact
Controller and
Expansion I/O
Modules

In order to maintain a natural circulation of air around the Compact controller and expansion I/O modules in a control panel, observe the minimum clearances shown in the figures below.

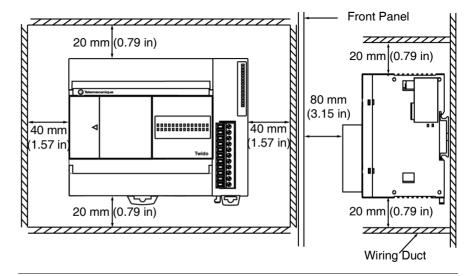

Minimum Clearances for a Modular Controller and Expansion I/O Modules In order to maintain a natural circulation of air around the Modular controller and expansion I/O modules in a control panel, observe the minimum clearances shown in the figures below.

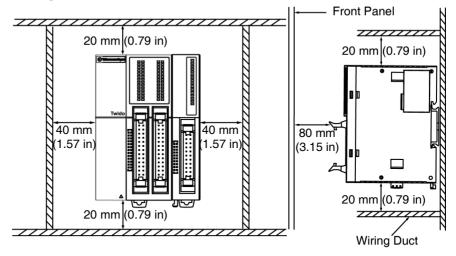

#### **How to Connect the Power Supply**

#### Introduction

This section describes how to connect the power supply to the Compact and Modular controllers.

**Note:** When operating outside of the specified voltage range, outputs may not switch accordingly. Use appropriate safety interlocks and voltage monitoring circuits.


### **▲** CAUTION

#### MAKE PROPER POWER SUPPLY CONNECTIONS

- Make sure that proper voltage and frequency is applied to the device.
- Verify that you have made proper lead connections to the power supply terminal block.

Failure to follow this instruction can result in injury or equipment damage.

Connect an AC Power Supply to a Compact Controller The following diagram shows how to connect an AC power supply to a TWDLCA•••DRF series Compact Controller.



Connect a DC
Power Supply to
a Compact
Controller


The following diagram shows how to connect a DC power supply to a TWDLCD••DRF series Compact Controller.



Compact Controller Power Supply Specifications The following table provides power supply information for the Compact controller.

Item	AC Specifications	DC Specifications
Power supply voltage	Rated power voltage: from 100 to 240 VAC	Rated power voltage: 24 VDC
	Allowable range: from 85 to 264 VAC	Allowable range: from 19.2 to 30 VDC
	The detection of the absence of a power supply depends on the number of inputs and outputs used. Usually the absence of a power supply is detected when voltage drops to less than 85 VAC, stopping the current operation to prevent malfunction.	The detection of the absence of a power supply depends on the number of inputs and outputs used. Usually the absence of a power supply is detected when voltage drops to below 14 VDC, stopping the current operation to prevent malfunction.
	Note: Momentary power interruption for 20 ms or less at 100 to 240 VAC is not recognized as power failure.	Note: Momentary power interruption for 10 ms or less at 24 VDC is not recognized as failure.
Inrush current flow at power-up	TWDLCAA10DRF and TWDLCAA16DRF: 35 A maximum TWDLCAA24DRF: 40 A maximum	
Power supply wiring	0.64 mm <sup>2</sup> (UL1015 AWG22) or 1.02 mm <sup>2</sup> (UL1007 AWG18) Make the power supply wiring as short as possible.	
Ground wiring	1.30 mm <sup>2</sup> (UL1007 AWG16)  Do not connect ground wire in common with ground wire of motor equipment.	

Connect a Power Supply to a Modular Controller The following diagram shows how to connect a power supply to a Modular Controller.



#### Modular Controller Power Supply Specifications

The following table provides power supply information for the Modular controller.

Item	Specifications
Power supply voltage	Rated power voltage: 24 VDC Allowable range: from 20.4 to 26.4 VDC The detection of the absence of a power supply depends on the number of inputs and outputs used. Usually the absence of a power supply is detected when voltage drops to below 20.4 VDC, stopping the current operation to prevent malfunction.  Note: Momentary power interruption for 10 ms or less at 24 VDC is not recognized as failure.
Inrush current flow at power-up	50 A maximum
Power supply wiring	0.64 mm <sup>2</sup> (UL1015 AWG22) or 1.02 mm <sup>2</sup> (UL1007 AWG18) Make the power supply wiring as short as possible.
Ground wiring	0.64 mm <sup>2</sup> (UL1015 AWG22) or 1.02 mm <sup>2</sup> (UL1007 AWG18)  Do not connect ground wire in common with ground wire of motor equipment.

#### How to Install and Replace an External Battery

**Note:** The following information about the external battery applies to TWDLCAA40DRF and TWDLCAE40DRF series compact base controllers only.If you own another model of compact or modular controller, you may skip this section.

#### Introduction

In addition to the built-in internal battery used for RAM backup, each of the TWDLCAA40DRF and TWDLCAE40DRF compact base controllers is equipped with a battery compartment that can host a user-replaceable external battery. Note that for most applications, no external battery is required.

The external battery option provides extended backup duration to meet the needs for long-term backup for specific applications, such as HAVC applications.

#### **Battery Type**

Your compact base controller uses one 1/2 AA, 3.6 V, lithium battery to provide optional extended data storage duration of up to 3 years.

**Note:** The external battery is not included with your Twido controller; you must purchase it separately. Please use part number TSXPLP01 to order a single battery or TSXPLP101 to order a 10 pack.

# Battery Power Status

The BAT LED indicator located on the front panel of your Twido compact controller serves as an indicator for low battery warning. The BAT LED state is described in the following table:

LED State	Description
Extinguished	Indicates that either:  • the external battery is functioning normally, or  • the BAT LED has been disabled by user by setting the %S66 system bit to 1.
Steady red	Indicates that either:  • the power of the external battery is low (voltage below 2.5V) (The external battery must be replaced within two weeks from the date the BAT LED was first lit.), or  • there is no external battery installed in the battery compartment.

#### Battery Installation Requirements

When installing or replacing the external battery, make sure the following two conditions are both met:

- 1. The internal battery of your Twido compact base must be fully charged.
- 2. After installing the external battery, you must power up your Twido controller immediately.

**Note:** Failure to meet any of the above two conditions will result in a significantly shorter battery life. The external battery life can be rapidly reduced to less than one month.

#### Installing and Replacing an External Battery

The battery compartment is located on the lower-panel of the Twido compact controller case. To install or replace an external battery, follow these steps:



#### **EXPLOSION AND FIRE HAZARD**

- Replace cell with part number TSXPLP01 (Tadiran, TL-5902) only.
- Use of another cell or battery may present a risk of fire or explosion.

Failure to follow this instruction can result in death, serious injury, or equipment damage.

Step	Action
1	Before installing or replacing the external battery, you must first make sure that the internal battery of your Twido controller is fully charged. This precaution is to ensure that the data stored in RAM memory are not lost when the external battery is removed from its compartment.
2	Press sideways on the small latch protruding from the compartment cover to unlock the door of the battery compartment.
3	Pull to open the compartment door, as shown in the figure below:
4	Remove the used battery from the compartment, if any.
5	Insert the new battery in the compartment, observing the correct polarity, as indicated by the polarity marking located inside the battery compartment.
6	Close the door of the battery compartment (make sure the latch clicks into place to lock the compartment door).
7	Power up your Twido controller immediately to preserve battery life.

#### Safe Battery Disposal

The TWDLCA•40DRF compact bases use an optional external lithium battery for longer duration of data backup. (Note: The lithium battery is not supplied with the compact bases: you must purchase it separately.)



#### **EXPLOSION AND TOXIC HAZARD**

- Do not incinerate a lithium battery for it may explode and release toxic substances.
- Do not handle damaged or leaking lithium battery.
- Dead batteries shall be disposed of properly, for improper disposal of unused batteries can cause harm, as well as environmental damage.
- In some areas, the disposal of lithium batteries with household or business trash
  collection may be prohibited. In any case, it is your responsibility to always
  conform to local regulations in your area, as regard to battery disposal.

Failure to follow this instruction can result in death, serious injury, or equipment damage.

#### Battery Status Monitoring and Control via System Bits

The following information describes how the battery status can be monitored and how the battery LED management can be controlled via two system bits %S75 and %S66, respectively:

System Bit	Description
%S75	<ul> <li>This is a read-only system bit that indicates the current battery status:</li> <li>%S75 = 0: external battery is operating normally.</li> <li>%S75 = 1: external battery power is low, or battery is absent from compartment.</li> </ul>
%S66	This system bit is writable and allows you to turn on/off the BAT LED:  Set this bit to 1 to disable the BAT LED (LED is always off even if there is no battery inside the compartment).  Set this bit to 0 to enable the BAT LED indicator. Note that the %S66 system bit is reset to 0 as default at system start-up.

#### At a Glance

#### Introduction

This chapter provides an introduction and I/O assignments for the Twido controllers' special functions. For information on configuring and using these special functions see the Twido Software Reference Guide.

# What's in this Chapter?

This chapter contains the following topics:

Topic	Page
RUN/STOP Input	246
Controller Status Output	247
Latching input	248
Fast Counting	249
Very Fast Counters	250
Pulse (PLS) Generator Output	253
Pulse Width Modulation (PWM) Output	254

#### **RUN/STOP Input**

#### Introduction

This section provides basic information on the RUN/STOP input special function.

#### **Principle**

The RUN/STOP input is a special function that can be assigned to any one of the base controller inputs. This function is used to start or stop a program.

#### Determining the State of Run/ Stop Input

At power up, if configured, the controller state is set by the Run/Stop input:

- if RUN/STOP input is at state 0, controller is in STOP mode.
- if RUN/STOP input is at state 1, controller is in RUN mode.

While the controller is powered, a rising edge on the RUN/STOP input state sets the controller to RUN. The controller is stopped if the RUN/STOP input is at 0. If the RUN/STOP input is at 0, a RUN command from a connected PC is ignored by the controller.

#### **Controller Status Output**

#### Introduction

This section provides basic information on the controller status output special function.

#### **Principle**

The controller status output is a special function that can be assigned to one of three outputs (%Q0.0.1 and %Q0.0.3) on a base or a remote controller.

At power up, if there is no controller error see *Troubleshooting Using the Controller's LEDs, p. 258*, the controller status output changes to 1. This function can be used in safety circuits external to the controller, for example, to control:

- The power supply to the output devices.
- The controller power supply.

#### Latching input

#### Introduction

This section provides basic information on the latching inputs special function.

#### **Principle**

The latching inputs is a special function that can be assigned to one of four inputs (%10.0.2 to %10.0.5) on a base or a remote controller. This function is used to memorize any pulse with a duration less than the controller scan time. When a pulse is shorter than one scan and has a value greater than or equal to 1 ms, the controller latches the pulse, which is then updated in the next scan.

#### **Fast Counting**

#### Introduction

This section provides basic information on the fast counting special function.

#### **Principle**

The base controllers have two fast counter types:

- A single up counter with a maximum frequency of 5 kHz.
- A single down counter with a maximum frequency of 5 kHz.

The single up counter and single down counter functions enable up counting or down counting of pulses (rising edges) on a digital I/O. The fast counter functions enable counting of pulses from 0 to 65535 in single-word mode and from 0 to 4294967296 in double-word mode.

# Controllers Fast Counting Capabilities

Compact controllers can have up to 3 fast counters, with the exception of the TWDLCA•40DRF series compact controllers that have 4 fast counters. Modular controllers can have up to 2 fast counters. The availability of the double-word counting option depends on the controller model. The following table lists the fast counting capabilities of the Twido line Compact and Modular controllers.

Twido Line Controllers		Compact TWD	Modular controllers TWDLMDA			
	10DRF	10DRF 16DRF 24DRF 40DRF				40D••
Fast Counters	3	3	3	4	2	2
Single-Word	Yes	Yes	Yes	Yes	Yes	Yes
Double-Word	No	Yes	Yes	Yes	Yes	Yes

#### Digital I/O Assignment for a Fast Counter

The digital I/O assignment for fast counters depends on whether digital I/O was assigned for the optional pre-set and catch inputs on the very fast counters. See *Very Fast Counters, p. 250* for more information.

#### **Very Fast Counters**

#### Introduction

This section provides basic information on the very fast counting special function.

#### Principle

The base controllers have five very fast counter types:

- An up/down counter with a maximum frequency of 20 kHz.
- An up/down 2-phase counter with a maximum frequency of 20 kHz.
- A single up counter with a maximum frequency of 20 kHz.
- A single down counter with a maximum frequency of 20 kHz.
- A frequency meter with a maximum frequency of 20 kHz.

The up/down counter, up/down 2-phase counter, single up counter, and single down counter functions enable counting of pulses from 0 to 65535 in single-word mode and pulses from 0 to 4294967296 in double-word mode. The frequency meter function measures the frequency of a periodic signal in Hz.

# Controllers Very Fast Counting Capabilities

The number of very fast counters supported varies with the Twido controller models, as shown in the table below. Also, the availability of the double-word counting option depends on the controller model. The following table lists the very fast counting capabilities of the Twido line Compact and Modular controllers.

Twido Line Controllers		Compact of TWD	Modular controllers TWDLMDA			
	10DRF	10DRF 16DRF 24DRF 40DRF				40D••
Fast Counters	1	1	1	2	2	2
Single-Word	Yes	Yes	Yes	Yes	Yes	Yes
Double-Word	No	Yes	Yes	Yes	Yes	Yes

# Digital I/O Assignment for a Very Fast Counter on all Controllers

The following tables lists the assigned I/O for one very fast counter on all controllers models.

Functions	First Input (pulses)	Second Input (pulses or Up/Down)	Pre-set Input	Catch Input	First Reflex Output	Second Reflex Output
Up/down counter	%I0.0.1 (pulses)	%10.0.0*	%10.0.2**	%10.0.3**	%Q0.0.2**	%Q0.0.3**
Up/down 2-phase counter	%I0.0.1 (pulses Phase A)	%I0.0.0 (pulses Phase B)	%10.0.2**	%10.0.3**	%Q0.0.2**	%Q0.0.3**
Single Up Counter	%I0.0.1 (pulses)	Not used	%10.0.2**	%10.0.3**	%Q0.0.2**	%Q0.0.3**
Single Down Counter	%I0.0.1 (pulses)	Not used	%10.0.2**	%10.0.3**	%Q0.0.2**	%Q0.0.3**
Frequency Meter	%I0.0.1 (pulses)	Not used	Not used	Not used	Not used	Not used

#### Note:

- \* Indicates up/down
- \*\* Optional use

Digital I/O
Assignment for
the Other Very
Fast Counter on
Modular
Controllers

The following tables lists the assigned I/O for the other very fast counter on Modular controllers only.

Functions	First Input (pulses)	Second Input (pulses or Up/Down)	Pre-set Input	Catch Input	First Reflex Output	Second Reflex Output
Up/down counter	%I0.0.7 (pulses)	%10.0.6*	%10.0.5**	%10.0.4**	%Q0.0.4**	%Q0.0.5**
Up/down 2-phase counter	%I0.0.7 (pulses Phase A)	%I0.0.6 (pulses Phase B)	%10.0.5**	%10.0.4**	%Q0.0.4**	%Q0.0.5**
Single Up Counter	%I0.0.7 (pulses)	Not used	%10.0.5**	%10.0.4**	%Q0.0.4**	%Q0.0.5**
Single Down Counter	%I0.0.7 (pulses)	Not used	%10.0.5**	%10.0.4**	%Q0.0.4**	%Q0.0.5**
Frequency Meter	%I0.0.7 (pulses)	Not used	Not used	Not used	Not used	Not used

#### Note:

- \* Indicates up/down
- \*\* Optional use

## **Pulse (PLS) Generator Output**

#### Introduction

This section provides basic information on the PLS special function.

### **Principle**

The PLS is a special function that can be assigned to output %Q0.0.0 or %Q0.0.1 on a base or a peer controller. A user-defined function block generates a signal on output %Q0.0.0 or %Q0.0.1. This signal has a variable period but has a constant duty cycle, or on to off ratio of 50% of the period.

## Controllers PLS Capabilities

The number of PLS generators supported varies with the Twido controller models, as shown in the table below. Note that all controllers that have a PLS generator support both single-word and double-word functions. The following table lists the PLS capabilities of the Twido line Compact and Modular controllers.

Twido Line Controllers	Compact controllers TWDLC••			Modular controllers TWDLMDA		
	10DRF 16DRF 24D		24DRF	40DRF	20D••	40D••
PLS Generator	None	None	None	2	2	2
Single-Word	-	-	-	Yes	Yes	Yes
Double-Word	-	-	-	Yes	Yes	Yes

## **Pulse Width Modulation (PWM) Output**

### Introduction

This section provides basic information on the PWM special function.

### Principle

The PWM is a special function that can be assigned to output %Q0.0.0 or %Q0.0.1 on a base or a peer controller. A user-defined function block generates a signal on output %Q0.00 or %Q0.0.1. This signal has a constant period with the possibility of varying the duty cycle, or on to off ratio.

## At a Glance

### Introduction

This chapter provides the procedure for the first time a controller is powered-up, checking the I/O connections, and troubleshooting the controller using the LEDs.

## What's in this Chapter?

This chapter contains the following topics:

Topic	Page
Procedure for First Time Power-Up of a Controller	256
Checking I/O Connections on the Base Controller	257
Troubleshooting Using the Controller's LEDs	258

## Procedure for First Time Power-Up of a Controller

#### Introduction

This section explains powering-up a controller for the first time.

## Power-Up Self Diagnostics

At power-up, the firmware will perform tests to ensure the proper functioning of the controller. Each major hardware component is tested for consistency. This includes the on-board PROM and RAM. Later in the booting sequence, the application is tested, using a checksum, before it can be executed.

### First Time Power-Up Procedure

There are four status LEDs that signify the state and condition of the controller. The LED labeled PWR directly monitors the power supplied to the controller. It can not be changed by the application and can not be modified by the executive firmware. The first time the controller is powered up, it will be in a non-configured state with no application programming present. This state is indicated by a blinking ERR LED. If the ERR LED is not blinking or if any of the Input/Output LEDs are illuminated, without the presence of an external signal, see *Troubleshooting Using the Controller's LEDs, p. 258.* 

## Checking I/O Connections on the Base Controller

#### Introduction

This section provides a procedure for checking the I/O connections.



### UNINTENDED OPERATION OF EXTERNAL EQUIPMENT

To avoid unintended operation of external equipment, check that:

- Power fuses are removed from the motor controls.
- Pneumatic and hydraulic inputs are closed.

Failure to follow this instruction can result in death, serious injury, or equipment damage.

# Checking I/O Connections Procedure

The following procedure ensures that the I/O connections are connected:

Step	Action
1	To test the I/O connections, the controller needs to be in the non-configured state. To accomplish this:  If an Operator Display is attached, press and hold ESC and cycle the power on the controller. After the controller restarts, the Operator Display indicates "NCF".  From TwidoSoft, issue the erase command from the Controller menu.
2	With the controller in the non-configured state, set system bit %S8 to 0. At state 0, the controller outputs are kept in their existing state.
3	Check the inputs by activating each external sensor. To accomplish this:  Check that each of the input LEDs for the corresponding bit changes state.  Using TwidoSoft's Operate Controller dialog, check that each of the input LEDs for the corresponding bit changes state.
4	Check the outputs by setting the bit corresponding to each output state to 1. To accomplish this:  Check that each of the output LEDs for the corresponding bit changes state.  Using TwidoSoft's Operate Controller dialog, check that each of the output LEDs for the corresponding bit changes state.
5	To complete this procedure, set system bit %S8 to 1. This is automatically accomplished by downloading a valid user application.

## **Troubleshooting Using the Controller's LEDs**

### Introduction

This section provides information on the controller's operating status and troubleshooting using the LEDs.

### Controller state

The following table displays the different LED states on a base controller, peer controller, and remote controller.

LED state		Base Controller or Peer Controller	Remote I/O Controller				
RUN green		Application not executed	Incorrectly or not connected				
groon		Controller is in STOP mode or execution fault (HALT)	Same as base controller				
		Controller is in RUN mode	Same as base controller				
ERR red		ОК	ОК				
ou		Application not executable, or execution error (HALT)	N/A				
		Internal faults (watchdog, etc.)	Same as base controller				
STAT	$\bigcirc$	Controlled by the user or application through system bit %S69	Same as base controller				
green		N/A	N/A				
		Controlled by the user or application through system bit %S69	Same as base controller				
BAT red		TWDLCAA40DRF and TWDLCAE40DRF Compact controllers. (For detailed information about the BAT LED status, please refer to <i>How to Install and Replace an External Battery, p. 241.</i> )					
		External battery power is OK or LED has been disabled. (Controlled by the user or system through system bit %S66)	N/A				
		N/A	N/A				
		No external battery or low battery power. Controlled by the user or system through system bit %S66	N/A				
_AN ACT		LCAE40DRF Compact controller. (For detailed information about to (See TwidoSoft Operation Guide - Online Help).)	he LAN ACT LED status, please				
green/ amber	$\bigcirc$	No Ethernet signal.	N/A				
		green: communicating over 10Base-T link. amber: communicating over 100Base-TX link.	N/A				
		green: 10Base-T network connection. amber: 100Base-TX network connection.	N/A				

LED state		Base Controller or Peer Controller Remote I/O Controller				
LAN ST green	T TWDLCAE40DRF Compact controller. (For detailed information about the refer to (See TwidoSoft Operation Guide - Online Help).)		ne LAN ACT LED status, please			
	$\bigcirc$	Base controller is powered OFF.	N/A			
		Multiple, consecutive flashes of various numbers to provide a visual diagnostic tool of the Ethernet network connection status.	N/A			
		Base controller is powered ON. Ethernet port is ready.	N/A			
	Off	Flashing Illuminat	red			

# Status of the Digital I/O Module

LED state		Digital I/O Module	
I/O LEDs	$\bigcirc$	I/O not active	
		I/O active	
Off		Illuminated	

## Status of AS-Interface bus interface module

The following table summarizes the problems that may occur on AS-Interface master module startup:

Problems		Causes and action to be taken		
PWR	0	Insufficient power is being delivered to the AS-Interface module.  Check AS-Interface power supply and connections.  Check the connection between the Twido module and the AS-Interface master.		
FLT	•	The slave configuration on the AS-Interface bus is incorrect:  Use TwidoSoft to check that the slaves are correctly connected.  If the configuration is correct and the LED remains on:  Disconnect and reconnect the AS-Interface connector, or switch off the power supply and switch it back on again.		
OFF	•	A slave is connected at address 0 at power up:  Change the slave's address and repeat power up:		
Instable slave oper	ration	If two slaves have the same address and the same identity codes, the AS-Interface master may fail to detect an error:  Remove one of the slaves from the bus and perform readdressing using TwidoSoft.		
Off		Illuminated		

## **CANopen Status LED**

The following table describes the CANopen status LED:

CANopen LED state		Possible causes and actions	
ON (Solid)	0	Bus On (no error)	
ON (Blinking)		Bus initialization in progress (at startup)	
or the bus configuration is invalid.     (See also %SW8187 and %SW2027 system wo		Possible causes:  either the CANopen master module is not powered normally,  or the bus configuration is invalid. (See also %SW8187 and %SW2027 system words to check operating status of CANopen master and slave devices	
Off		Blinking Illuminated	

## **Agency Requirements**

### Introduction

This section provides agency standards for the Twido products.

### **Standards**

Twido controllers comply with the main national and international standards concerning electronic industrial control devices.

The following are specific controller requirements:

- EN61131-2 (IEC61131-2)
- UL508
- UL1604/CSA 213 Class I Division 2 Groups A, B, C, D

## **Appendices**



## At a Glance

## Introduction

This appendix provides information on common IEC symbols used in this manual.

## What's in this Appendix?

The appendix contains the following chapters:

Chapter	Chapter Name	Page
Α	IEC Symbols	265

## **IEC Symbols**



## **Glossary of Symbols**

## Introduction

This section contains illustrations and definitions of common IEC symbols used in describing wiring schematics.

## Symbols

## Common IEC symbols are illustrated and defined in the table below:

	Fuse
- L	Load
~	AC power
+ - - +	DC power
<u>-</u>     <del>+</del>	
	Digital sensor/input, for example, contact, switch, initiator, light barrier, and so on.
<u> </u>	Earth ground
+ +	2-wire sensor
$\rightarrow$	Thermocouple element

## **Glossary**





## Analog potentiometer

It can be used to preset a value for an analog timer. All Modular controllers and Compact 10 and 16 I/O controllers have one analog potentiometer. The Compact 24 I/O controller has two:

## Analog Voltage Input Connector

Connects an analog voltage source of 0 through 10 VDC. The analog voltage is converted to a digital value and is stored in a system word.



CAN Controller Area Network: field bus originally developed for automobile applications

which is now used in many sectors, from industrial to tertiary.

Cartridge Connector

A connector to attach an optional memory cartridge or an RTC.

Catch Input Makes sure to receive short input pulses (rising pulse of 40 µs or falling pulse of 150

us minimum) from sensors without regard to the scan time.

CIA CAN in Automation: international organization of users and manufacturers of CAN

products.

_	_	_
r	$\boldsymbol{\cap}$	0
u	u	0

**Communication OBject**: transport unit on CAN bus. A COB is identified by a unique identifier, which is coded on 11 bits, [0, 2047]. A COB contains a maximum of 8 data bytes. The priority of a COB transmission is shown by its identifier - the weaker the identifier, the more priority the associated COB has.

## Communication Adapter

An optional cartridge that can be attached to any Compact controller or Operator Display Expansion Module to provide an optional Serial Port 2.

### Communication Expansion Module

An optional module that can be attached to any Modular controllers communications expansion bus to provide an optional Serial Port 2.

## Controller status output

A special function. This function is used in safety circuits, external to the controller, to control the power supply to the output devices or the controller power supply.



#### FDS

Electronic Data Sheet: description file for each CAN device (provided by the

manufacturers).

#### FRR I FD

An LED that illuminates when an error occurs in the controller.

## Expansion connector

A connector to attach expansion I/O modules.

## Expansion Connector Cover

A cover to protect the expansion connector.

## Expansion I/O Module

Either a digital or analog module that adds additional I/O to the base controller.



#### **Fast Counting**

A special function, it is available as a single up counter and single down counter. These functions enable up counting or down counting of pulses (rising edges)on a digital I/O. Compact controllers can be equipped with three fast counters. Modular controllers can have two fast counters.

#### Free Wire

The end of a digital I/O cable whose wires do not have a connector. This scheme provides connectivity from Modular I/O to discrete I/O points.



I/O Input/Output.

I/O terminals Terminals on all Modular controllers and expansion I/O modules used to connect

input and output signals. The input terminals accept both sink and source DC input signals. The output terminals are either transistor source or sink or relay contacts.

IN LED An LED that illuminates when a corresponding input is on. All modules have IN

LEDs.

Input Filter A special function that rejects input noises. This function is useful for eliminating

input noises and chatter in limit switches. All inputs provide a level of input filtering using the hardware. Additional filtering using the software is also configurable

through TwidoSoft.

Input Simulators An optional accessory for Compact controllers that is used for debugging. It can

simulate input sensors to test application logic.

Input terminals Terminals on the top of all Compact controllers used to connect input signals from

input devices such as sensors, push buttons, and limit switches. The input terminals

accept both sink and source DC input signals.



**Latching input** A special function. This function is used to memorize any pulse with a duration less

than the controller scan time. When a pulse is shorter than one scan and has a value greater than or equal to 100  $\mu$ s, the controller latches the pulse, which is then

updated in the next scan.



### Memory Cartridge

An optional cartridge available in two sizes: 32 KB and 64 KB (64 KB not available on Compact). It can be added to any controller for removable backup of applications or to load an application, if certain conditions exist. The 64 KB cartridge is also used to increase program memory.

### Modbus Master Mode

Allows the controller to initiate a Modbus query transmission, with a response expected from a Modbus slave.

### Modbus Slave Mode

Allows the controller to respond to Modbus queries from a Modbus master and is the default communications mode if no communication is configured.



### Operator display expansion module

An optional module that can be attached to any Modular controller to display program information.

### Operator display module

An optional module that can be attached to any Compact controller to display

program information.

#### **OUT LFD**

An LED that illuminates when a corresponding output is on. All modules have OUT

LEDs.

#### **Output terminals**

Terminals on the bottom of all Compact controllers used to connect output signals from output devices such as electromechanical relays and solenoid valves. The

internal output relay contact is rated up to 240 VAC/2A or 30 VDC/2A.



### **PLS**

A special function. This user-defined function block generates a signal on output %Q0.0.0 or %Q0.0.1. This signal has a variable period but has a constant duty cycle, or on to off ratio of 50% of the period.

Power Supply

The power supply is connected to these terminals to provide power to the controller. The power voltage for a Compact controller is 100-240 VAC and 24 VDC for a

Modular controller.

**PWM** 

A special function. This user-defined function block generates a signal on output %Q0.0.0 or %Q0.0.1. This signal has a constant period with the possibility of varying

the duty cycle, or on to off ratio.

**PWRIFD** 

An LED that illuminates when power is supplied to the controller.



Removable Cover A cover on all Compact controllers that can be removed to install an optional

Operator Display.

RTC Real Time Clock.

RTD Temperature detector of type PT100, PT1000 etc. Resistor Temperature Detector.

**RUN LED** An LED that illuminates when the controller is executing a program.



Sensor power

Supplies power to the sensors (24 VDC, 400 mA for -40DRF compact controllers and 250 mA for all other controllers). Output terminals are only intended for input

devices and should not be used as a source for driving external loads.

Serial Port 1

An EIA RS-485 connector used to download and monitor the controller operation

using TwidoSoft.

Serial port 2

An optional port that can be configured as either EIA RS-232 or EIA RS-485.

STAT LED

An LED that blinks on and off to indicate a specific status of the user program.



### Terminal cover

A cover on all Compact controllers to protect the input and output terminals.



## Very Fast Counting

A special function available as an up/down counter, an up/down 2-phase counter, a single up counter, a single down counter, and frequency meter. The counter functions enable counting of pulses from 0 to 65,535 in single-word mode and from 0 to 4,294,967,295 in double-word mode. The frequency meter function measures the frequency of a periodic signal in Hz.



## Index

#### AS-Interface Master module TWDNOI10M3 Δ Dimensions, 202 Accessories 18 LEDs. 142 Adding a second serial port Operating modes, 141 Compact, 217 Push buttons, 140 Modular, 218 Specifications, 17 Agency requirements, 261 Status, 260 Analog I/O modules AS-Interface TWDNOI10M3 master module Input specifications, 111, 114 Mounting hole layout, 234 Mounting positions, 207 Parts description, 134 Output specifications, 117 Specifications, 135 Overview, 107 AS-Interface V2 bus. 125 Parts description, 109 Components, 129 Specifications, 17, 110 Main specifications, 132 Wiring schematics, 119 Reminder, 126 Analog potentiometers, 25, 39 Specifications, 135 Physical description, 62 Assembling Analog voltage input, 25 Communication expansion module, 217 Overview, 63 Operator display expansion module, 215 ASCII protocol, 27 AS-Interface bus Illustration, 127 В AS-Interface cable Batterv Connection procedure, 138 External battery, 241 Specifications, 137 **Built-in functions** AS-Interface Master module, 14 Compact specifications, 47 AS-Interface master module, 125 Modular specifications, 68 Assembling to a controller, 209 Disassembling from a controller, 212 Mounting positions, 207

TWD USE 10AE 273

Cables, 14, 19, 180

CANopen 43 Field bus interface, 157 Backup internal battery specifications, 43 CANopen fieldbus, 145 Connect a DC power supply, 239 Specifications, 152 Connect an AC power supply, 238 Topology, 147 DC input specifications, 48 CANopen fieldbus master module Dimensions, 195 Assembling to a controller, 209, 212 Electrical specifications, 44, 45 Mounting positions, 207 I/O usage limits, 50 CANopen Master module, 14 Input internal circuit, 49 Installing a communication adapter, 217 CANopen master module, 145 CANopen Master module TWDNCO1M Installing a memory cartridge, 224 Specifications, 17 Installing an operator display module. CANopen power supply cable 213 Connection procedure, 154 Installing an RTC, 224 CANopen TWDNCO1M master module Minimum clearance 236 CANopen Status LED, 260 Mounting hole layout, 231 Mounting hole layout, 234 Normal operating specifications, 42 Parts description, 151 Operating range, 49 Specifications, 152 Output delay, 52 Checking I/O connections, 257 Overview, 36 Communication adapters Parts description, 40, 41 Installing in a Compact, 217 Power supply specifications, 239 Installing in a operator display expansion Relay output contact, 53 Relay output specifications, 51 module, 218 Overview, 159 Transistor source output contact, 53 Parts description, 160 Transistor source output specifications. Specifications, 162 52 Communication architecture, 26 Wiring schematics, 54 Communication expansion modules Configuration Assembling to a Modular, 219 Compact, 21 Dimensions, 204 Hardware, 21 Disassembling from a Modular controller. Modular, 21 220 Connect a DC power supply Compact, 239 Mounting hole layout, 235 Overview, 159 Connect a power supply Parts description, 160 Modular, 240 Communication functions Connect an AC power supply Compact specifications, 46 Compact, 238 Modular specifications, 67 Controller status output, 247 Controllers Compact Backup external battery specifications, Analog potentiometers, 39 Assembling an expansion I/O, an AS-Interface bus master module or a CANopen fieldbus master module, 209 Assembling to a communication

expansion module, 219	Digital I/O modules
Compact, 14	Dimensions, 199, 200, 201
Dimensions, 195, 197	I/O usage limits, 88, 93
Disassembling an expansion I/O, an AS-	Input internal circuit, 93
Interface bus master module or a	Internal circuit, 87
CANopen fieldbus master module, 212	Mounting positions, 207
Disassembling of a communication	Operating range, 86, 93
expansion module, 220	Output delay, 89, 94
Disassembling of an operator display	Overview, 80
expansion module, 216	Parts description, 83
Functions, 24	Relay output contact, 95
Installing a communication adapter, 217	Specifications, 16, 85, 89, 90, 91, 92, 94
Installing on a DIN rail, 228	Status, 259
Minimum clearance, 236	Transistor sink output contact, 95
Modular, 14	Transistor source output contact, 95
Mounting positions, 207	Wiring schematics, 96
Parts description, 40, 41, 64	Dimensions
Removing from a DIN rail, 229	AS-Interface Master module
Specifications, 15	TWDNOI10M3, 202
Status, 258	Communication expansion module, 204
Wiring schematics, 54, 75	Controller, 197
Counters	Digital I/O modules, 199, 200, 201
Fast counters, 249	Modular, 197
Very fast, 250	Operator display expansion module, 203
	Operator display module, 203
_	Disassembling
D	Communication expansion module, 217
Dedicated function blocks, 25	Double-word
Determining the state of Run/Stop input, 246	Fast counters, 249
Digital I/O assignment	PLS, 253
Controller status output, 247	Very fast counters, 250
Fast counters, 249	•
Latching input, 248	_
PLS, 253	E
PWM, 254	Ethernet port, 41
RUN/STOP input, 246	Execution time, 24
Very fast counters, 251, 252	Expansion I/O modules
Digital I/O cables, 14	Assembling to a controller, 209
,	Disassembling from a controller, 212
	Mounting hole layout, 233
	Expansion I/O Modules Analog I/O modules,
	85
	Expansion I/O Modules Digital I/O modules,
	85
	Expansion modules
	Specifications, 162

## External battery, 241 F Fast counters, 249 Double-word, 249 Single-word, 249 Field bus interface Connection, 157 First time power-up procedure, 256 I/O connections Checking, 257 I/O modules Analog, 14 Digital, 14 I/O specifications Compact controller, 48 I/O usage limits Compact controllers, 50 Digital I/O modules, 88, 93 Modular controllers, 71 IEC symbols, 265 Input internal circuit Compact controllers, 49 Digital I/O modules, 93 Modular controllers, 70 Input simulators Overview, 169 Installation preparation, 206 Installing Communication adapter, 217 Memory cartridge, 224 Operator display module, 213 Installing on a DIN rail, 228 Internal circuit Digital I/O modules, 87

Latching input, 248

Status, 258

**LED** 

## M

Main Functions, 24 Maximum hardware configuration, 21 Memory capacity, 24 Memory cartridge Installing in a Compact, 224 Installing in a Modular, 225 Overview, 169 Specifications, 170 Minimum clearance Compact, 236 Controllers, 236 Modular, 237 Modbus Master mode, 27 Protocol, 27 Slave mode, 27 Modular Assembling to a communication expansion module, 219 Backup battery specifications, 66 Connect a power supply, 240 DC input specifications, 69 Dimensions, 197 Disassembling of a communication expansion module, 220 Disassembling of an operator display

expansion module, 216 Operator display expansion module Electrical specifications, 66 Assembling, 215 I/O usage limits, 71 Dimensions, 203 Input internal circuit, 70 Installing a communication adapter, 218 Installing a memory cartridge, 225 Mounting hole layout, 235 Installing an RTC, 225 Overview 164 Minimum clearance, 237 Parts description, 166 Mounting hole layout, 232 Specifications, 167 Normal operating specifications, 65 Operator display expansion modules Disassembling from a Modular controller. Operating range, 70 Output delay, 74 216 Overview, 60 Operator display module Dimensions, 203 Parts description, 64 Power supply specifications, 240 Installing in a Compact, 213 Relay output contact, 74 Overview 164 Relay output specifications, 73 Parts description, 165 Specifications, 167 Removing the terminal block, 226 Transistor sink output contact, 74 Options, 14 Transistor sink output specifications, 72 Communication adapters, 18 Transistor source output contact, 74 Communication expansion modules, 18 Transistor source output specifications, Connectors, 18 72 Input simulators, 18 Wiring schematics, 75 Memory cartridges, 18 Mounting hole layout Operator display expansion module, 18 AS-Interface TWDNOI10M3 master Operator display module, 18 module, 234 Overview, 169 CANopen TWDNCO1M master module, RTC, 18 Specifications, 170 Communication expansion modules, 235 Terminal blocks, 18 Compact controller, 231 Output delay Compact controllers, 52 Expansion I/O modules, 233 Modular controller, 232 Digital I/O modules, 89, 94 Operator display expansion module, 235 Modular controllers, 74

Operating range Compact controllers, 49 Digital I/O modules, 86, 93 Modular controllers, 70

Overview	Protocol
Analog I/O module, 107	ASCII, 27
AS-Interface V2 bus, 131	Modbus, 27
Communication adapters, 159	Modbus TCP/IP, 27
Communication expansion modules, 159	Remote link, 27
Compact, 36	Pulse generator output, 253
Digital I/O module, 80	Pulse width modulation, 254
Input simulators, 169	PWM, 254
Memory cartridge, 169	1 11111, 201
Modular, 60	
Operator display expansion module, 164	R
Operator display module, 164	DAM bookup 04
Options, 169	RAM backup, 24
Real Time Clock cartridge, 169	Read before starting, 206
hear time Clock carriage, 169	Real Time Clock cartridge
	Overview, 169
P	Specifications, 170
	Relay output contact
Parts description	Compact controllers, 53
Analog I/O modules, 109	Digital I/O modules, 95
AS-Interface TWDNOI10M3 master	Modular controllers, 74
module, 134	Remote link protocol, 27
CANopen TWDNCO1M master module,	Removing
151	Terminal block, 226
Communication adapters, 160	RTC
Communication expansion modules, 160	Installing in a Compact, 224
Controllers, 64	Installing in a Modular, 225
Digital I/O modules, 83	RUN/STOP input, 246
Modular, 64	
Operator display expansion module, 166	•
Operator display module, 165	S
Physical description	Scanning, 24
Analog potentiometer on Compact	Single counter
controller, 39	Down, 249
Analog potentiometer on Modular	Up, 249
controller, 62	Single-word
PLS, 253	Fast counters, 249
Double-word, 253	PLS, 253
Single-word, 253	Very fast counters, 250
Power supply	Special functions
Specifications, 239, 240	Controller status output, 247
Power-up self diagnostics, 256	Fast counters, 249
Programming cables, 14, 19	Latching input, 248
Programming port, 24	PLS, 253
- 5 ··· ····· · 5   F ··· · · · - ·	PWM, 254
	RUN/STOP input, 246
	Very fast counters, 250
	very last counters, 200

Special I/O, 25	TWDNOI10M3, 260
Specifications	CANopen TWDNCO1M master module,
Analog I/O module input, 111, 114	260
Analog I/O module output, 117	Controller, 258
Analog I/O modules, 17, 110	Digital I/O module, 259
AS-Interface cable, 137	LED, 258
AS-Interface Master module	Symbols, 265
TWDNOI10M3, 17	•
AS-Interface TWDNOI10M3 master	_
module, 135	T
AS-Interface V2 bus, 131, 135	TCP/IP
CANopen fieldbus, 152	Protocol, 27
CANopen Master module TWDNCO1M,	Telefast
17	Bases, 180
CANopen TWDNCO1M master module,	Dimensions, 205
152	Pre-wired systems, 14, 18
Communication adapters, 162	Specifications, 183
Compact AC power supply, 44	System overview, 180
Compact built-in functions, 47	Wiring schematics, 185
Compact communication functions, 46	Topology
Compact controller normal operating, 42	CANopen fieldbus, 147
Compact DC input, 48	Transistor sink output contact
Compact DC power supply, 45	Digital I/O modules, 95
Compact relay output, 51	Modular controllers, 74
Compact transistor source output, 52	Transistor source output contact
Controllers, 15	Compact controllers, 53
Digital I/O modules, 16, 85, 89, 90, 91,	Digital I/O modules, 95
92, 94	Modular controllers, 74
Expansion modules, 162	Troubleshooting, 256
Memory cartridges, 170	Using LEDs, 258
Modular built-in functions, 68	
Modular communication functions, 67	
Modular controller DC input, 69	U
Modular controller normal operating, 65	Unintended operation of external equipment,
Modular controller power supply, 66	257
Modular relay output, 73	
Modular transistor sink output, 72	M
Modular transistor source output, 72	V
Operator display expansion module, 167	Very fast counters, 250
Operator display module, 167	Double-word, 250
Power supply, 239, 240	Single-word, 250
Real Time Clock cartridge, 170	
Standards, 261	
Starting, 206	
Status	

TWD USE 10AE 279

AS-Interface Master module

## W

Wiring schematics
Analog I/O modules, 119
Compact, 54
Controller, 54, 75
Digital I/O modules, 96
Modular, 75
Telefast bases, 185