
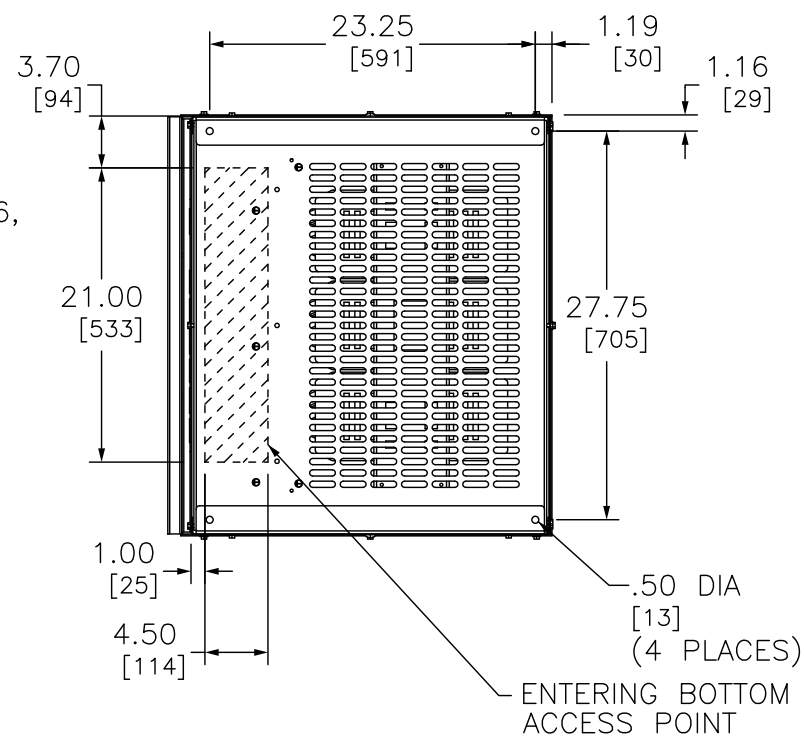
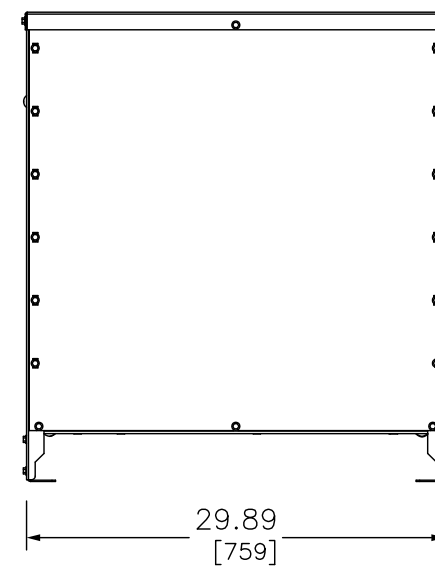
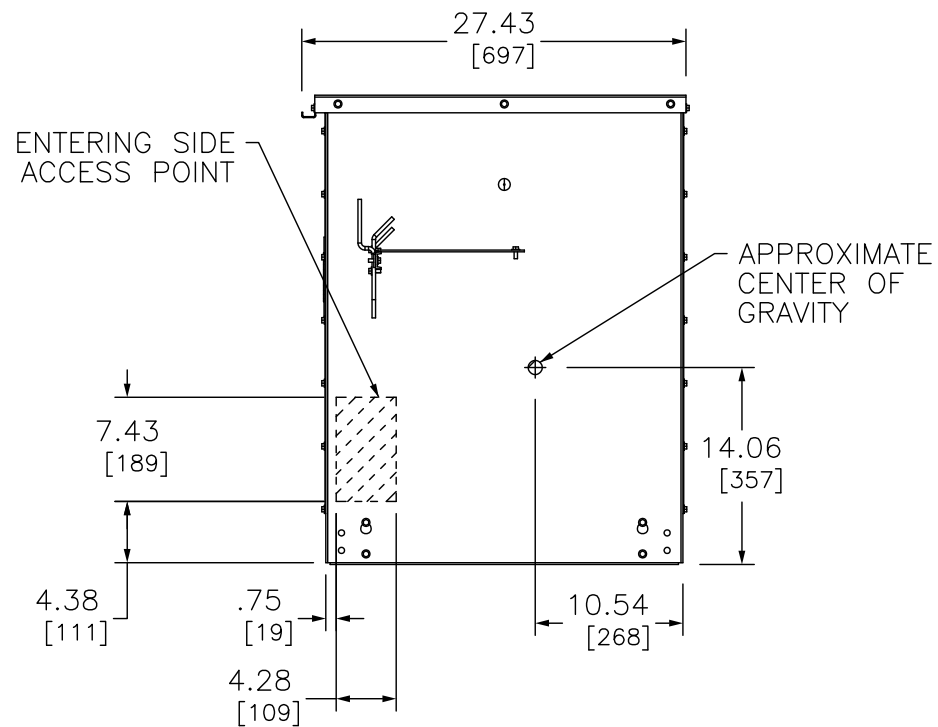


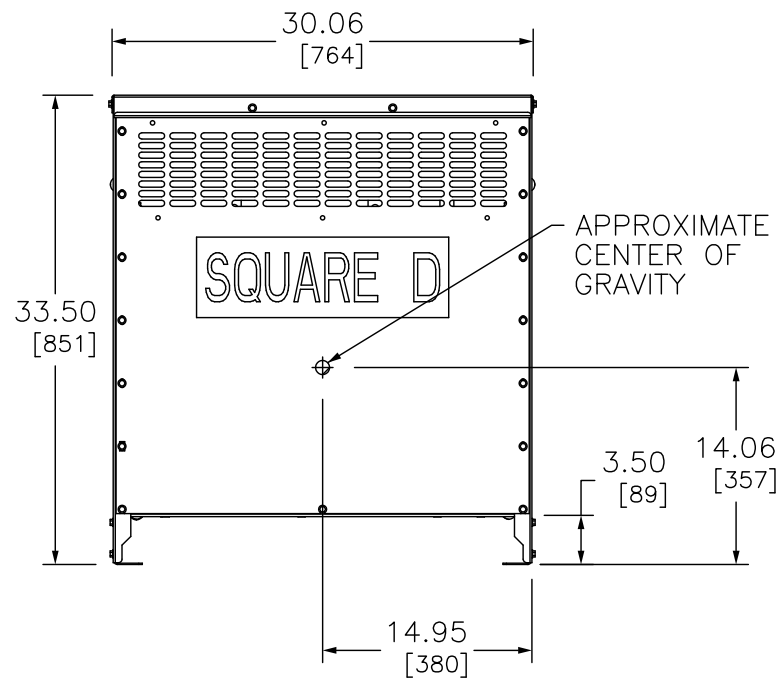

SEISMIC QUANTIFICATION

TO BE COMPLIANT WITH THE SEISMIC REQUIREMENTS OF ASCE/SEI 7, THIS UNIT IS SELF CERTIFIED TO ICS ES AC156, BY SHAKE TABLE QUALIFICATION TESTING. THE ENCLOSURE ABOVE IS 20M.

TRANSFORMER SPECIFICATION

75 KVA 3 PHASE 60 HERTZ
PRIMARY VOLTAGE: 480 DELTA
SECONDARY VOLTAGE: 208Y/120
115°C RISE ABOVE 40°C AMBIENT
220°C INSULATION SYSTEM COPPER WINDING
APPROXIMATE WEIGHT: 653 LBS
GUARANTEED SOUND LEVEL: 45 dB
TYPE 2 ENCLOSURE PAINTED ANSI 49 GREY
MINIMUM EFFICIENCY 98.60% @ 35% LOADING 75°C
COMPLYING WITH DOE 2016-10 CFR 431
(78 FR 23335-APRIL 18, 2013)

NOTES:



cULus List TO UL 1561 AND C22.2No47, FILE NUMBER E6868
ALL UNITS 100% TESTED PRIOR TO SHIPPING TO NEMA ST-20 (2014)
MANUFACTURE IN ISO 9001 FACILITIES
GREEN PREMIUM (RoHS/REACH COMPLIANT, PRODUCT ENVIRONMENT PROFILE)
REGISTERED TO DOE VIA 10 CFR 429 & NRCAN
MINIMUM CLEARANCE 1/2 INCH PER ALCOVE TESTING UL 1561. SIDES AND REAR
FRONT ACCESS MUST COMPLY WITH NEC WORK SPACE REQUIREMENTS,
MINIMUM CLEARANCE OF 6 INCHES.
CONDUIT ENTRY AREA ARE SHOWN ABOVE, LOCATIONS ARE FRONT SIDES
AND FRONT BOTTOM

DUAL DIMENSIONS: INCHES
MILLIMETERS

LOW VOLTAGE DISTRIBUTION TRANSFORMER
DOE 2016
DRY TYPE TRANSFORMERS CATALOG NO EXN75T3HFCU
3 PHASE, 480 DELTA
SECONDARY 208Y /120, COPPER


SQUARE D
by Schneider Electric

DWG# EXN75T3HFCU PG 1
NO.

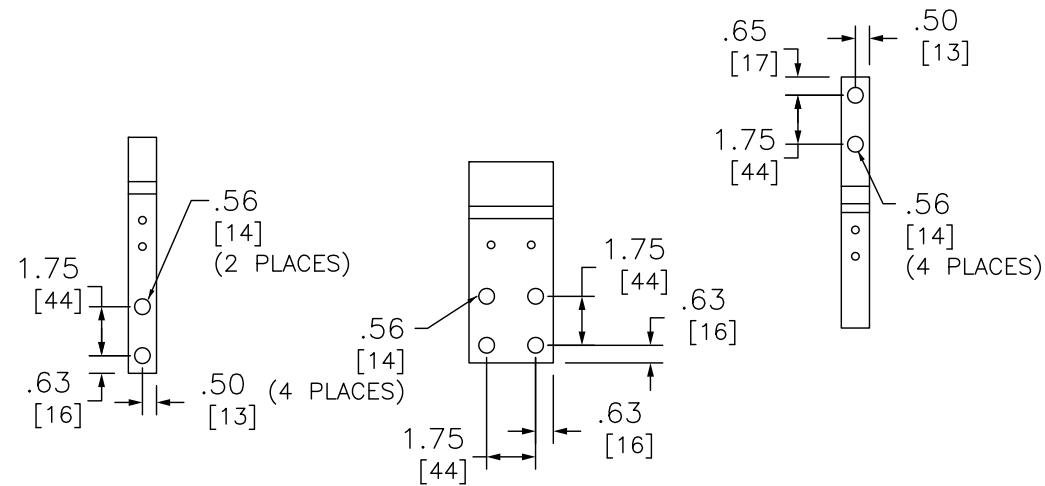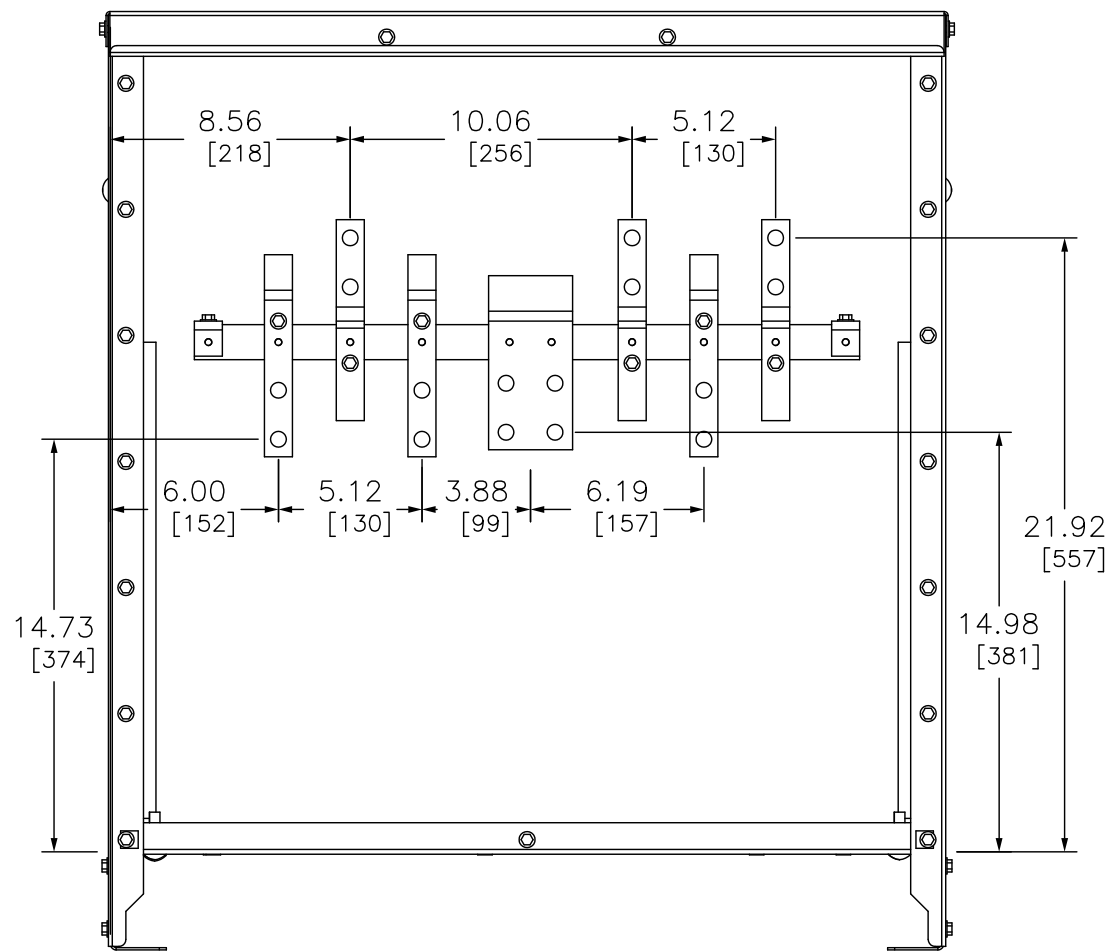

IN EACH PHASE CONNECT TO TAPS	
PRIMARY VOLTS	2-2.5% FCAN 4-2.5% FCBN
504	1
492	2
480	3
468	4
456	5
444	6
432	7

NOTE: ACTUAL VOLTAGES & NAMEPLATE VALUES MAY NOT MATCH VOLTAGE IN TABLE

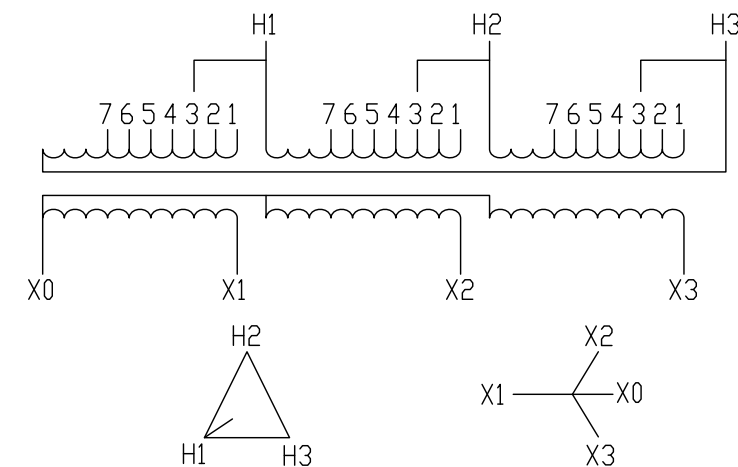

DUAL DIMENSIONS: INCHES
MILLIMETERS

LOW VOLTAGE DISTRIBUTION TRANSFORMER
DOE 2016
DRY TYPE TRANSFORMERS CATALOG NO EXN75T3HFCU
3 PHASE, 480 DELTA
SECONDARY 208Y /120, COPPER

SQUARE D™
by **Schneider Electric**

DWG# EXN75T3HFCU PG 2
NO.